Alpha Maintenance Systems



Analysis Report ATLAS COPCO PTS1600 (864909/18504)

Class D

Class E

Class F

max -10°C

max -15°C max -20°C

System: Sump Capacity:	DIESEL 6000 L	Customer:	ATLAS COPCO RENTAL EUROPE Luc Despeghel
Fuel type	DIESEL	Address:	INDUSTRIEWEG 1F
Labocodenbr:	109897-tqf9		
Samplenumber:	17.06.24 T003		B- 2850 BOOM
Labelnumber:	429000801401		
Date sample drawn:	6.06.2024	Your customer:	864909/18504
Sampling:	by client	Your ref.:	B/864909/18504/PTS1600

Diagnostic

Appearance : bright red. There is no visual precipitation. For the insolubles (based on EN12662), 24821 of sample was used. Defilement of the sample by an increased level of insolubles. Microscopic examination of the patch shows the presence of polymers, black particles and silicon particles. The particle pollution level is normal. No bacteria or fungi present in the fuel. AMS 002259


Results:		Current sample			17.06.24 T00
Analysis date		17/06/2024			
Sample date		6/06/2024			
Fuel condition:			EN 590	Min	Max
Density	kg/m³			820.0	845.0
Visual		red			
S: Sulfur content	ppm	7.44			10.0
Viscosity at 40°C	cSt	2.9		2.0	4.5
Water content	ppm	42			200
Pollution/additives:			EN 590	Min	Max
Al: Aluminium content	ppm	< 1			10.0
Ba: Barium content	ppm	< 1			10.0
Ca: Calcium content	ppm	< 1			10.0
Cu: Kopper content	ppm	< 1			10.0
Fe: Iron content	ppm	< 1			10.0
Mg: Magnesium content	ppm	< 1			10.0
Mn: Mangan content	ppm	< 1			2.0
Na: Sodium content	ppm	< 1			10.0
Pb: Lead content	ppm	< 1			10.0
V: Vanadium content	ppm	< 1			10.0
Zn: Zink content	ppm	< 1			10.0
Bacteria		0			
Insolubles	mg/kg	41			24-50: Follow-up
					>50: Alert
Quality:			EN 590	Min	Max
Distillate at 250°C	V%				< 65
Distillate at 350°C	V%			85.0	
95% (V/V) distilled at	°C				360.0
Flashpoint	°C			> 55.0	
Cetane index				46.0	
Cetane number				51.0	
PAK (Aromaten)	m%				8.0
FAME (biodiesel)	V%				7.0
CFPP	°C			A-class	max +5°C
				Class B	max 0°C
				Class C	max -5°C

These conclusions are based on the tested supplied samples and information where the representativeness and validity cannot be guaranteed. Opinions and interpretation are outside the scope of accreditation. The measurement uncertainty is available on request. Samples are destroyed 2 months after receipt. The report may only be reproduced complete. Distribution on the responsibility of the client. Methods are modified according to specified method. (A)Accreditation. (U)Outsourced.

Alpha Maintenance Systems



Annex ATLAS COPCO PTS1600 (864909/18504)

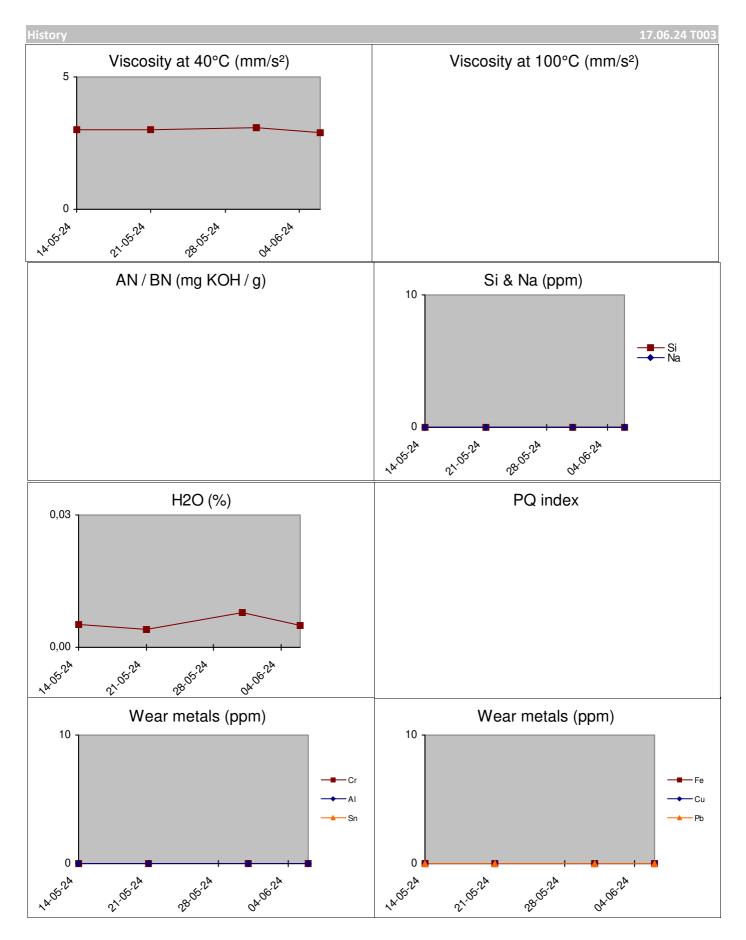

These conclusions are based on the tested supplied samples and information where the representativeness and validity cannot be guaranteed. Opinions and interpretation are outside the scope of accreditation. The measurement uncertainty is available on request. Samples are destroyed 2 months after receipt. The report may only be reproduced complete. Distribution on the responsibility of the client. Methods are modified according to specified method. (A)Accreditation. (U)Outsourced.

 Batch:
 2417604 - p.2 / 4
 Diagnosis:
 ANW
 Date of issue:
 24/06/2024
 B118
 AC RENTAL EUROPE.


 Alpha
 MS - Bergensesteenweg
 713 - 1600
 Sint-Pieters-Leeuw - Belgium - Tel.:
 00
 32
 2
 365
 02
 29
 - Fax.:
 00
 32
 2
 361
 34
 58

Alpha Maintenance Systems




Particle count

ATLAS COPCO PTS1600 (864909/18504)

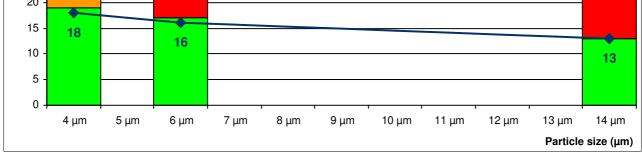

AS4059 class	Particles / 100ml			Class
	A:	> 4µ	185430	A8
	B:	> 6µ	57680	B8
	C:	> 14µ	4910	C7
	D:	> 21µ	800	D7
	E:	> 38µ	10	E3
	F:	> 70µ	0	F000

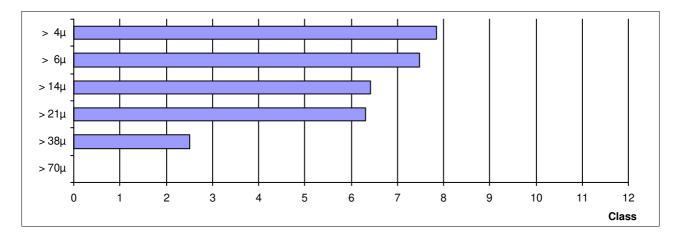

 These conclusions are based on the tested supplied samples and information where the representativeness and validity cannot be guaranteed. Opinions and interpretation are outside the scope of accreditation. The measurement uncertainty is available on request. Samples are destroyed 2 months after receipt. The report may only be reproduced complete. Distribution on the responsibility of the client. "Methods are modified according to specified method.

 (A)Accreditation. (U)Outsourced.
 Diagnosis: ANW
 Date of issue: 24/06/2024
 B118
 AC RENTAL EUROP

B118 AC RENTAL EUROPE. Alpha MS - Bergensesteenweg 713 - 1600 Sint-Pieters-Leeuw - Belgium - Tel.: 00 32 2 365 02 29 - Fax.: 00 32 2 361 34 58.





Microscopical analysis ATLAS COPCO PTS1600 (864909/18504)

System:	DIESEL	Labocodenbr:	109897-tqf9
Sump Capacity:	6000 L	Labelnumber:	429000801401
Lubricant:	DIESEL	Samplenumber:	06.06.24
Your ref.:	B/864909/18504/PTS1600	Analysis date:	17.06.24

The sample was diluted with an organic pre-filtered solvent and filtered on a 0.7 µm fiberglass filter. After filtration, the filtrate was dried and analyzed under microscope.

Particle type:	None	Few	Moderate	Many
White metal:				
Black particles:			\checkmark	
Rust particles:				
Silicon:			\checkmark	
Fibers:				
Weldings:				
Plastics:				
Copper:				
Polymers:			\checkmark	

Final judgement:

Normal	Moderate	🗌 High
	500µm	

These conclusions are based on the tested supplied samples and information where the representativeness and validity cannot be guaranteed. Opinions and interpretation are outside the scope of accreditation. The measurement uncertainty is available on request. Samples are destroyed 2 months after receipt. The report may only be reproduced complete. Distribution on the responsibility of the client. "Methods are modified according to specified method. (A)Accreditation. (U)Outsourced.