



**PERFORMANCE  
UNDER  
PRESSURE**

**OIL ANALYSIS REPORT**

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>ABNORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**CATERPILLAR EMD CAT 4125**

Component  
**Diesel Engine**

Fluid  
**SAE 40W (110 GAL)**

**RECOMMENDATION**

We advise that you check for possible coolant leak. Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>RP025608</b>	---	---
Sample Date		Client Info		<b>05 May 2007</b>	---	---
Machine Age	hrs	Client Info		<b>5084</b>	---	---
Oil Age	hrs	Client Info		<b>1024</b>	---	---
Filter Age	hrs	Client Info		<b>1024</b>	---	---
Oil Changed		Client Info		<b>Changed</b>	---	---
Filter Changed		Client Info		<b>Changed</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m		<b>7</b>	---	---
Chromium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m		<b>1</b>	---	---
Lead	ppm	ASTM D5185m		<b>0</b>	---	---
Copper	ppm	ASTM D5185m		<b>5</b>	---	---
Tin	ppm	ASTM D5185m		<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---

**CONTAMINATION**












Sodium and/or potassium levels are high indicating a possible coolant leak.

Silicon	ppm	ASTM D5185m		<b>4</b>	---	---
Potassium	ppm	ASTM D5185m		<b>▲ 13</b>	---	---
Fuel		WC Method		<b>&lt;1.0</b>	---	---
Water		WC Method		<b>NEG</b>	---	---
Glycol	%	*ASTM D2982		<b>NEG</b>	---	---
Soot %	%	*ASTM D7844		<b>0</b>	---	---
Nitration	Abs/cm	*ASTM D7624		<b>5.</b>	---	---
Sulfation	Abs/.1mm	*ASTM D7415		<b>16.</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual		<b>NEG</b>	---	---

**FLUID CONDITION**

The condition of oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>▲ 378</b>	---	---
Boron	ppm	ASTM D5185m		<b>1</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>4</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>140</b>	---	---
Calcium	ppm	ASTM D5185m		<b>2985</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>734</b>	---	---
Zinc	ppm	ASTM D5185m		<b>880</b>	---	---
Oxidation	Abs/.1mm	*ASTM D7414		<b>6.</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896		<b>8.01</b>	---	---
Visc @ 100°C	cSt	ASTM D445		<b>14.31</b>	---	---

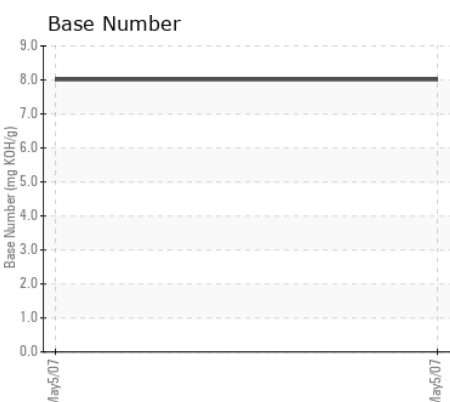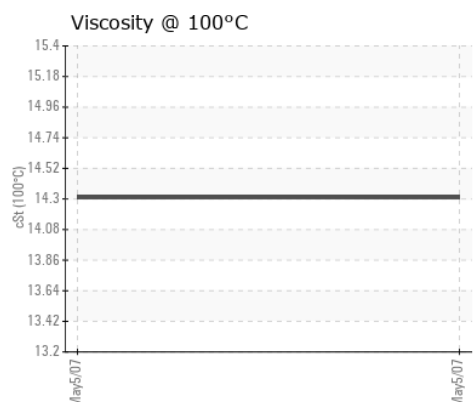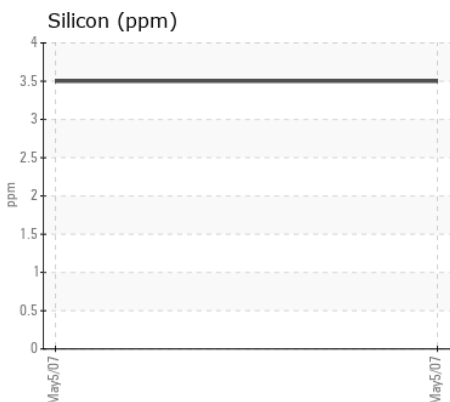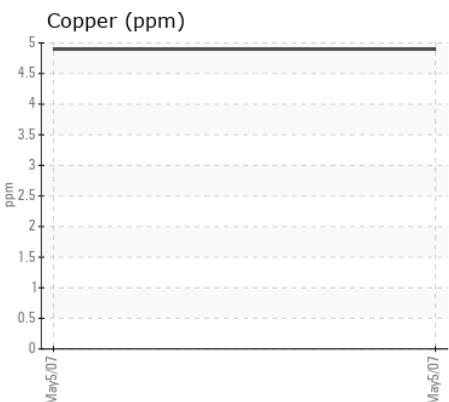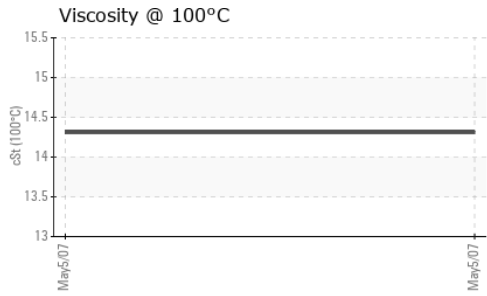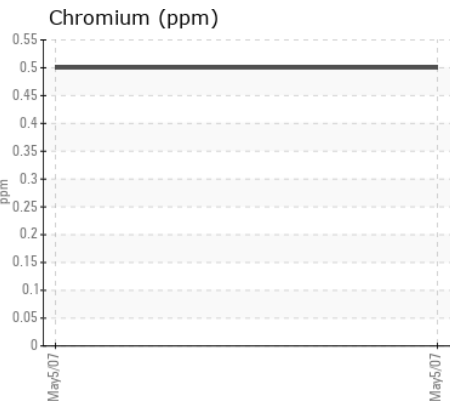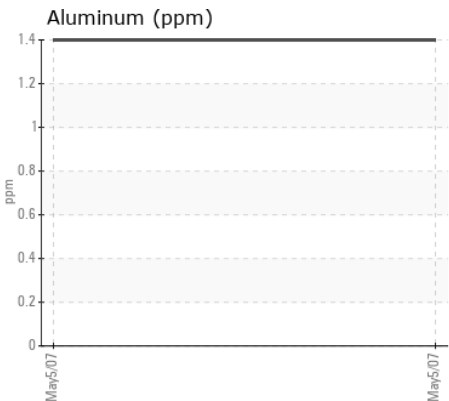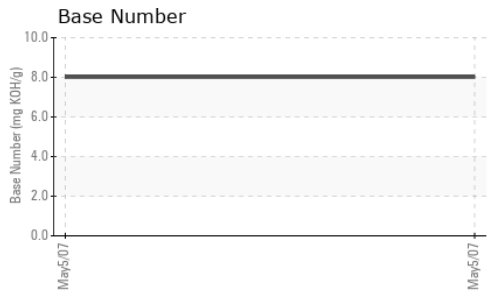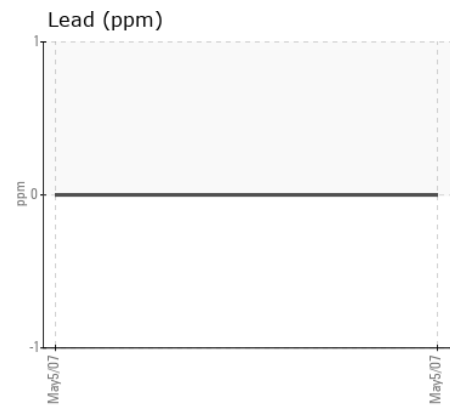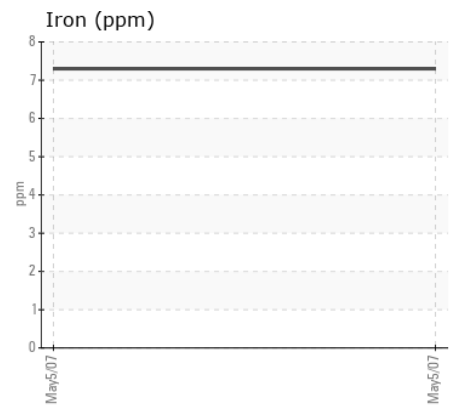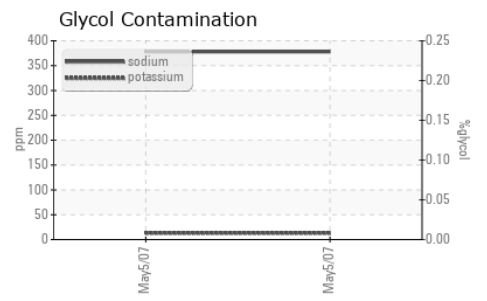

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP025608 **Received** : 21 May 2007  
**Lab Number** : 01963084 **Tested** : 23 May 2007  
**Unique Number** : 4111779 **Diagnosed** : 23 May 2007 - Doug Bogart  
**Test Package** : MOB 2 ( Additional Tests: Glycol )

**OILMAX S.A.S.**  
 AV 6 DICIEMBRE Y GASPARD CANTERO  
 QUITO-ECUADOR,

Contact: DANNY BARREIRO  
 oilmax.ec@gmail.com  
 T: (593)996-451694

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: x: