



WEAR CHECK

OIL ANALYSIS REPORT

WEAR	ABNORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ABNORMAL

Machine Id
CLOVER SCREEN 120 #2
Component
Gearbox
Fluid
GEAR OIL ISO 220 (--- GAL)

RECOMMENDATION

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

WEAR

Copper and tin ppm levels are abnormal. Bearing and/or bushing wear is indicated.







CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

Viscosity of sample indicates oil is within SAE 50 range, advise investigate. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0738316	WC0738280	---
Sample Date		Client Info		19 Sep 2023	05 Jul 2023	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		N/A	Not Changd	---
Filter Changed		Client Info		N/A	Not Changd	---
Sample Status				ABNORMAL	ABNORMAL	---
PQ		ASTM D8184*		0	0	---
Iron	ppm	ASTM D5185(m)	>200	13	13	---
Chromium	ppm	ASTM D5185(m)	>10	0	0	---
Nickel	ppm	ASTM D5185(m)	>10	8	8	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)		0	0	---
Aluminum	ppm	ASTM D5185(m)	>25	0	<1	---
Lead	ppm	ASTM D5185(m)	>50	7	8	---
Copper	ppm	ASTM D5185(m)	>200	▲ 295	▲ 297	---
Tin	ppm	ASTM D5185(m)	>10	▲ 41	▲ 41	---
Vanadium	ppm	ASTM D5185(m)		0	0	---
White Metal	scalar	Visual*	NONE	NONE	VLITE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---
Silicon	ppm	ASTM D5185(m)	>50	15	14	---
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	---
Water		WC Method	>0.2	NEG	NEG	---
Silt	scalar	Visual*	NONE	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	VLITE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	---
Sodium	ppm	ASTM D5185(m)		4	4	---
Boron	ppm	ASTM D5185(m)	50	<1	<1	---
Barium	ppm	ASTM D5185(m)	15	<1	0	---
Molybdenum	ppm	ASTM D5185(m)	15	0	0	---
Manganese	ppm	ASTM D5185(m)		<1	<1	---
Magnesium	ppm	ASTM D5185(m)	50	2	2	---
Calcium	ppm	ASTM D5185(m)	50	674	675	---
Phosphorus	ppm	ASTM D5185(m)	350	424	445	---
Zinc	ppm	ASTM D5185(m)	100	12	13	---
Sulfur	ppm	ASTM D5185(m)	12500	446	532	---
Visc @ 40°C	cSt	ASTM D7279(m)	220	▲ 155	▲ 154	---

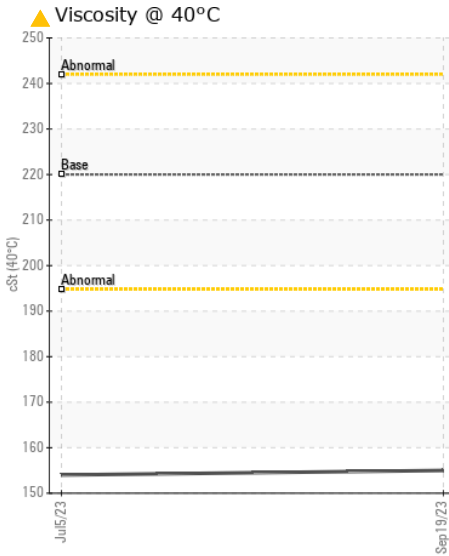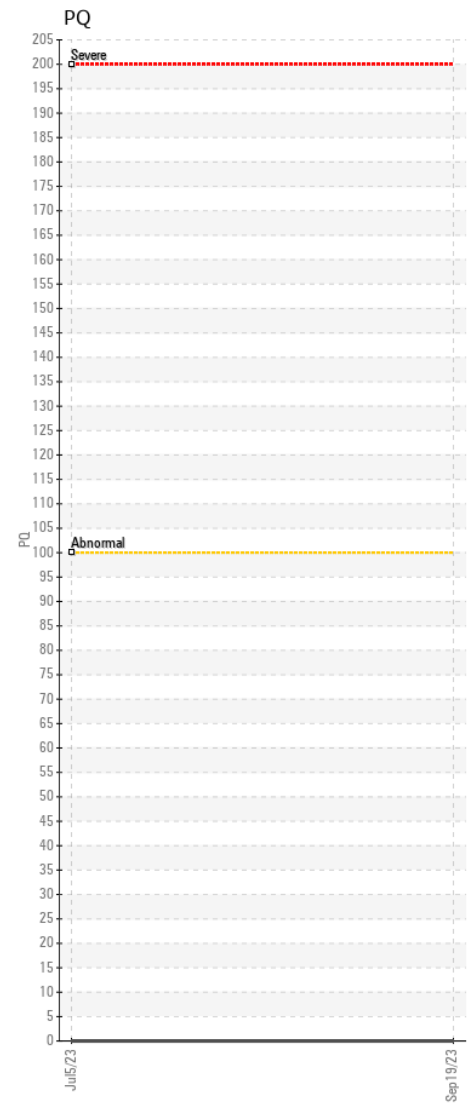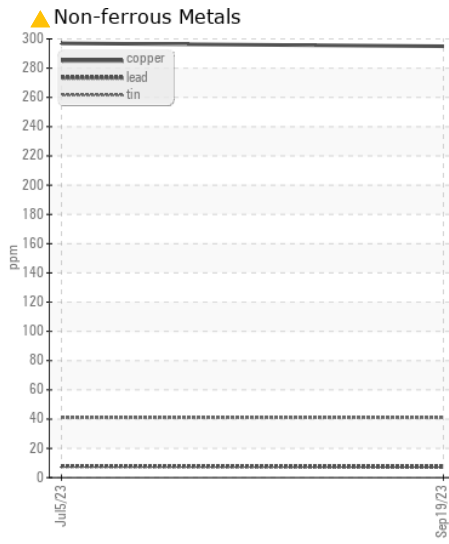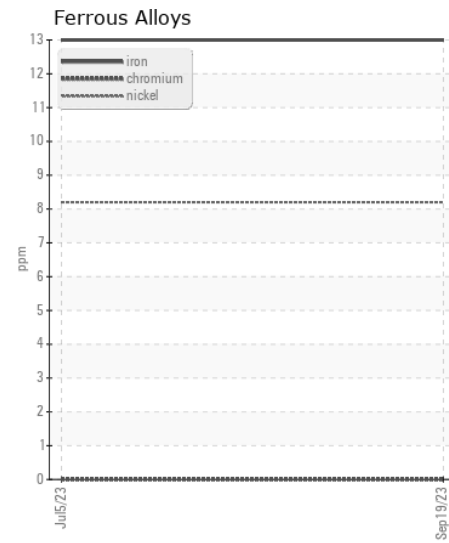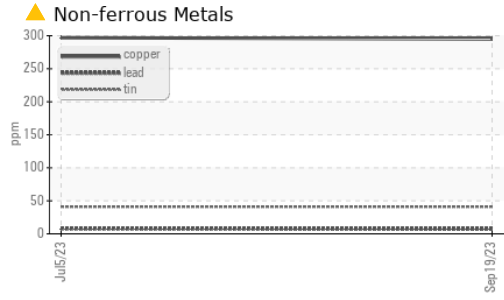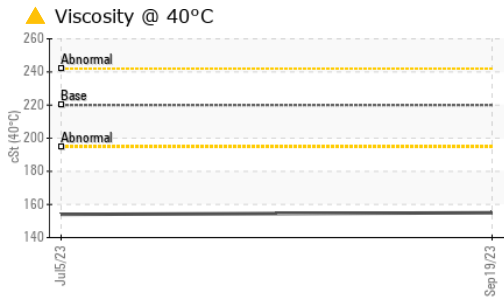

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0738316 **Received** : 28 Sep 2023
Lab Number : 02585915 **Diagnosed** : 28 Sep 2023
Unique Number : 5654981 **Diagnostician** : Kevin Marson
Test Package : FLEET (Additional Tests: PQ)

CRD, Integrated Water Services
 337 Victoria View Road
 Victoria, BC
 CA V9A 3Z3
 Contact: Maintenance Planning
 maintenanceplanning@crd.bc.ca

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T:
F: