



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

SABIC
Machine Id

Roots 121-10028 #3 VAC. BLOWER DRIVE END

Component

Drive End Blower

Fluid

ESSO SPARTAN EP 220 (0 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.









CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0839720	WC0839724	WC0783704
Sample Date		Client Info		02 Nov 2023	13 Oct 2023	29 Mar 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	SEVERE
PQ		ASTM D8184*		7	0	0
Iron	ppm	ASTM D5185(m)	>20	27	▲ 45	▲ 57
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		<1	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	1	2	1
Lead	ppm	ASTM D5185(m)	>20	<1	0	0
Copper	ppm	ASTM D5185(m)	>20	1	<1	<1
Tin	ppm	ASTM D5185(m)	>20	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185(m)	>15	5	7	▲ 29
Potassium	ppm	ASTM D5185(m)	>20	0	0	<1
Water		WC Method	>0.5	NEG	NEG	NEG
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.5	NEG	NEG	NEG
Sodium	ppm	ASTM D5185(m)		<1	2	4
Boron	ppm	ASTM D5185(m)	.5	22	12	4
Barium	ppm	ASTM D5185(m)		<1	<1	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	<1	2
Magnesium	ppm	ASTM D5185(m)	0	<1	3	3
Calcium	ppm	ASTM D5185(m)	1.7	3	5	8
Phosphorus	ppm	ASTM D5185(m)	250	318	305	256
Zinc	ppm	ASTM D5185(m)	.3	7	35	19
Sulfur	ppm	ASTM D5185(m)		13012	11958	3872
Acid Number (AN)	mg KOH/g	ASTM D974*	0.75	0.64	0.72	0.80
Visc @ 40°C	cSt	ASTM D7279(m)	220	219	207	▲ 219

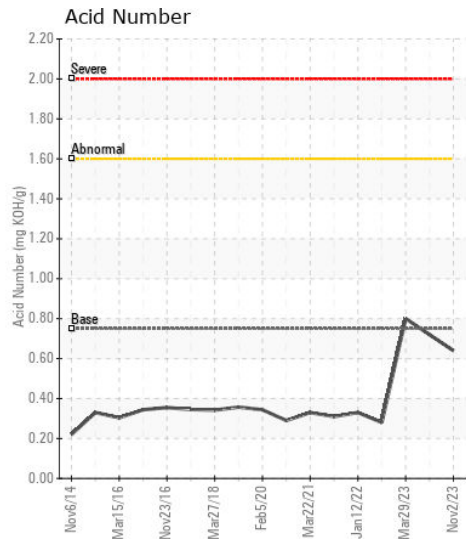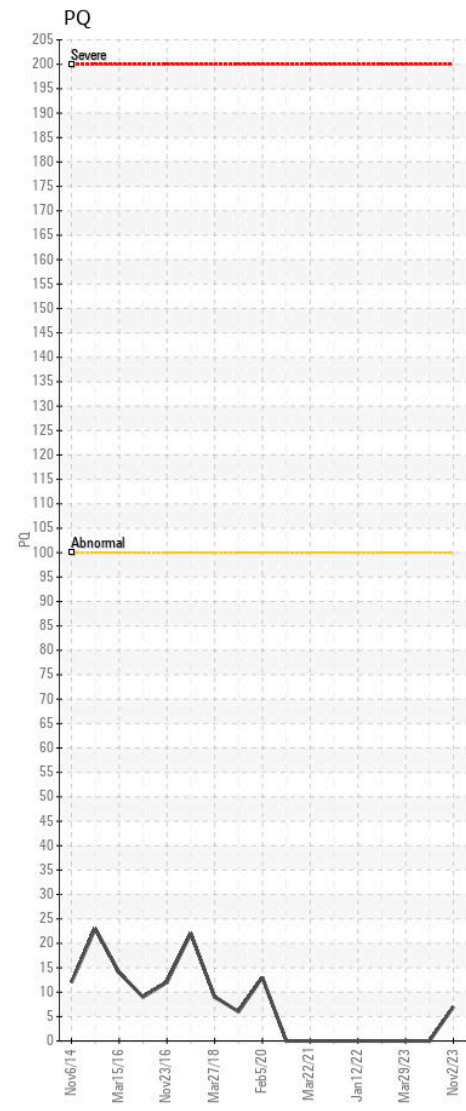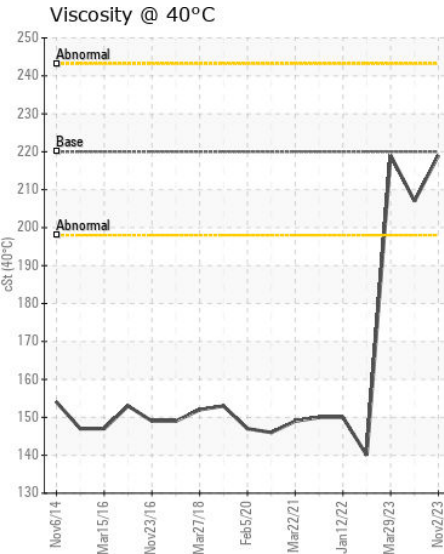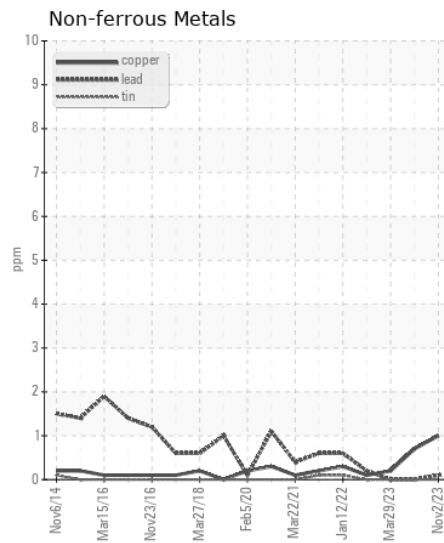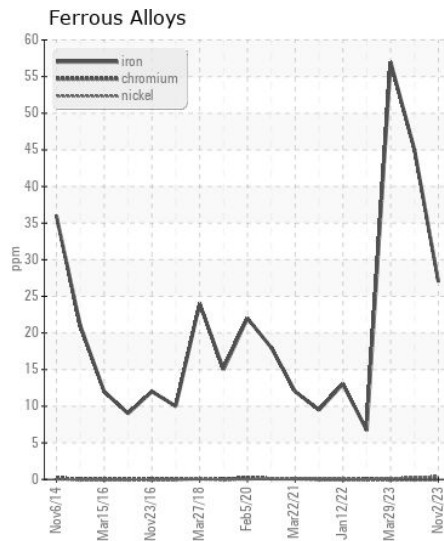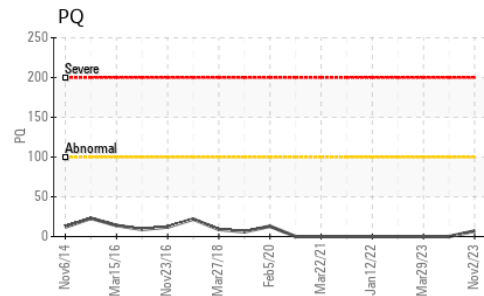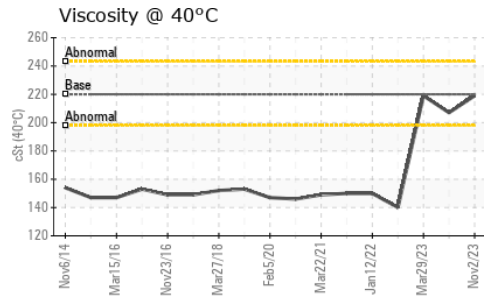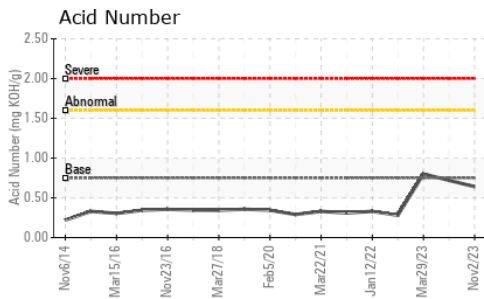

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0839720 **Received** : 10 Nov 2023
Lab Number : 02595663 **Tested** : 13 Nov 2023
Unique Number : 5672742 **Diagnosed** : 14 Nov 2023 - Kevin Marson
Test Package : IND 2

DXP - SCS - Sabic IP Cobourg
 44 Normar Road
 Cobourg, ON
 CA K9A 4L7
 Contact: George DiFrancesco
 george.difrancesco@sabic.com
 T: (905)373-3988
 F: (905)373-3844

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.