



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ATTENTION
FLUID CONDITION	NORMAL

Area
COR
Machine Id
LONGGEN1BRGUS
Component
Bearing
Fluid
SHELL TURBO T ISO 68 (25 LTR)

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0790715	WC0790724	WC0790726
Sample Date		Client Info		06 Nov 2023	13 Sep 2023	15 Feb 2023
Machine Age	mths	Client Info		316	310	307
Oil Age	mths	Client Info		9	12	29
Filter Age	mths	Client Info		0	0	0
Oil Changed		Client Info		Not Chngd	Not Chngd	Changed
Filter Changed		Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status				ATTENTION	NORMAL	NORMAL

WEAR

All component wear rates are normal.

PQ	UOM	Method	Limit/Abn	Current	History1	History2
Iron	ppm	ASTM D5185(m)	>20	0	0	0
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	<1	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	0	0
Lead	ppm	ASTM D5185(m)	>20	0	<1	0
Copper	ppm	ASTM D5185(m)	>20	0	<1	0
Tin	ppm	ASTM D5185(m)	>20	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE

CONTAMINATION











There is a light amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

Silicon	ppm	ASTM D5185(m)	>15	0	0	0
Potassium	ppm	ASTM D5185(m)	>20	2	0	0
Water	%	ASTM D6304*	>2	0.002	0.002	0.001
ppm Water	ppm	ASTM D6304*		19	22.2	14.2
Particles >4µm		ASTM D7647	>10000	6653	2636	3174
Particles >6µm		ASTM D7647	>2500	2265	821	1071
Particles >14µm		ASTM D7647	>160	▲ 248	71	116
Particles >21µm		ASTM D7647	>40	▲ 68	18	37
Particles >38µm		ASTM D7647	>10	6	2	4
Particles >71µm		ASTM D7647	>3	2	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/14	▲ 20/18/15	19/17/13	19/17/14
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)		0	<1	0
Boron	ppm	ASTM D5185(m)		0	<1	<1
Barium	ppm	ASTM D5185(m)		0	<1	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		<1	0	0
Calcium	ppm	ASTM D5185(m)		0	0	0
Phosphorus	ppm	ASTM D5185(m)		3	3	0
Zinc	ppm	ASTM D5185(m)		<1	<1	<1
Sulfur	ppm	ASTM D5185(m)		9	34	25
Acid Number (AN)	mg KOH/g	ASTM D974*	.05	0.06	0.05	0.04
Visc @ 40°C	cSt	ASTM D7279(m)	68	65.9	66.0	66.0

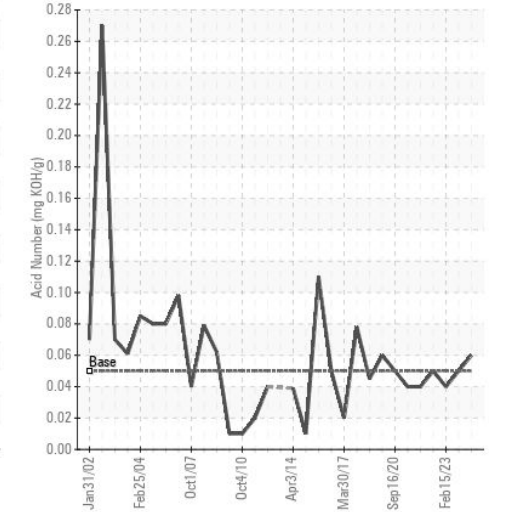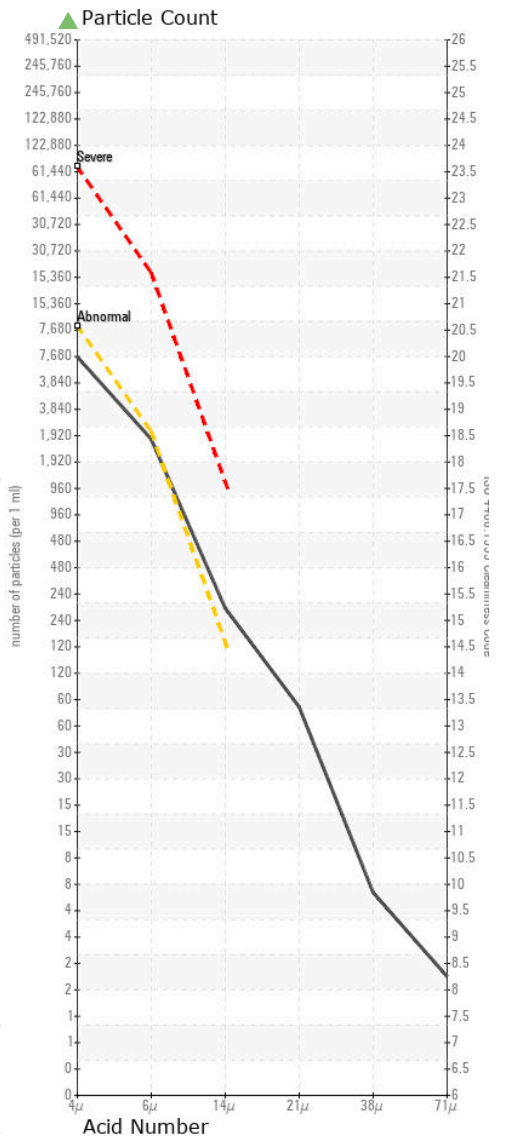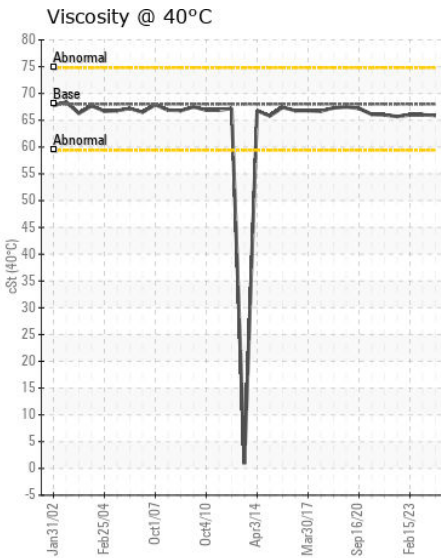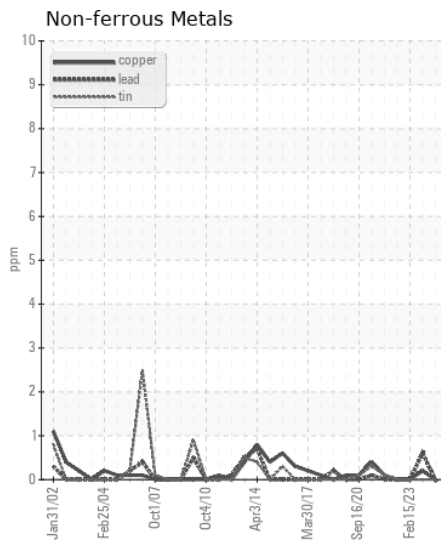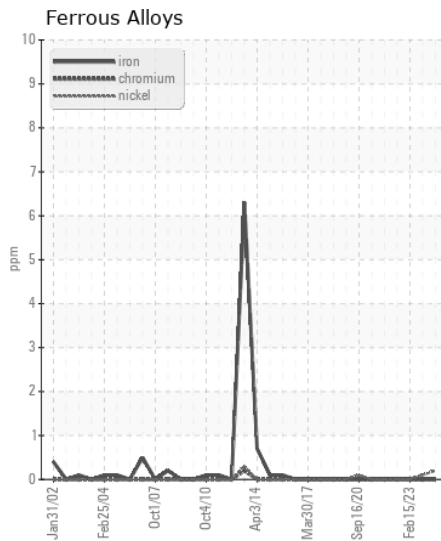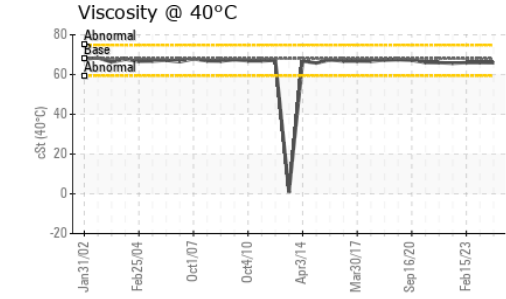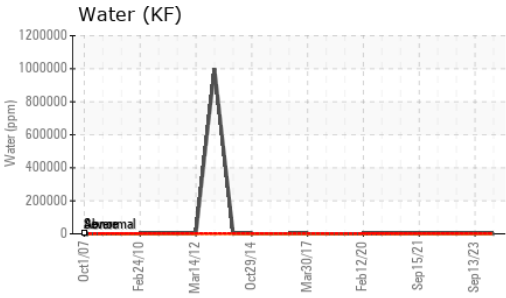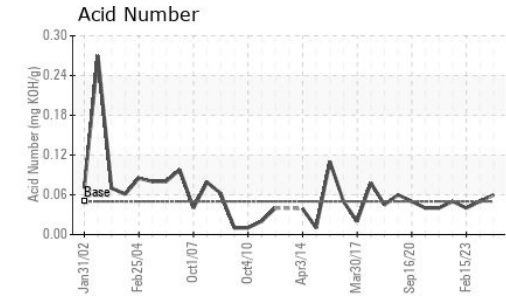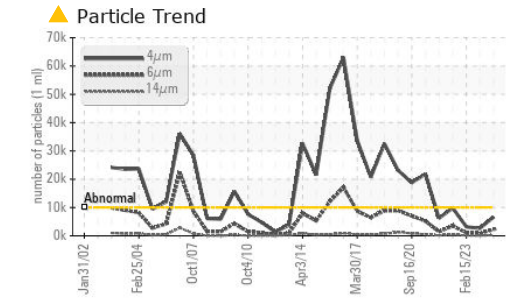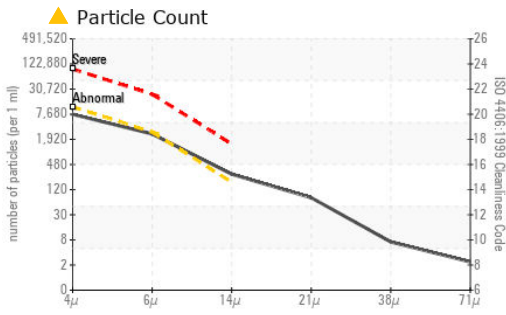

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0790715
Lab Number : 02605961
Unique Number : 5707047
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount, TAN Man)

ALGONQUIN POWER SYSTEMS INC.
 354 DAVIS ROAD
 OAKVILLE, ON
 CA L6J 2X1
 Contact: Antonino Champ Fernando
 antoninoChamp.fernando@algonquinpower.com
 T: (905)465-7065
 F: x:

*To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.*