POWER GENERATION PRODUCTS

OIL ANALYSIS REPORT

Area [83618] Machine Id


5089 MORRISON ST NIAGARA FALLS REGION OF NIAGARA REGION OF NIAGARA


Component Rear Diesel Engine

ESSO XD-3 EXTRA 15W40 (20 LTR)

ESSO XD-3 EXTRA 15W40 (20 LTR)							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		PN0005651		
	Sample Date		Client Info		04 Jan 2024		
	Machine Age	hrs	Client Info		136		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		Changed		
	Filter Changed		Client Info		Not Changd		
	Sample Status				NORMAL		
WEAD	Iron		ASTM D5185(m)	> 100	2		
WEAR Metal levels are typical for a new component breaking in.	Iron Chromium	ppm	ASTM D5185(m)		2		
	Nickel	ppm	ASTM D5185(m) ASTM D5185(m)				
	Titanium	ppm		>4	<1 <1		
	Silver	ppm	ASTM D5185(m)	. 2	0		
	Aluminum	ppm	ASTM D5185(m)		2		
		ppm	ASTM D5185(m)		2		
	Lead	ppm	ASTM D5185(m)	>40	0 <1		
	Copper Tin	ppm	ASTM D5185(m) ASTM D5185(m)		< 1 0		
	Vanadium	ppm	ASTM D5185(m)	>15	0		
	White Metal	ppm scalar	Visual*	NONE	VLITE		
	Yellow Metal	scalar	Visual*	NONE	NONE		
		Scalai	visuai		NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185(m)	>25	5		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185(m)	>20	<1		
	Fuel		WC Method		<1.0		
	Water		WC Method	>0.2	NEG		
	Glycol		WC Method		NEG		
	Soot %	%	ASTM D7844*	>3	0		
	Nitration	Abs/cm	ASTM D7624*	>20	4.8		
	Sulfation	Abs/.1mm	ASTM D7415*	>30	19.2		
	Silt	scalar	Visual*	NONE	NONE		
	Debris	scalar	Visual*	NONE	NONE		
	Sand/Dirt	scalar	Visual*	NONE	NONE		
	Appearance	scalar	Visual*	NORML	NORML		
	Odor	scalar	Visual*	NORML	NORML		
	Emulsified Water	scalar	Visual*	>0.2	NEG		
FLUID CONDITION The condition of the oil is acceptable for the time in service.	Sodium		ASTM D5185(m)	<102	2		
	Boron	ppm ppm	ASTM D5185(m)	2192	188		
	Barium	ppm	ASTM D5185(m) ASTM D5185(m)		0		
	Molybdenum	ppm	ASTM D5185(m)		57		
	Manganese	ppm	ASTM D5185(m) ASTM D5185(m)		0		
	Magnesium	ppm	ASTM D5185(m)		410		
	Calcium	ppm	ASTM D5185(m)	3780	1502		
	Phosphorus	ppm	ASTM D5185(m)		964		
	Zinc	ppm	ASTM D5185(m)	1500	1130		
	Sulfur	ppm	ASTM D5185(m)		2961		
	Oxidation	Abs/.1mm	ASTM D7414*		13.9		
	Visc @ 100°C	cSt	ASTM D7279(m)		13.9		
		001					

Page 1 of 2



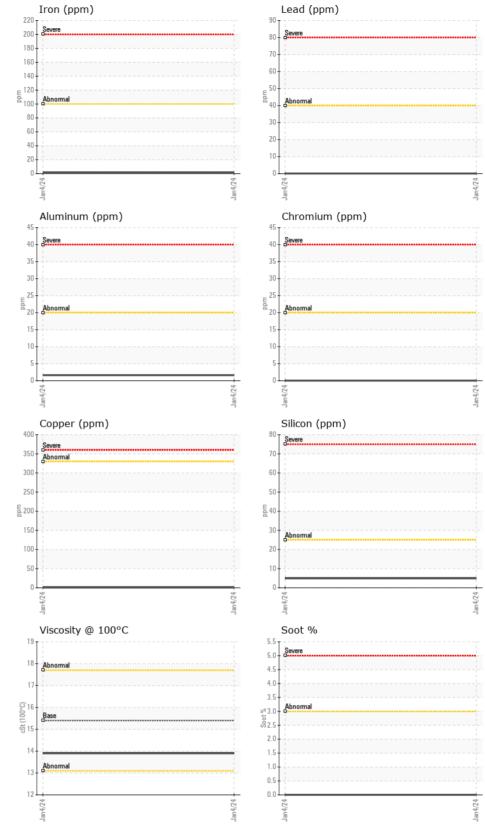



POWER STATION INC. Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 CALA Sample No. : PN0005651 Recieved : 08 Jan 2024 1050 JAYSON COURT Lab Number : 02606975 MISSISSAUGA, ON Diagnosed : 08 Jan 2024 ISO 17025:2017 Accredited Laboratory : 5708061 Diagnostician : Wes Davis CA L4W 2V5 Unique Number Test Package : MOB 1 (Additional Tests: Visual) Contact: Brett Kinkley To discuss this sample report, contact Customer Service at 1-800-268-2131. Bkinkley@pwrstn.com Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. T: Validity of results and interpretation are based on the sample and information as supplied. F: (905)565-8544

Contact/Location: Brett Kinkley - POWMIS

Page 2 of 2