



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[83363]

Machine Id

180 QUEEN ST W, TORONTO PENTHOUSE GWL REALTY ADVISORS 1FZ02529

Component

Rear Diesel Engine

Fluid

ESSO XD-3 EXTRA 15W40 (220 LTR)

RECOMMENDATION

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MOB 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. this testkit includes BN to determine the suitability of the oil for continued use.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005758	PN0004445	PN0003110
Sample Date		Client Info		21 Dec 2023	21 Dec 2022	21 Dec 2021
Machine Age	hrs	Client Info		314	300	281
Oil Age	hrs	Client Info		300	0	18
Filter Age	hrs	Client Info		300	0	18
Oil Changed		Client Info		Changed	Changed	Not Changd
Filter Changed		Client Info		Not Changd	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in. Component wear rates appear to be normal (unconfirmed).

Iron	ppm	ASTM D5185(m)	>100	<1	1	<1
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	<1	0	<1
Titanium	ppm	ASTM D5185(m)	>2	0	<1	0
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>25	2	2	2
Lead	ppm	ASTM D5185(m)	>40	0	<1	<1
Copper	ppm	ASTM D5185(m)	>330	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	4	3	3
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	1
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	7.0	5.9	7.0
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.1	16.7	18.9
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service (unconfirmed).

Sodium	ppm	ASTM D5185(m)	>192	1	2	2
Boron	ppm	ASTM D5185(m)		67	75	76
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		29	75	73
Manganese	ppm	ASTM D5185(m)		0	<1	0
Magnesium	ppm	ASTM D5185(m)		145	136	140
Calcium	ppm	ASTM D5185(m)	3780	1935	2151	1974
Phosphorus	ppm	ASTM D5185(m)	1370	978	1059	993
Zinc	ppm	ASTM D5185(m)	1500	1106	1097	1090
Sulfur	ppm	ASTM D5185(m)	3800	3431	3214	3106
Oxidation	Abs/.1mm	ASTM D7414*	>25	12.9	11.0	13.9
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	14.1	14.3	14.5

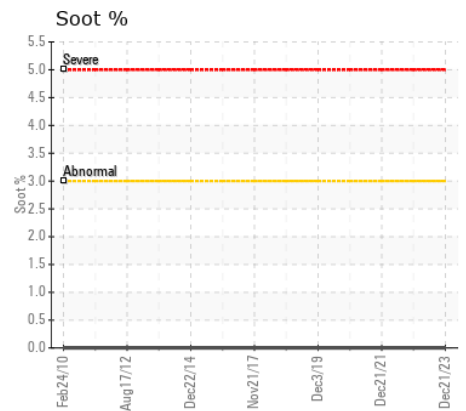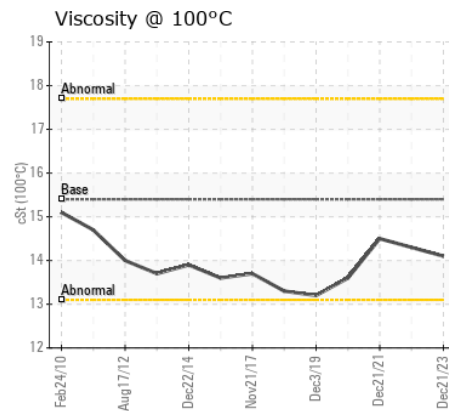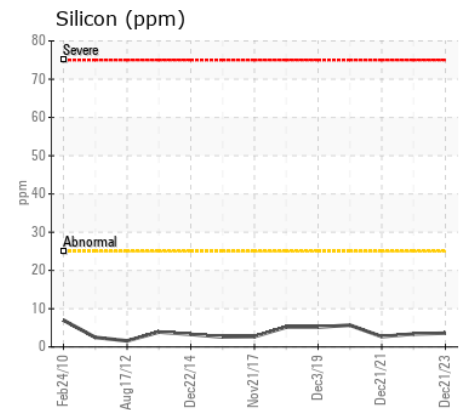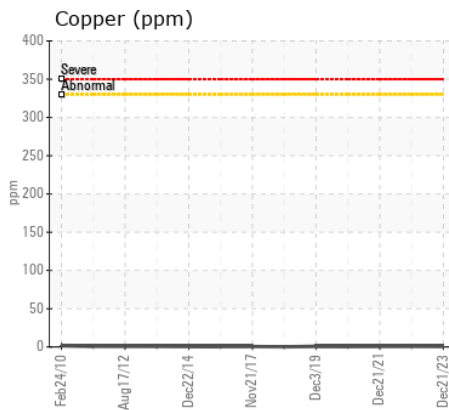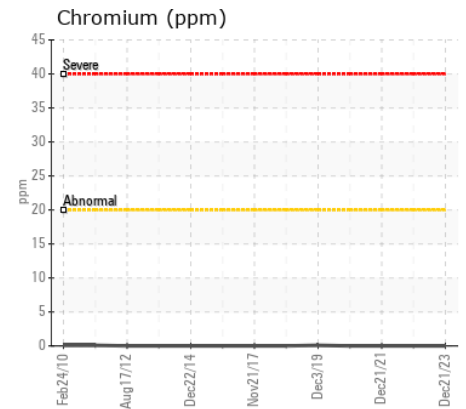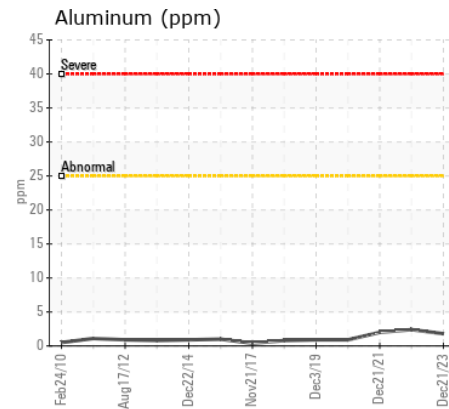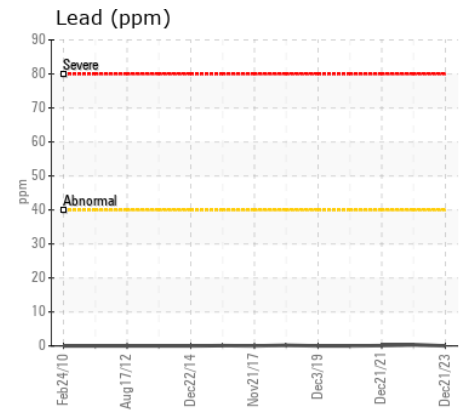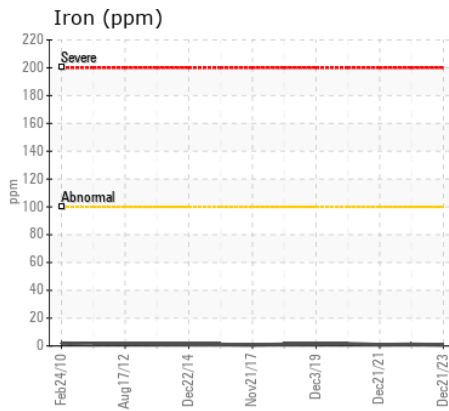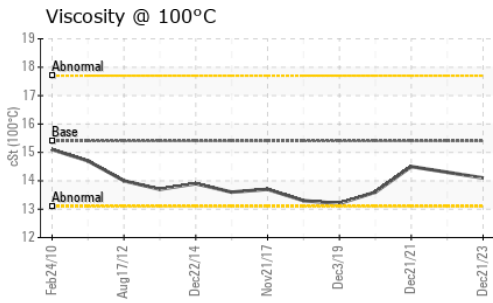

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005758 **Received** : 08 Jan 2024
Lab Number : 02606978 **Diagnosed** : 08 Jan 2024
Unique Number : 5708064 **Diagnostician** : Wes Davis
Test Package : MOB 1

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.