



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**1109 LESLIE ST SCARBOROUGH COT EEIOH706861**

Component  
**Rear Natural Gas Engine**

Fluid  
**ESSO XD-3 EXTRA 15W40 (25 LTR)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PN0005751</b>	PN0004452	PN0003165
Sample Date		Client Info		<b>27 Dec 2023</b>	28 Dec 2022	22 Dec 2021
Machine Age	hrs	Client Info		<b>104</b>	85	67
Oil Age	hrs	Client Info		<b>63</b>	0	16
Filter Age	hrs	Client Info		<b>63</b>	0	16
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>50	<b>2</b>	2	2
Chromium	ppm	ASTM D5185(m)	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>2	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>9	<b>2</b>	2	2
Lead	ppm	ASTM D5185(m)	>30	<b>1</b>	2	2
Copper	ppm	ASTM D5185(m)	>35	<b>11</b>	14	6
Tin	ppm	ASTM D5185(m)	>4	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	<1

**CONTAMINATION**










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>+100	<b>4</b>	6	8
Potassium	ppm	ASTM D5185(m)	>20	<b>1</b>	<1	2
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*		<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>6.9</b>	4.8	7.2
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>16.8</b>	15.1	17.9
Emulsified Water	scalar	Visual*	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	<b>1</b>	2	2
Boron	ppm	ASTM D5185(m)		<b>63</b>	72	73
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185(m)		<b>34</b>	85	82
Manganese	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185(m)		<b>90</b>	25	49
Calcium	ppm	ASTM D5185(m)	3780	<b>1998</b>	2245	2078
Phosphorus	ppm	ASTM D5185(m)	1370	<b>971</b>	1086	1020
Zinc	ppm	ASTM D5185(m)	1500	<b>1111</b>	1118	1114
Sulfur	ppm	ASTM D5185(m)	3800	<b>3331</b>	3223	3162
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>12.4</b>	8.3	12.9
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	<b>13.9</b>	14.3	14.4

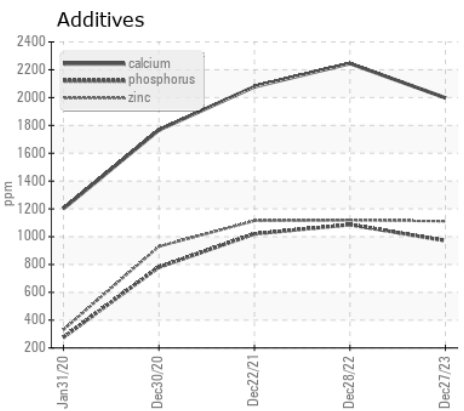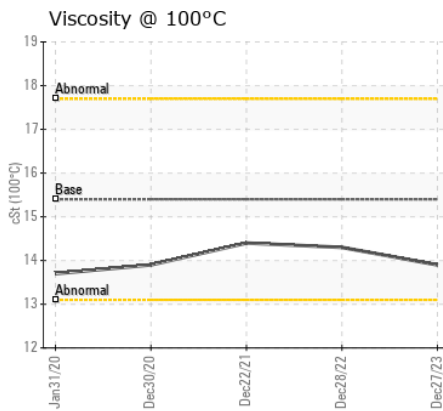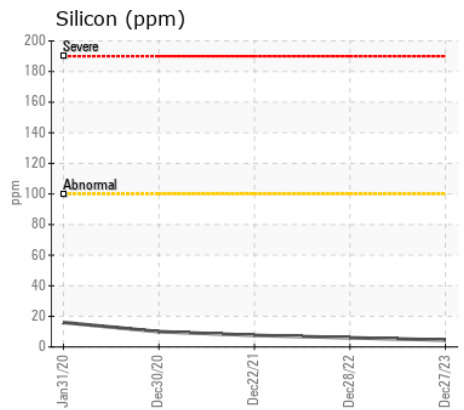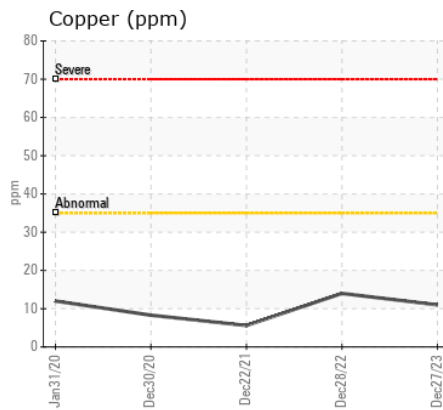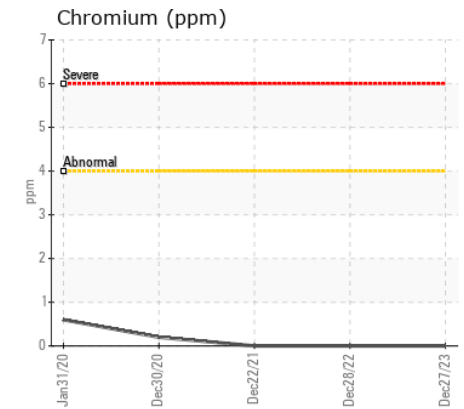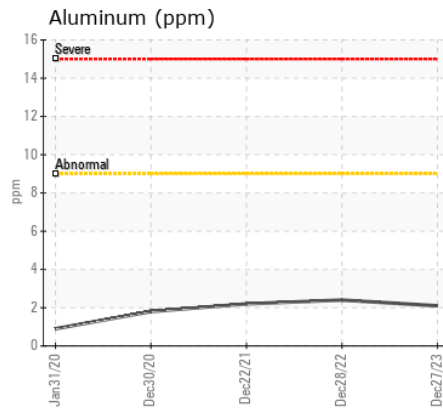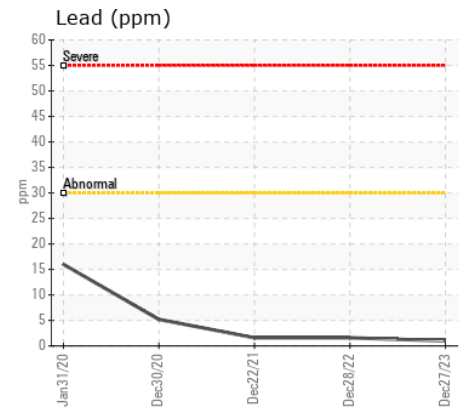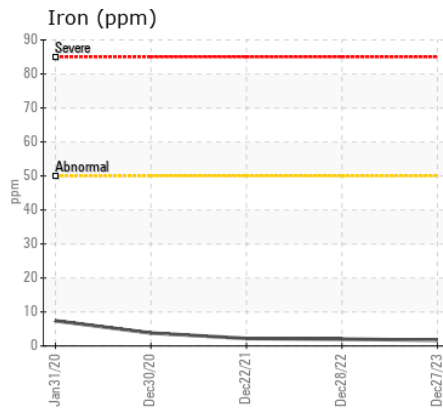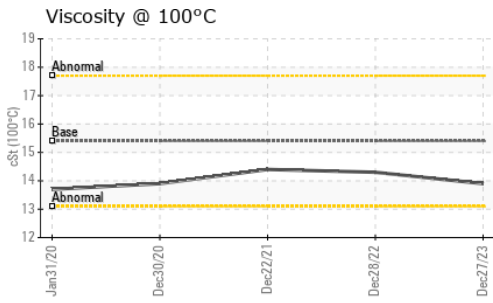

ISO 17025:2017  
Accredited  
Laboratory

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PN0005751 **Received** : 08 Jan 2024  
**Lab Number** : 02606995 **Diagnosed** : 08 Jan 2024  
**Unique Number** : 5708081 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**POWER STATION INC.**  
 1050 JAYSON COURT  
 MISSISSAUGA, ON  
 CA L4W 2V5  
 Contact: Brett Kinkley  
 Bkinkley@pwrstn.com  
 T:  
 F: (905)565-8544