



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**6747 OAKWOOD DR. NIAGARA FALLS CONMED HEALTH CD4045L050997**

Component  
**Rear Diesel Engine**

Fluid  
**ESSO XD-3 EXTRA 15W40 (20 LTR)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PN0005755</b>	PN0004441	PN0001792
Sample Date		Client Info		<b>04 Jan 2024</b>	05 Jan 2023	10 Nov 2020
Machine Age	hrs	Client Info		<b>63</b>	59	51
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Changed</b>	N/A	Changed
Filter Changed		Client Info		<b>Changed</b>	N/A	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>51	<b>2</b>	2	3
Chromium	ppm	ASTM D5185(m)	>11	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185(m)	>5	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>31	<b>2</b>	3	1
Lead	ppm	ASTM D5185(m)	>26	<b>0</b>	0	<1
Copper	ppm	ASTM D5185(m)	>26	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>4	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0

**CONTAMINATION**











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>22	<b>7</b>	8	8
Potassium	ppm	ASTM D5185(m)	>20	<b>7</b>	<1	1
Fuel		WC Method	>2.1	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.21	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>6.6</b>	7.2	5.1
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>16.8</b>	18.7	20.8
Emulsified Water	scalar	Visual*	>0.21	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	<b>2</b>	3	3
Boron	ppm	ASTM D5185(m)		<b>66</b>	79	71
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>16</b>	85	23
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185(m)		<b>90</b>	25	567
Calcium	ppm	ASTM D5185(m)	3780	<b>1967</b>	2217	1420
Phosphorus	ppm	ASTM D5185(m)	1370	<b>975</b>	1072	684
Zinc	ppm	ASTM D5185(m)	1500	<b>1078</b>	1134	819
Sulfur	ppm	ASTM D5185(m)	3800	<b>3383</b>	3248	2253
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>12.0</b>	13.5	16.6
Visc @ 40°C	cSt	ASTM D7279(m)	116	<b>105</b>	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	<b>14.4</b>	14.5	13.8
Viscosity Index (VI)	Scale	ASTM D2270*	140	<b>140</b>	---	---

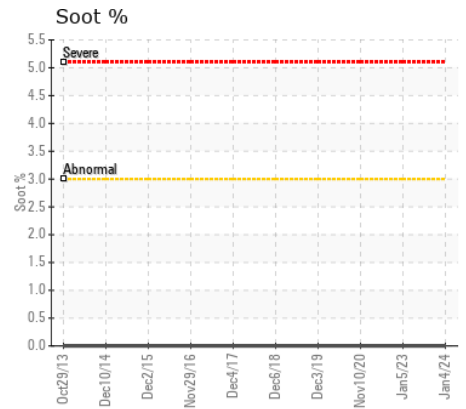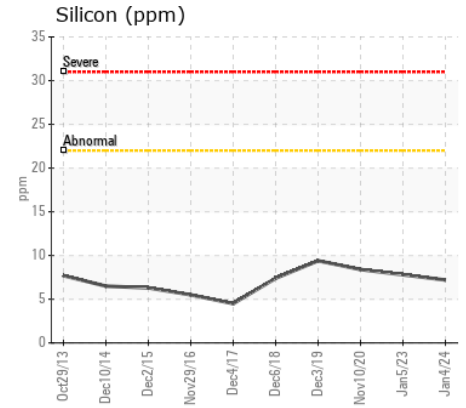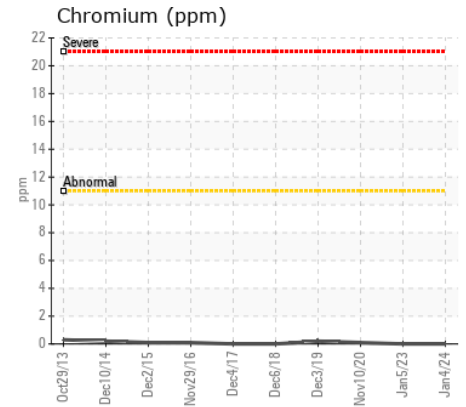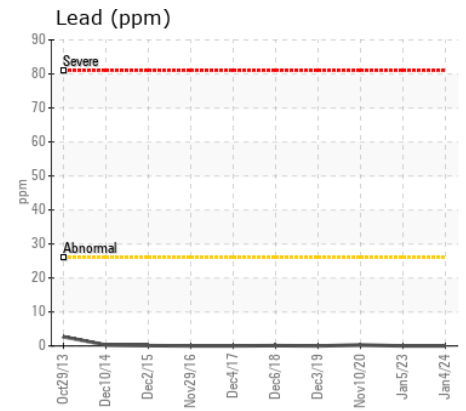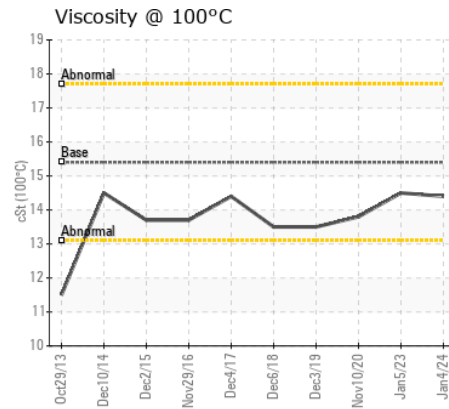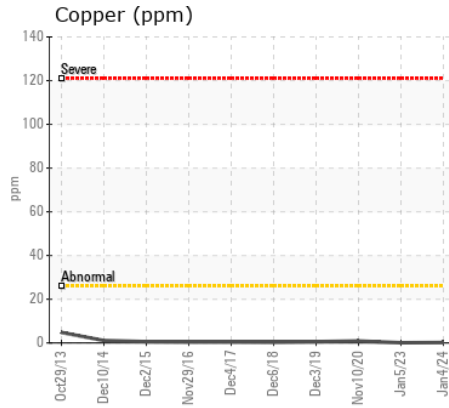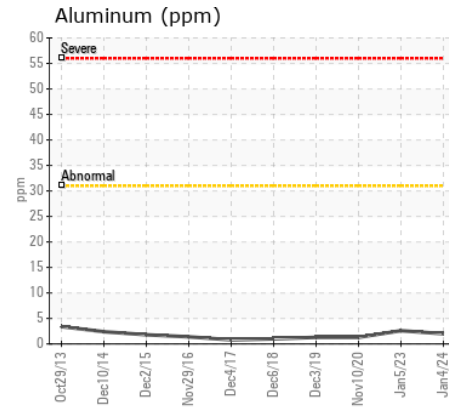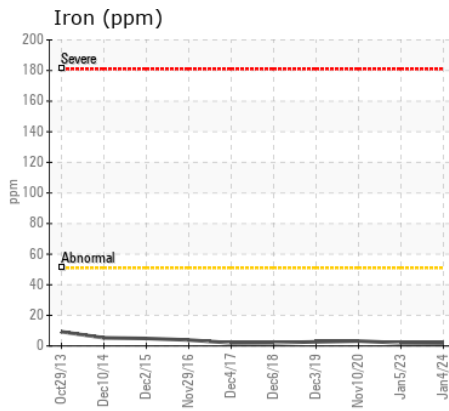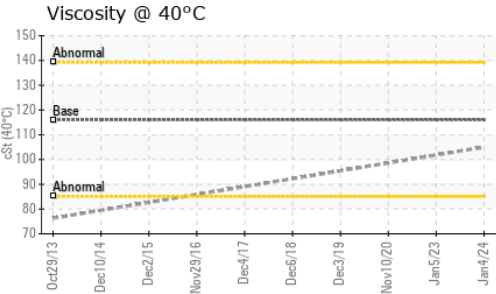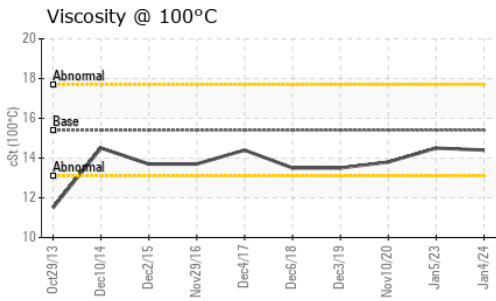

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PN0005755 **Received** : 09 Jan 2024  
**Lab Number** : 02607444 **Diagnosed** : 09 Jan 2024  
**Unique Number** : 5708530 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: KV40, VI )

**POWER STATION INC.**  
 1050 JAYSON COURT  
 MISSISSAUGA, ON  
 CA L4W 2V5  
 Contact: Ryan Udall  
 rudall@pwrstn.com  
 T: (905)565-1621  
 F: (905)629-1499

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.