



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
71 7TH LINE RD WOLFE ISLAND BELL BELL

Component
Right Diesel Engine

Fluid
ESSO XD-3 EXTRA 15W40 (10 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005648	PN0004171	---
Sample Date		Client Info		05 Jan 2024	04 Oct 2022	---
Machine Age	hrs	Client Info		69	50	---
Oil Age	hrs	Client Info		19	0	---
Filter Age	hrs	Client Info		19	0	---
Oil Changed		Client Info		Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	NORMAL	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>80	4	4	---
Chromium	ppm	ASTM D5185(m)	>6	0	0	---
Nickel	ppm	ASTM D5185(m)	>2	<1	0	---
Titanium	ppm	ASTM D5185(m)	>2	0	<1	---
Silver	ppm	ASTM D5185(m)	>2	0	0	---
Aluminum	ppm	ASTM D5185(m)	>20	3	3	---
Lead	ppm	ASTM D5185(m)	>95	<1	1	---
Copper	ppm	ASTM D5185(m)	>85	4	7	---
Tin	ppm	ASTM D5185(m)	>9	<1	<1	---
Vanadium	ppm	ASTM D5185(m)		0	0	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	28	29	---
Potassium	ppm	ASTM D5185(m)	>20	<1	0	---
Fuel		WC Method	>4.0	<1.0	<1.0	---
Water		WC Method	>0.1	NEG	NEG	---
Glycol		WC Method		NEG	NEG	---
Soot %	%	ASTM D7844*		0	0	---
Nitration	Abs/cm	ASTM D7624*	>20	6.8	7.0	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.1	19.1	---
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	4	5	---
Boron	ppm	ASTM D5185(m)		52	64	---
Barium	ppm	ASTM D5185(m)		1	1	---
Molybdenum	ppm	ASTM D5185(m)		65	65	---
Manganese	ppm	ASTM D5185(m)		<1	<1	---
Magnesium	ppm	ASTM D5185(m)		323	213	---
Calcium	ppm	ASTM D5185(m)	3780	1799	1924	---
Phosphorus	ppm	ASTM D5185(m)	1370	936	963	---
Zinc	ppm	ASTM D5185(m)	1500	1040	1005	---
Sulfur	ppm	ASTM D5185(m)	3800	2908	2800	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	15.3	15.9	---
Visc @ 40°C	cSt	ASTM D7279(m)	116	102	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.8	13.7	---
Viscosity Index (VI)	Scale	ASTM D2270*	140	136	---	---

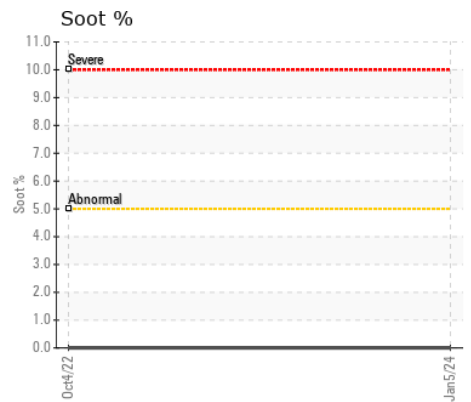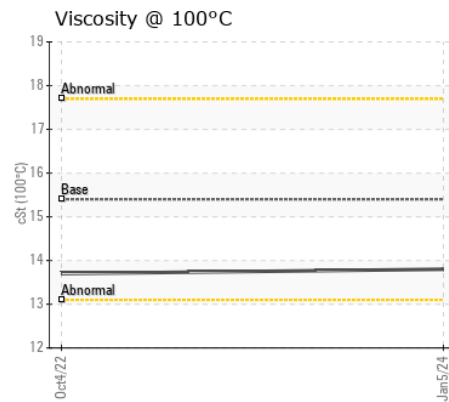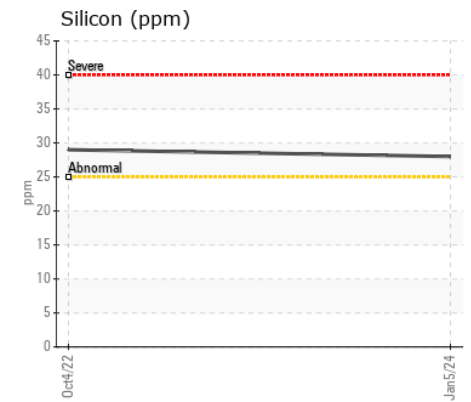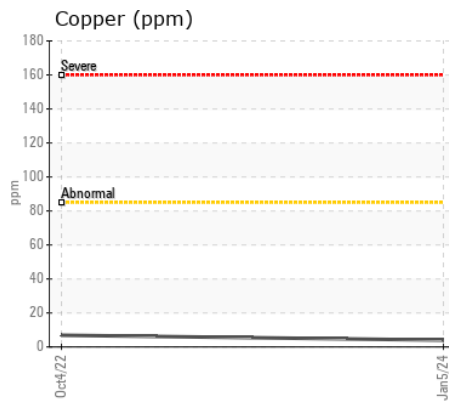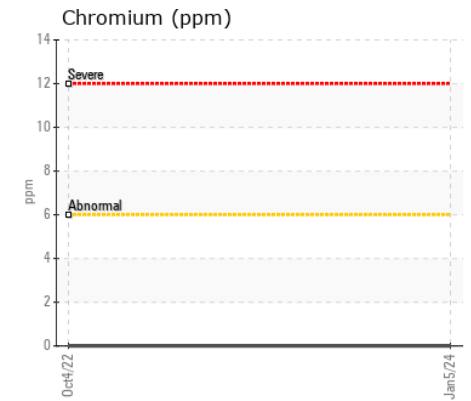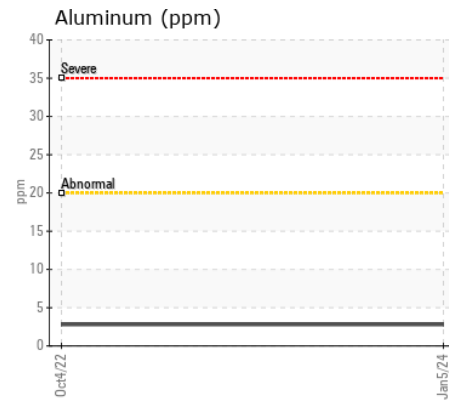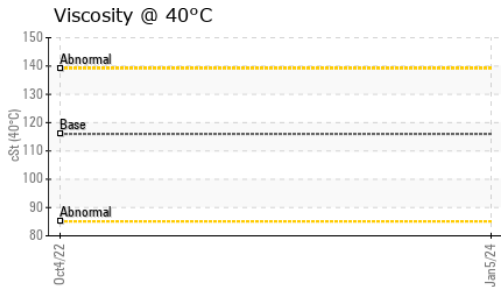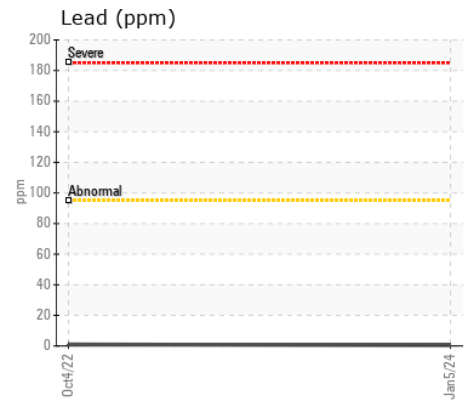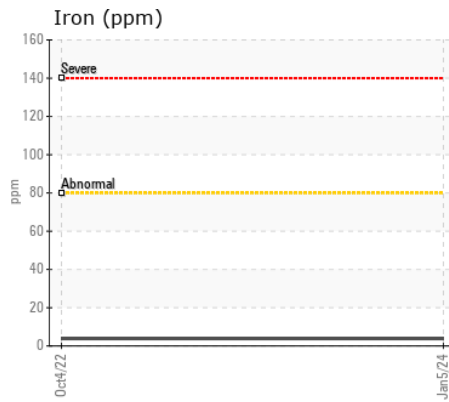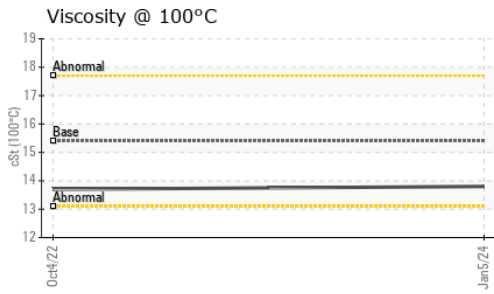

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005648 **Received** : 09 Jan 2024
Lab Number : 02607446 **Diagnosed** : 10 Jan 2024
Unique Number : 5708532 **Diagnostician** : Wes Davis
Test Package : MOB 1 (Additional Tests: KV40, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544