



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[FLE.21.06167]
 Machine Id
NO UNIT WC0665989
 Component
Diesel Engine
 Fluid
{not provided} (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0665989	---	---
Sample Date		Client Info		22 Apr 2023	---	---
Machine Age	hrs	Client Info		1021	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	76	---	---
Chromium	ppm	ASTM D5185(m)	>20	<1	---	---
Nickel	ppm	ASTM D5185(m)	>4	<1	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	3	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>330	29	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	8	---	---
Potassium	ppm	ASTM D5185(m)	>20	5	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol	%	ASTM D7922*		NEG	---	---
Soot %	%	ASTM D7844*	>3	1	---	---
Nitration	Abs/cm	ASTM D7624*	>20	11.7	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	24.1	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		4	---	---
Boron	ppm	ASTM D5185(m)		38	---	---
Barium	ppm	ASTM D5185(m)		<1	---	---
Molybdenum	ppm	ASTM D5185(m)		62	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)		1036	---	---
Calcium	ppm	ASTM D5185(m)		885	---	---
Phosphorus	ppm	ASTM D5185(m)		938	---	---
Zinc	ppm	ASTM D5185(m)		1111	---	---
Sulfur	ppm	ASTM D5185(m)		2573	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	20.6	---	---
Visc @ 100°C	cSt	ASTM D7279(m)		13.7	---	---

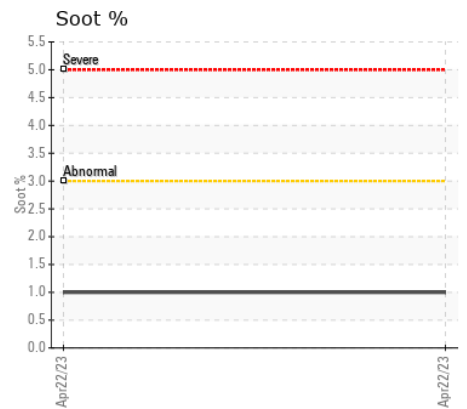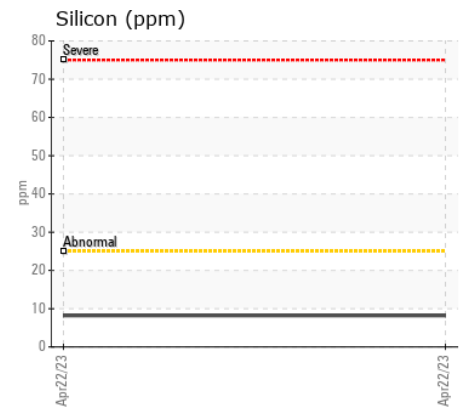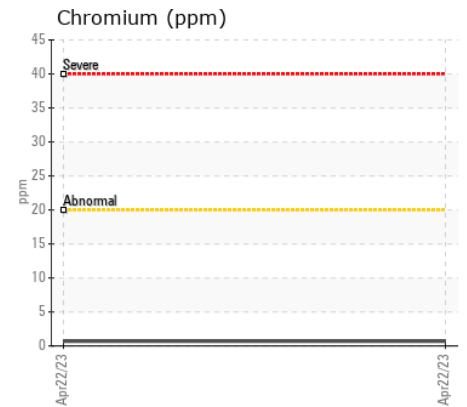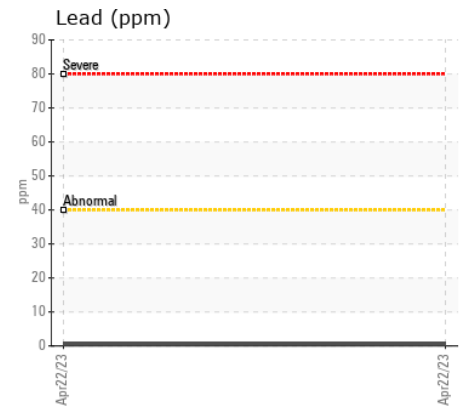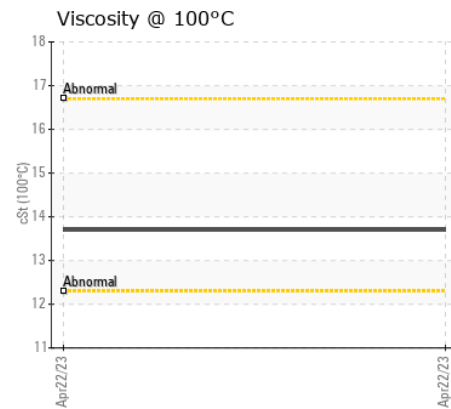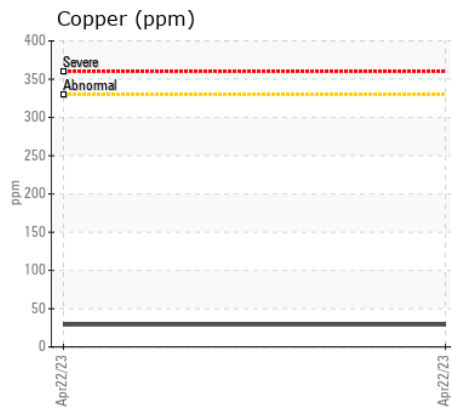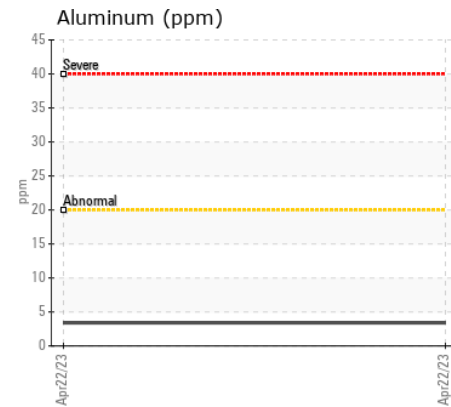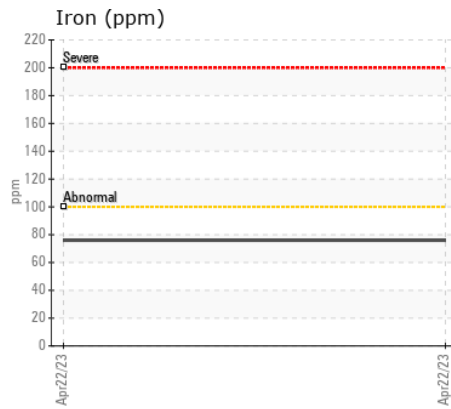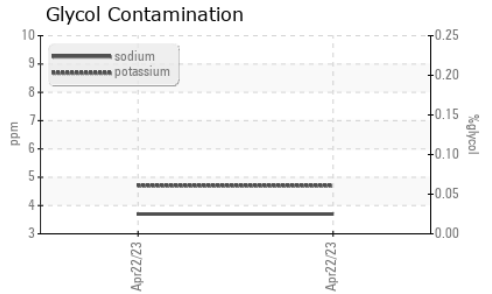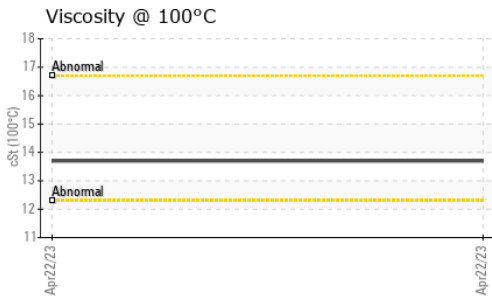

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0665989 **Received** : 12 Jan 2024
Lab Number : 02608428 **Diagnosed** : 15 Jan 2024
Unique Number : 5709514 **Diagnostician** : Kevin Marson
Test Package : MOB 1 (Additional Tests: Glycol)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

THE CORP/CITY OF SAULT STE MARIE
 PUBLIC WORKS - STORES, 128 SACKVILLE ROAD
 SAULT STE. MARIE, ON
 CA P6B 4T6
 Contact: Jeff Morden
 j.morden@cityssm.on.ca
 T: (705)541-7000e x:236
 F: (705)541-7014