



WEAR	NORMAL
CONTAMINATION	SEVERE
FLUID CONDITION	SEVERE

Area

[83182]

Machine Id

30 WELLINGTON ST W TORONTO, GENERATOR 6 QUADREAL 36L376

Component

Rear Diesel Engine

Fluid

ESSO XD-3 EXTRA 15W40 (160 LTR)

RECOMMENDATION

We advise that you check the fuel injection system. The oil change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005579	---	---
Sample Date		Client Info		12 Dec 2023	---	---
Machine Age	hrs	Client Info		1053	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				SEVERE	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	5	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>2	0	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>25	2	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>330	2	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	LIGHT	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION












There is a high amount of fuel present in the oil. Tests confirm the presence of fuel in the oil.

Silicon	ppm	ASTM D5185(m)	>25	7	---	---
Potassium	ppm	ASTM D5185(m)	>20	2	---	---
Fuel	%	ASTM D7593*	>5	8.4	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol	%	ASTM D7922*		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	6.1	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.4	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

Sodium	ppm	ASTM D5185(m)	>192	2	---	---
Boron	ppm	ASTM D5185(m)		42	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		38	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		406	---	---
Calcium	ppm	ASTM D5185(m)	3780	1597	---	---
Phosphorus	ppm	ASTM D5185(m)	1370	767	---	---
Zinc	ppm	ASTM D5185(m)	1500	856	---	---
Sulfur	ppm	ASTM D5185(m)	3800	2239	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	17.8	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	10.5	---	---

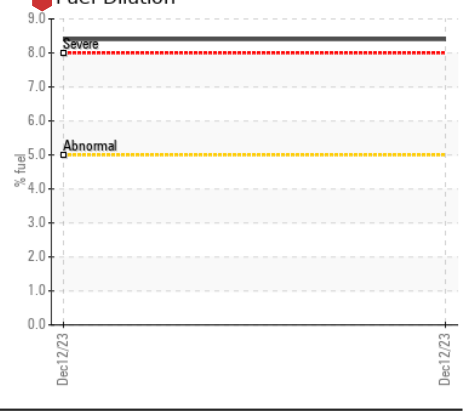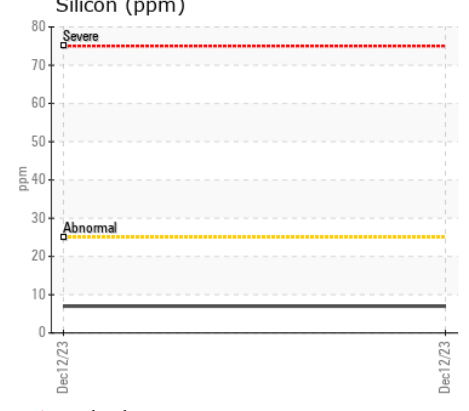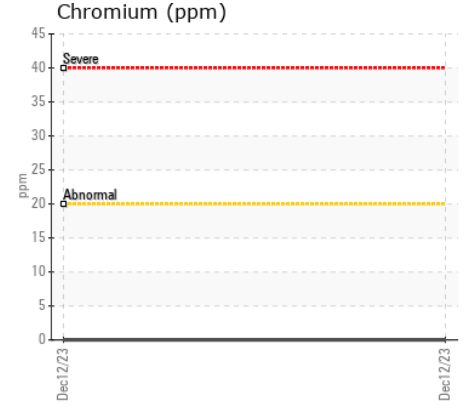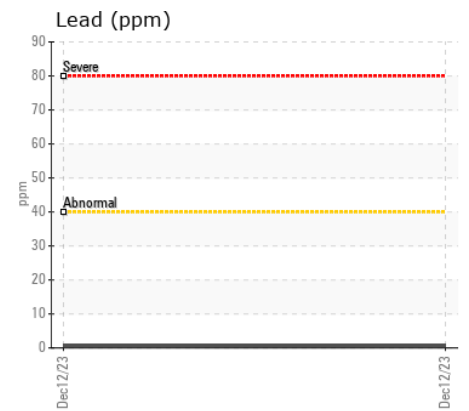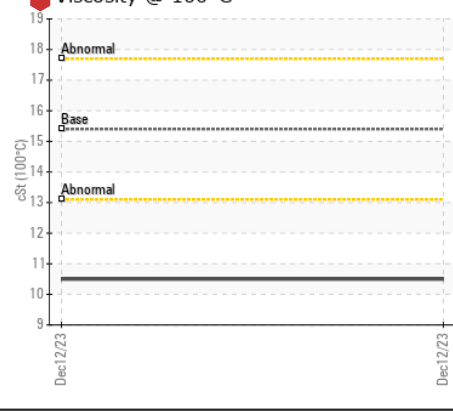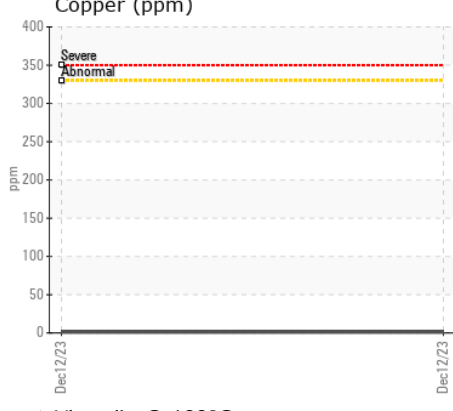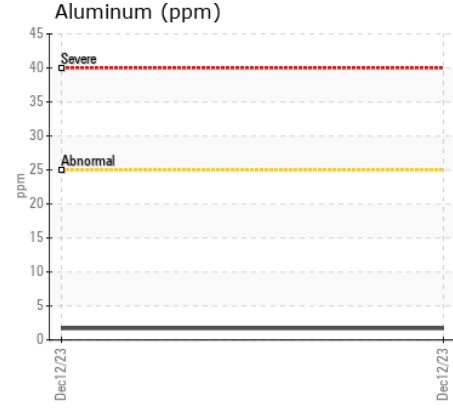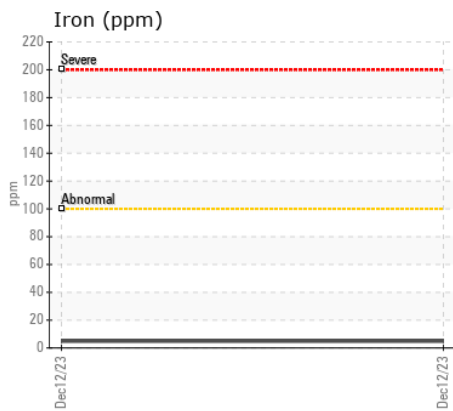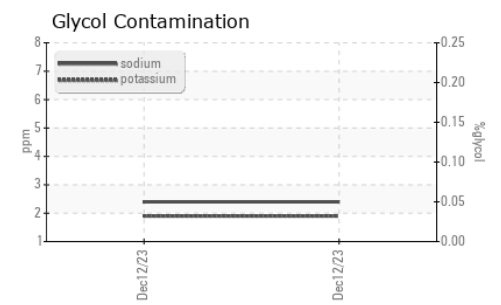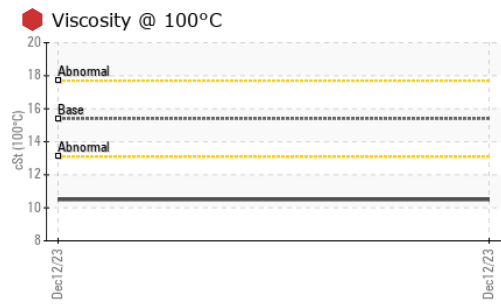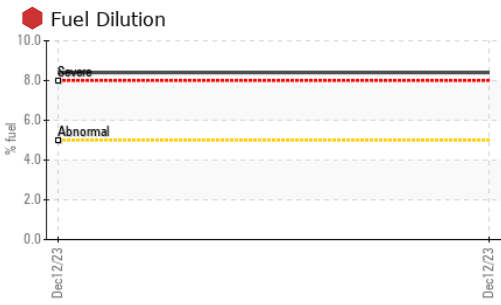

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005579 **Received** : 12 Jan 2024
Lab Number : 02608512 **Diagnosed** : 15 Jan 2024
Unique Number : 5709598 **Diagnostician** : Kevin Marson
Test Package : MOB 1 (Additional Tests: FuelDilution, Glycol, PercentFuel, Visual)

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.