



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
GREATER SHEDIAC SEWERAGE [6100246557]

Machine Id
KOHLER 4735403180

Component
Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0019594	WA0019341	---
Sample Date		Client Info		05 Jan 2024	09 Feb 2023	---
Machine Age	hrs	Client Info		203	175	---
Oil Age	hrs	Client Info		29	44	---
Filter Age	hrs	Client Info		29	44	---
Oil Changed		Client Info		Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	NORMAL	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	1	2	---
Chromium	ppm	ASTM D5185(m)	>20	0	0	---
Nickel	ppm	ASTM D5185(m)	>4	0	<1	---
Titanium	ppm	ASTM D5185(m)		0	<1	---
Silver	ppm	ASTM D5185(m)	>3	0	0	---
Aluminum	ppm	ASTM D5185(m)	>20	1	3	---
Lead	ppm	ASTM D5185(m)	>40	0	<1	---
Copper	ppm	ASTM D5185(m)	>330	<1	<1	---
Tin	ppm	ASTM D5185(m)	>15	0	<1	---
Vanadium	ppm	ASTM D5185(m)		0	0	---

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	3	6	---
Potassium	ppm	ASTM D5185(m)	>20	0	<1	---
Fuel		WC Method	>5	<1.0	<1.0	---
Water		WC Method	>0.2	NEG	NEG	---
Glycol		WC Method		NEG	NEG	---
Soot %	%	ASTM D7844*	>3	0	0	---
Nitration	Abs/cm	ASTM D7624*	>20	4.9	7.8	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.2	18.4	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	1	2	---
Boron	ppm	ASTM D5185(m)	250	7	64	---
Barium	ppm	ASTM D5185(m)	10	0	0	---
Molybdenum	ppm	ASTM D5185(m)	100	58	76	---
Manganese	ppm	ASTM D5185(m)		0	<1	---
Magnesium	ppm	ASTM D5185(m)	450	871	19	---
Calcium	ppm	ASTM D5185(m)	3000	1095	2229	---
Phosphorus	ppm	ASTM D5185(m)	1150	992	1101	---
Zinc	ppm	ASTM D5185(m)	1350	1119	1136	---
Sulfur	ppm	ASTM D5185(m)	4250	2702	3300	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.0	12.9	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.9	14.2	---

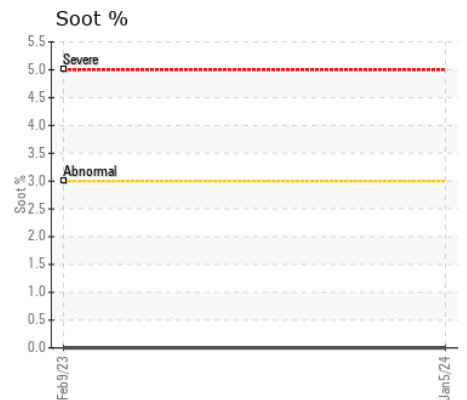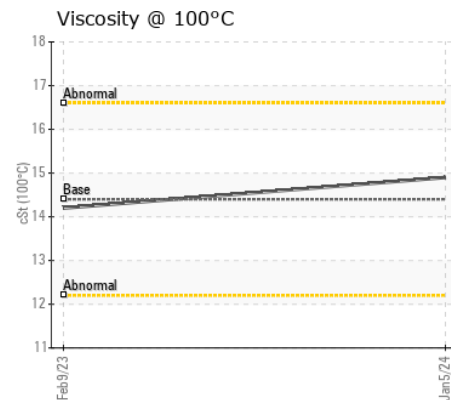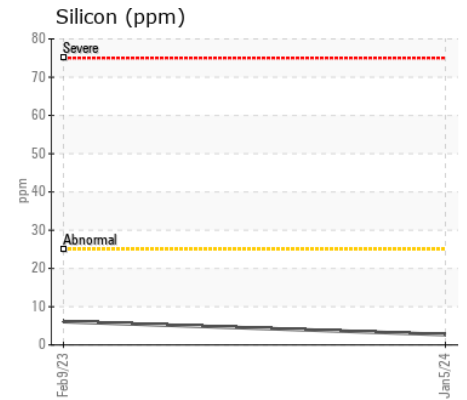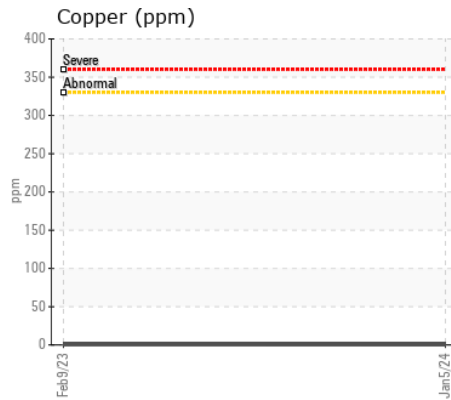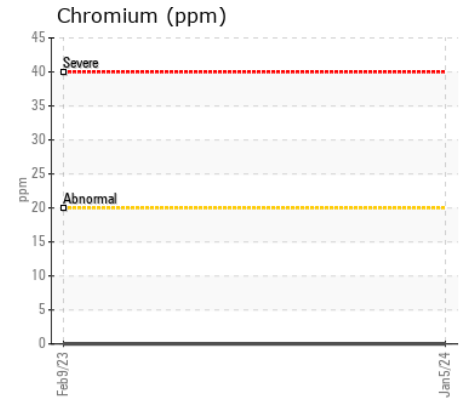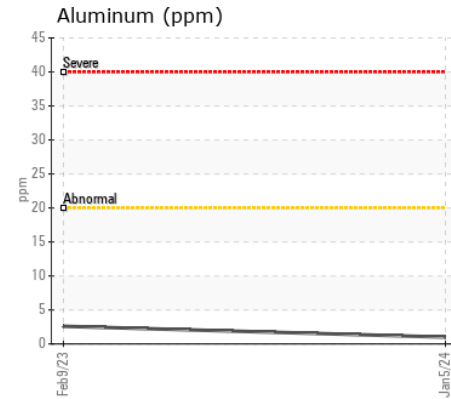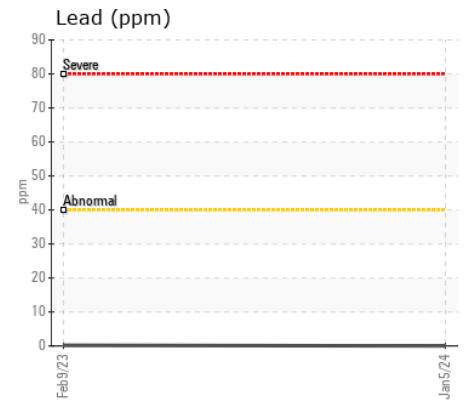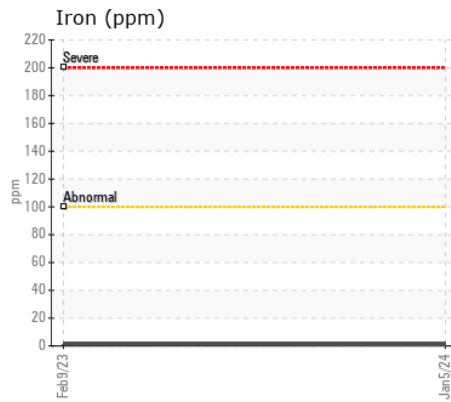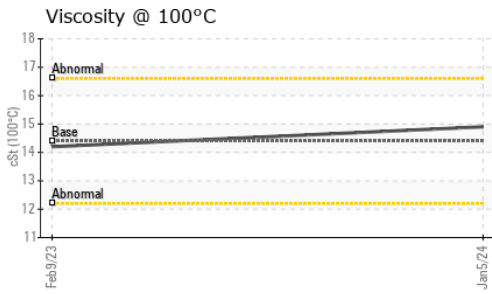

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0019594 **Received** : 16 Jan 2024
Lab Number : 02608913 **Diagnosed** : 16 Jan 2024
Unique Number : 5709999 **Diagnostician** : Wes Davis
Test Package : MOB 1

Wajax Power Systems
 485 VENTURE DR
 MONCTON, NB
 CA E1H 2P4
 Contact: Doug Balsler
 dbalsler@wajax.com
 T: (506)855-5371
 F: (506)870-4448

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.