



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
SHEDIAC SEWERAGE [6100246557]

Machine Id
JOHN DEERE PE4045T654509

Component
Diesel Engine

Fluid
CASTROL 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0020818	WA0014899	---
Sample Date		Client Info		09 Jan 2024	15 Oct 2020	---
Machine Age	hrs	Client Info		741	647	---
Oil Age	hrs	Client Info		40	74	---
Filter Age	hrs	Client Info		40	74	---
Oil Changed		Client Info		Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	NORMAL	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>51	2	3	---
Chromium	ppm	ASTM D5185(m)	>11	0	0	---
Nickel	ppm	ASTM D5185(m)	>5	<1	0	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)	>3	0	<1	---
Aluminum	ppm	ASTM D5185(m)	>31	1	<1	---
Lead	ppm	ASTM D5185(m)	>26	0	<1	---
Copper	ppm	ASTM D5185(m)	>26	<1	<1	---
Tin	ppm	ASTM D5185(m)	>4	0	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>22	4	3	---
Potassium	ppm	ASTM D5185(m)	>20	0	<1	---
Fuel		WC Method	>2.1	<1.0	<1.0	---
Water		WC Method	>0.21	NEG	NEG	---
Glycol		WC Method		NEG	NEG	---
Soot %	%	ASTM D7844*	>3	0	0	---
Nitration	Abs/cm	ASTM D7624*	>20	4.8	4.8	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.3	18.6	---
Emulsified Water	scalar	Visual*	>0.21	NEG	NEG	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>406	1	2	---
Boron	ppm	ASTM D5185(m)		6	1	---
Barium	ppm	ASTM D5185(m)		0	0	---
Molybdenum	ppm	ASTM D5185(m)		58	58	---
Manganese	ppm	ASTM D5185(m)		0	<1	---
Magnesium	ppm	ASTM D5185(m)		887	979	---
Calcium	ppm	ASTM D5185(m)		1074	1070	---
Phosphorus	ppm	ASTM D5185(m)		990	1049	---
Zinc	ppm	ASTM D5185(m)		1115	1270	---
Sulfur	ppm	ASTM D5185(m)		2696	2828	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.3	14.0	---
Visc @ 100°C	cSt	ASTM D7279(m)		14.6	14.9	---

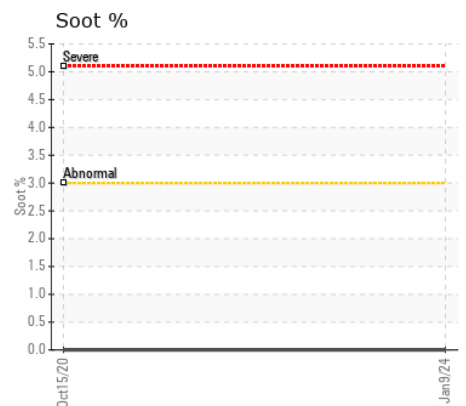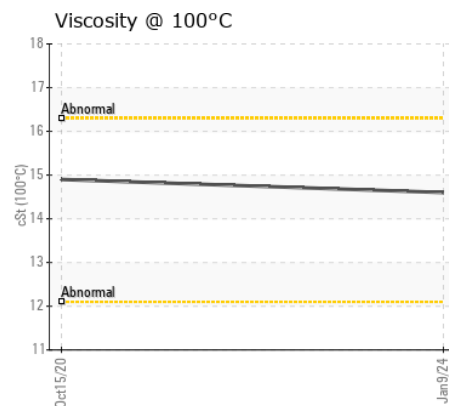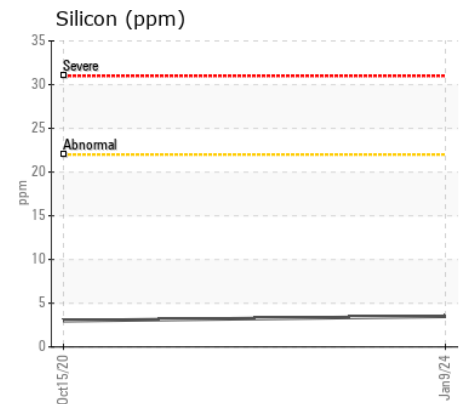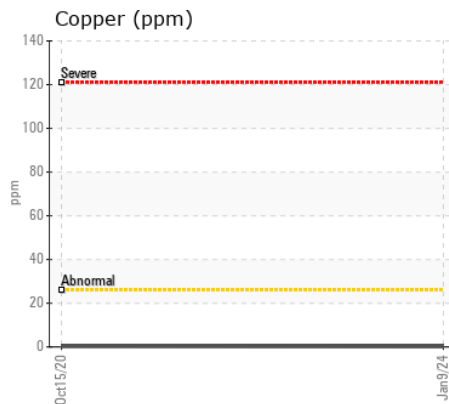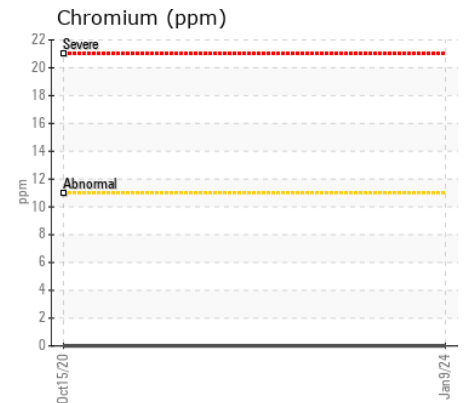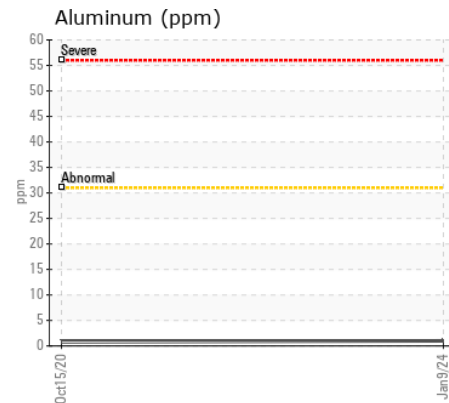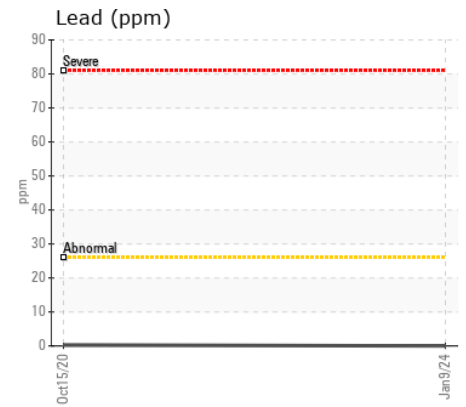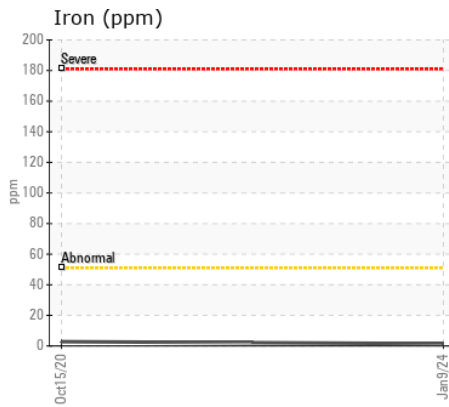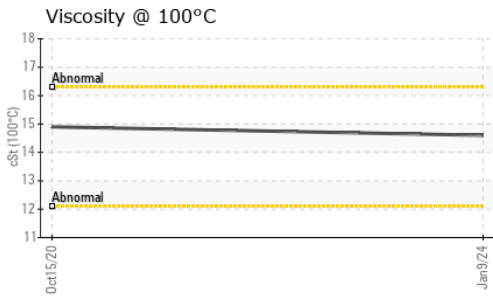

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020818 **Received** : 16 Jan 2024
Lab Number : 02608914 **Diagnosed** : 16 Jan 2024
Unique Number : 5710000 **Diagnostician** : Wes Davis
Test Package : MOB 1

Wajax Power Systems
 485 VENTURE DR
 MONCTON, NB
 CA E1H 2P4
 Contact: Doug Balsler
 dbalsler@wajax.com
 T: (506)855-5371
 F: (506)870-4448

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.