



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
STRATH
Machine Id
BABBIT BRG PEDESTAL A ROD MILL NON DRIVE END
Component
Non-Drive End Bearing
Fluid
PETRO CANADA TURBOFLO R&O 68 (15 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0878478	WC0811981	WC0828549
Sample Date		Client Info		09 Jan 2024	04 Oct 2023	17 Jul 2023
Machine Age	mths	Client Info		0	6	0
Oil Age	mths	Client Info		0	6	6
Filter Age	mths	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Filter Changed		Client Info		N/A	N/A	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>20	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	0	0	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	0
Lead	ppm	ASTM D5185(m)	>20	1	1	3
Copper	ppm	ASTM D5185(m)	>20	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>20	1	<1	1
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE

CONTAMINATION





There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>15	0	0	0
Potassium	ppm	ASTM D5185(m)	>20	0	0	<1
Water		WC Method	>2	NEG	NEG	NEG
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	VLITE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		0	0	0
Boron	ppm	ASTM D5185(m)		0	<1	<1
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		<1	0	0
Calcium	ppm	ASTM D5185(m)	0	4	<1	1
Phosphorus	ppm	ASTM D5185(m)	4	11	9	4
Zinc	ppm	ASTM D5185(m)	0	2	<1	2
Sulfur	ppm	ASTM D5185(m)		144	141	155
Visc @ 40°C	cSt	ASTM D7279(m)	64.9	64.2	64.3	65.1

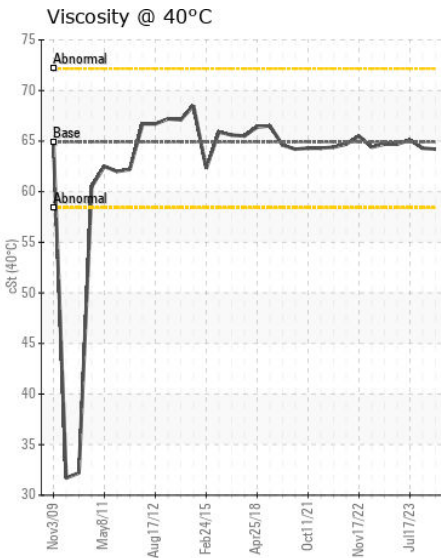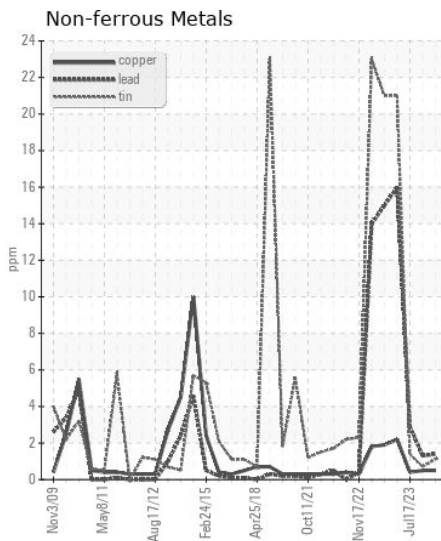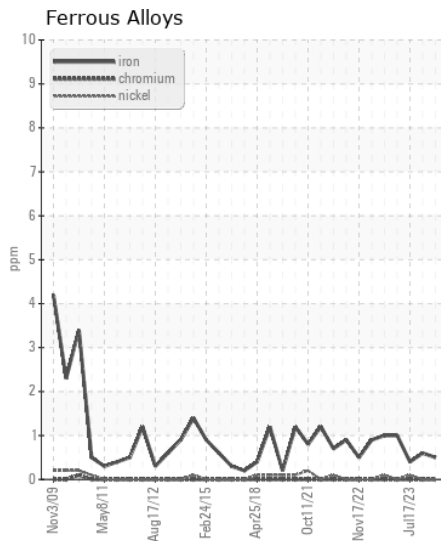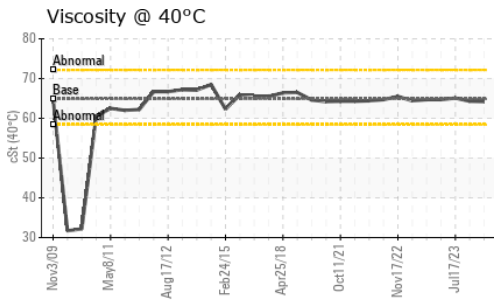

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Wajax - Northpoint Technical Services
Sample No. : WC0878478 **Received** : 16 Jan 2024 1108 WebbWood Drive.
Lab Number : 02609000 **Diagnosed** : 16 Jan 2024 Sudbury, ON
Unique Number : 5710086 **Diagnostician** : Kevin Marson CA P3C 3B7
Test Package : IND 1 Contact: Nick Walker
 nwalker@northpoints.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T: (705)499-2387
 F: (795)690-9010