



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**10994640**  
Component  
**Diesel Engine**  
Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0862505	---	---
Sample Date		Client Info		12 Jan 2024	---	---
Machine Age	hrs	Client Info		616	---	---
Oil Age	hrs	Client Info		225	---	---
Filter Age	hrs	Client Info		225	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

## WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>90	5	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>2	0	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	1	---	---
Lead	ppm	ASTM D5185(m)	>40	0	---	---
Copper	ppm	ASTM D5185(m)	>330	<1	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

## CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	3	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Fuel		WC Method	>3.0	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>6	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	6.8	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.7	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

## FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	1	---	---
Boron	ppm	ASTM D5185(m)	250	7	---	---
Barium	ppm	ASTM D5185(m)	10	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	100	55	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)	450	903	---	---
Calcium	ppm	ASTM D5185(m)	3000	1031	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	929	---	---
Zinc	ppm	ASTM D5185(m)	1350	1095	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2519	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	15.8	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	12.4	---	---

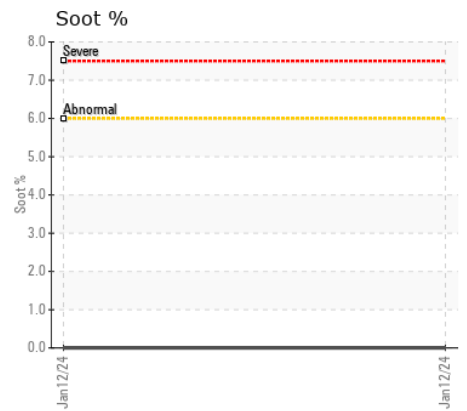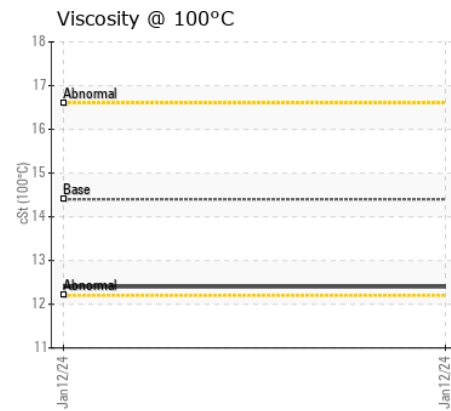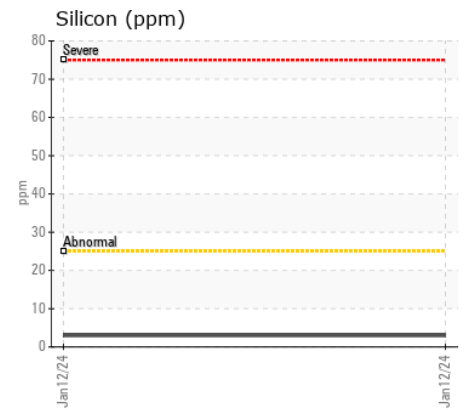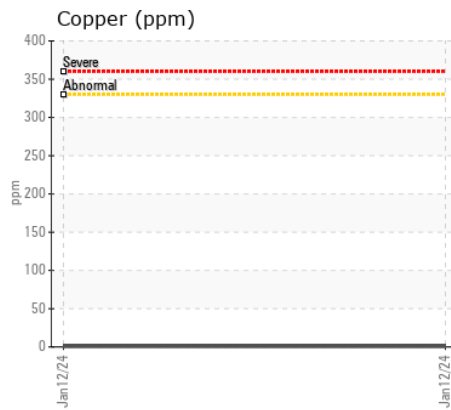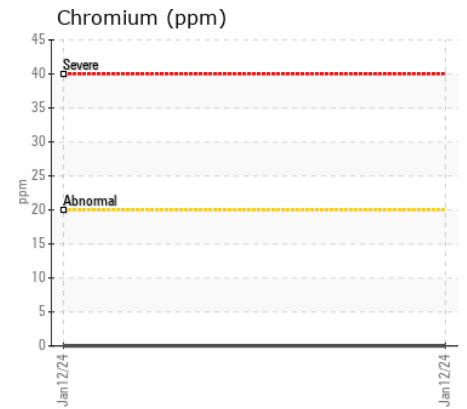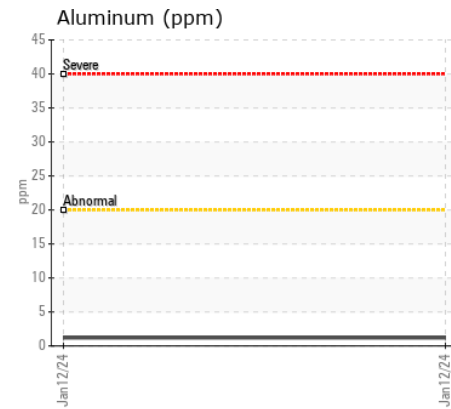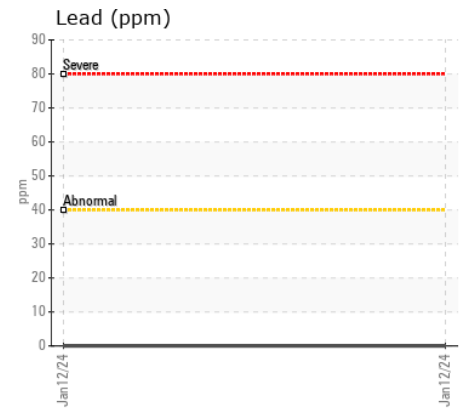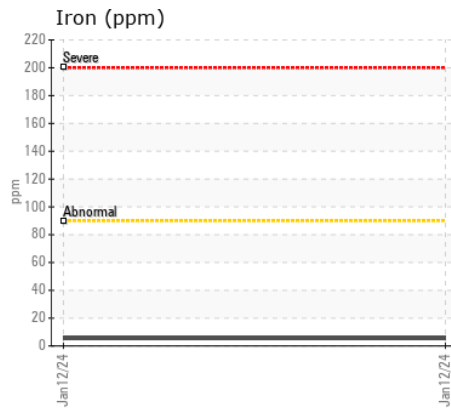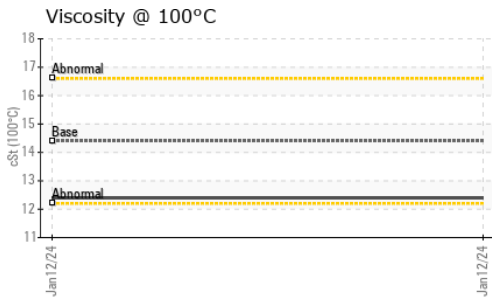

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0862505 **Received** : 17 Jan 2024  
**Lab Number** : 02609173 **Diagnosed** : 17 Jan 2024  
**Unique Number** : 5710259 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: Visual )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**HVAC RENTALS**  
 20 SIMPSON ROAD  
 BOLTON, ON  
 CA L7E 1G9  
 Contact: Hongwu Zhang  
 hzhang@hvacentals.ca  
 T: (647)637-1409  
 F: