



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[8965]
Machine Id

1
Component
Diesel Engine

Fluid
SHELL ROTELLA T 30 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0755681	---	---
Sample Date		Client Info		15 Jan 2024	---	---
Machine Age	hrs	Client Info		706	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>200	2	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>2	0	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>30	1	---	---
Lead	ppm	ASTM D5185(m)	>30	<1	---	---
Copper	ppm	ASTM D5185(m)	>30	1	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>30	3	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Fuel		WC Method	>3.0	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	3.3	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	13.5	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		2	---	---
Boron	ppm	ASTM D5185(m)	0	1	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)	0	117	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		24	---	---
Calcium	ppm	ASTM D5185(m)	1890	2684	---	---
Phosphorus	ppm	ASTM D5185(m)	680	1095	---	---
Zinc	ppm	ASTM D5185(m)	750	1175	---	---
Sulfur	ppm	ASTM D5185(m)		3086	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	6.5	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	11.5	10.9	---	---

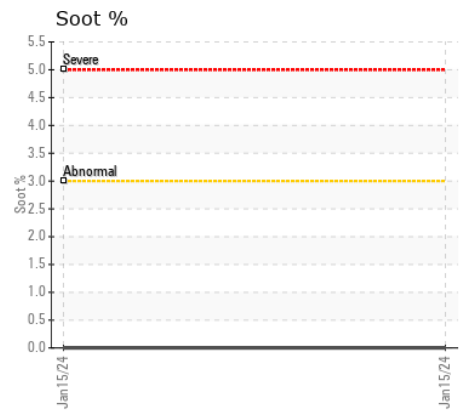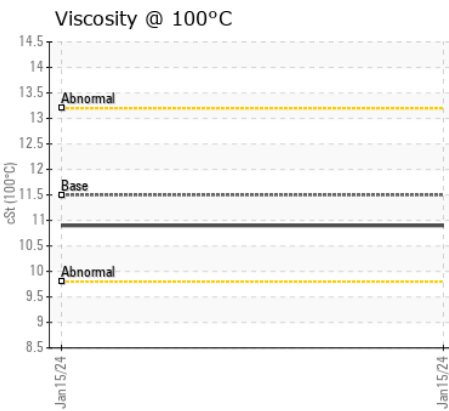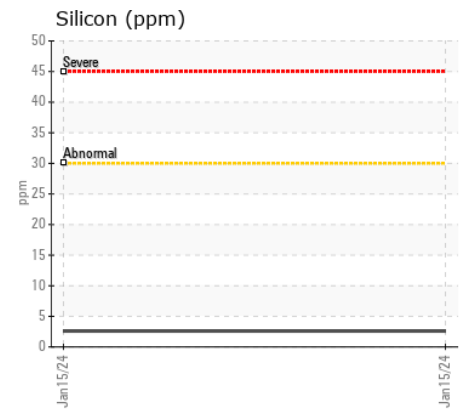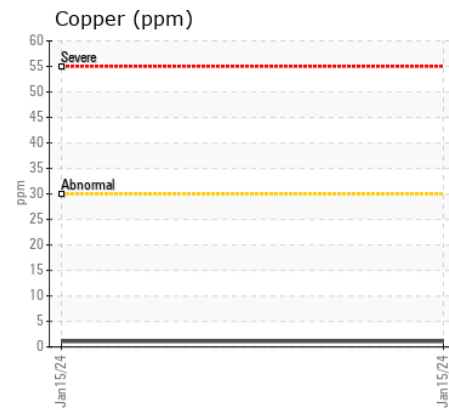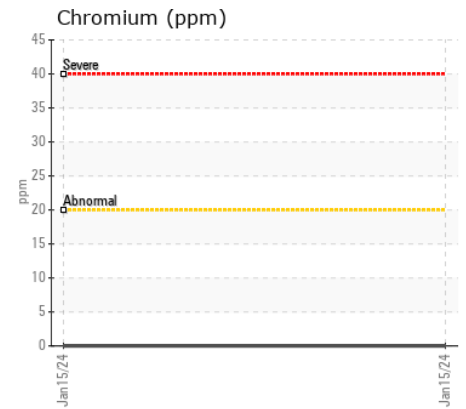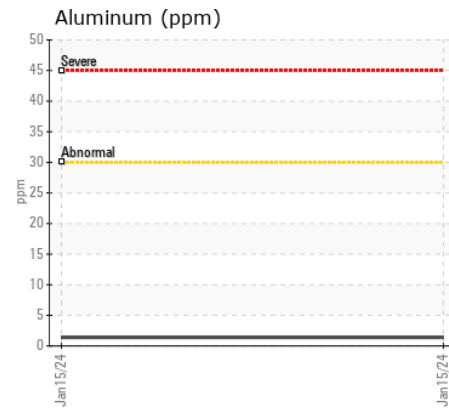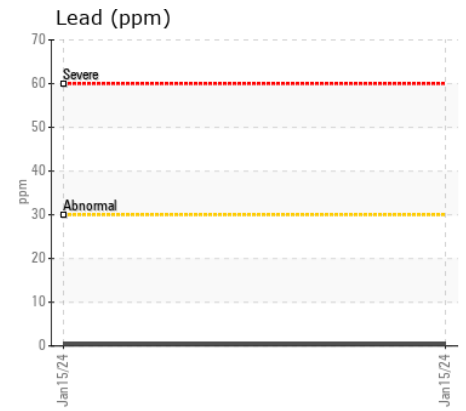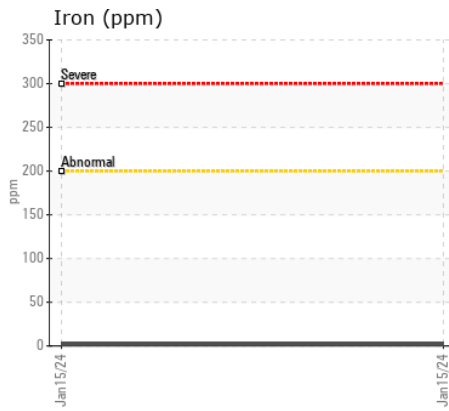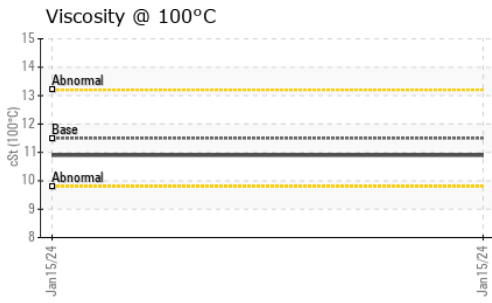

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0755681 **Received** : 17 Jan 2024
Lab Number : 02609183 **Diagnosed** : 17 Jan 2024
Unique Number : 5710269 **Diagnostician** : Wes Davis
Test Package : MOB 1

GENSERVE LTD.
 562 VICTORIA ST.
 PORT PERRY, ON
 CA L9L 1R7
 Contact: Raymond Robert
 raymond@genserve.ca
 T: (416)729-0355
 F: x:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.