



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL



Machine Id
833067
Component
Natural Gas Engine
Fluid
PETRO CANADA DURON GEO LD 15W40 (--- LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		GFL0094411	---	---
Sample Date		Client Info		16 Jan 2024	---	---
Machine Age	hrs	Client Info		1256	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

PQ		ASTM D8184*		0	---	---
Iron	ppm	ASTM D5185(m)	>50	65	---	---
Chromium	ppm	ASTM D5185(m)	>4	1	---	---
Nickel	ppm	ASTM D5185(m)	>2	1	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	<1	---	---
Aluminum	ppm	ASTM D5185(m)	>9	5	---	---
Lead	ppm	ASTM D5185(m)	>30	2	---	---
Copper	ppm	ASTM D5185(m)	>35	14	---	---
Tin	ppm	ASTM D5185(m)	>4	2	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>+100	23	---	---
Potassium	ppm	ASTM D5185(m)	>20	2	---	---
Water		WC Method	>0.1	NEG	---	---
Soot %	%	ASTM D7844*		0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	11.2	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	24.6	---	---
Emulsified Water	scalar	Visual*	>0.1	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		3	---	---
Boron	ppm	ASTM D5185(m)	50	9	---	---
Barium	ppm	ASTM D5185(m)	5	2	---	---
Molybdenum	ppm	ASTM D5185(m)	50	90	---	---
Manganese	ppm	ASTM D5185(m)	0	11	---	---
Magnesium	ppm	ASTM D5185(m)	560	663	---	---
Calcium	ppm	ASTM D5185(m)	1510	1391	---	---
Phosphorus	ppm	ASTM D5185(m)	780	723	---	---
Zinc	ppm	ASTM D5185(m)	870	832	---	---
Sulfur	ppm	ASTM D5185(m)	2040	2214	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	20.2	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.1	13.8	---	---

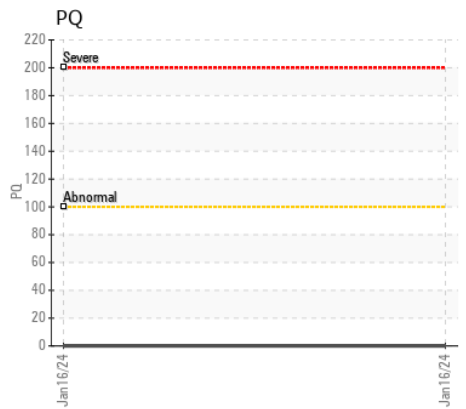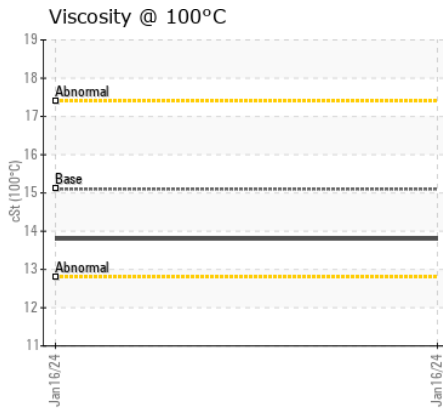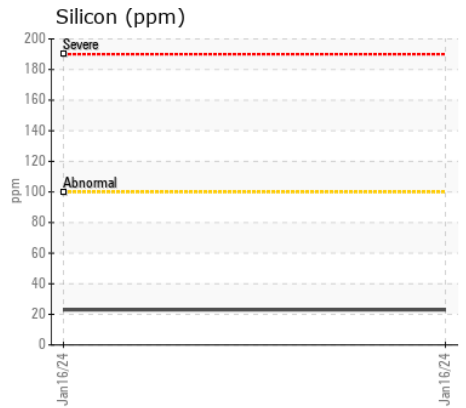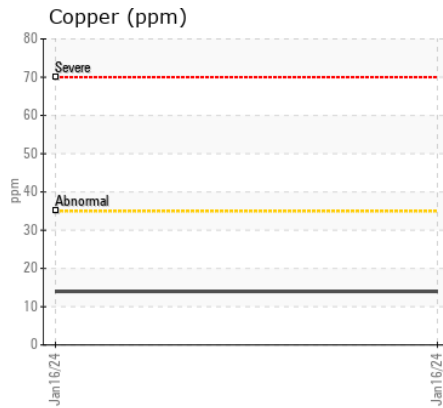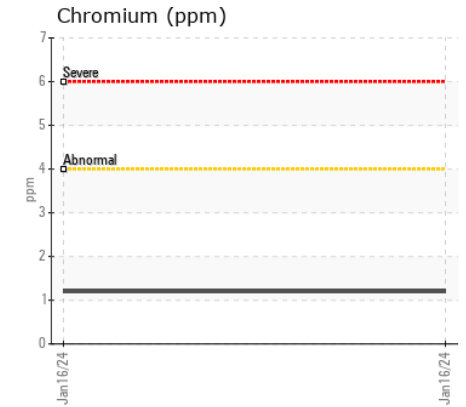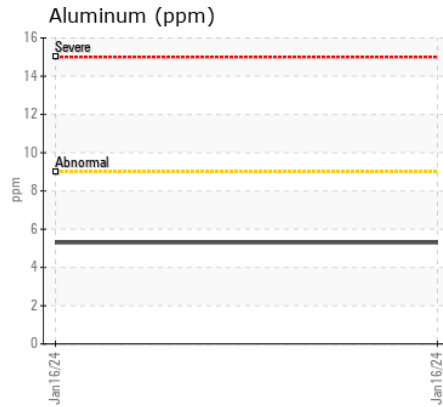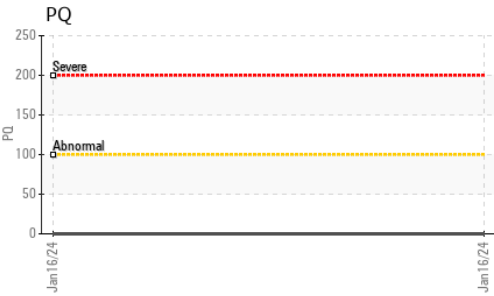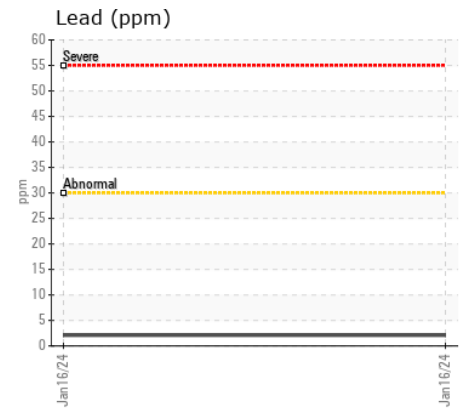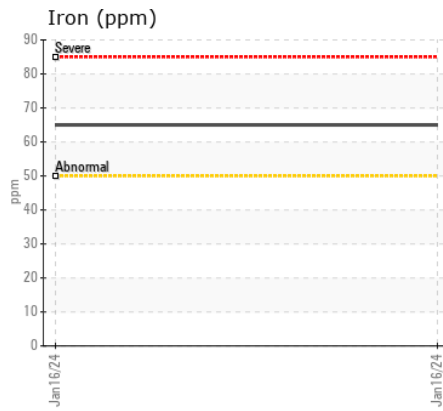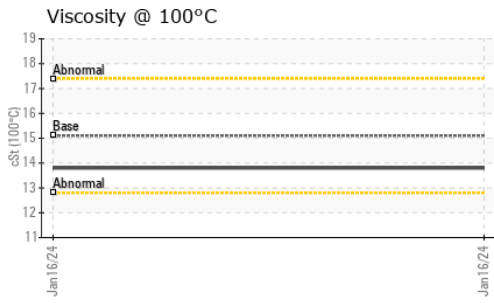

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GFL0094411 **Received** : 17 Jan 2024
Lab Number : 02609291 **Diagnosed** : 18 Jan 2024
Unique Number : 5710377 **Diagnostician** : Kevin Marson
Test Package : MOB 1 (Additional Tests: PQ)
 To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

GFL Environmental - 222 - Sandhill
 SANDHILL DISPOSAL & RECYCLING DIVIS, 19 COMMERCE ROAD
 ORANGEVILLE, ON
 CA L9W 3X5
 Contact: GLENN COOK
 gcook@gflenv.com
 T: (519)940-4167
 F: