



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[49602]
 Machine Id
I180427786
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CU0022625	---	---
Sample Date		Client Info		17 Jan 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	3	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	<1	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	1	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>330	2	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	7	---	---
Potassium	ppm	ASTM D5185(m)	>20	23	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol	%	ASTM D7922*		0.0	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	6.4	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	20.4	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	3	---	---
Boron	ppm	ASTM D5185(m)	250	41	---	---
Barium	ppm	ASTM D5185(m)	10	0	---	---
Molybdenum	ppm	ASTM D5185(m)	100	46	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)	450	740	---	---
Calcium	ppm	ASTM D5185(m)	3000	1203	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	733	---	---
Zinc	ppm	ASTM D5185(m)	1350	832	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2120	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	16.8	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.6	---	---

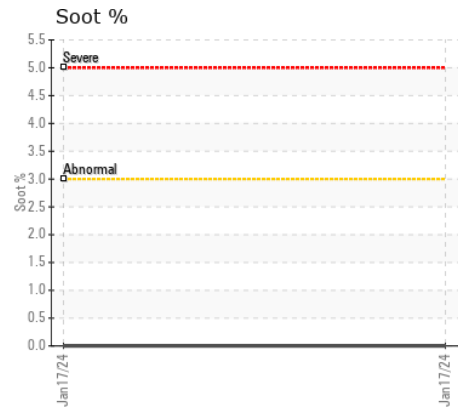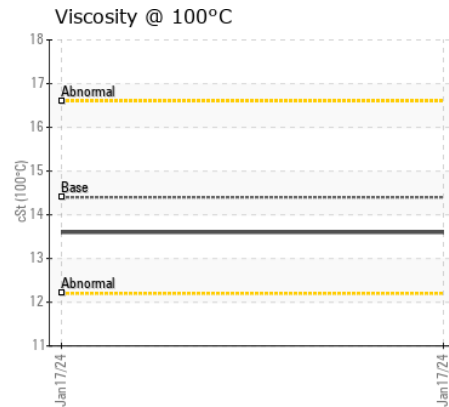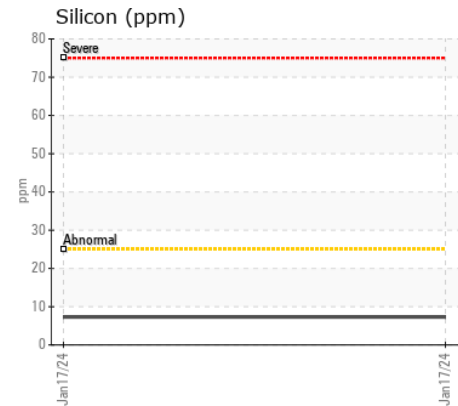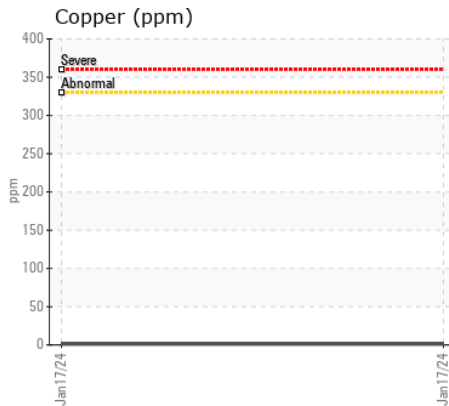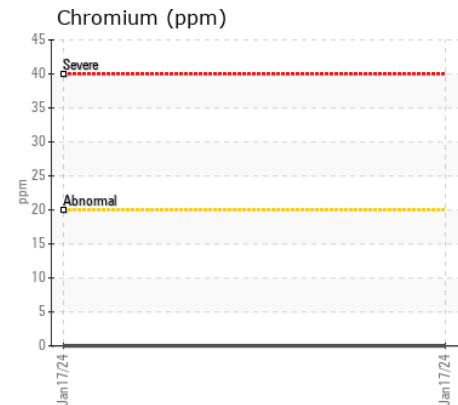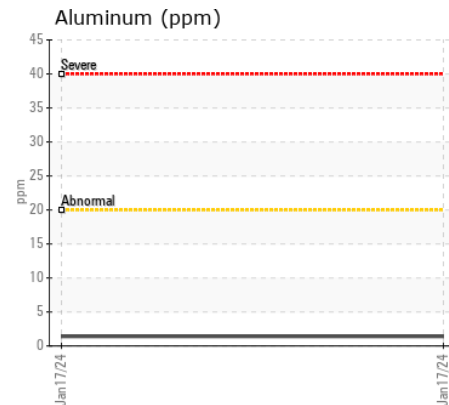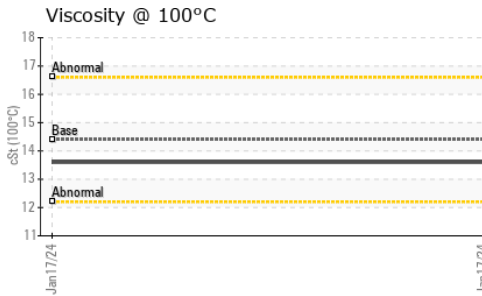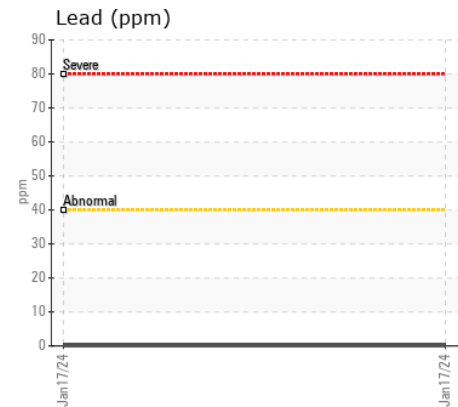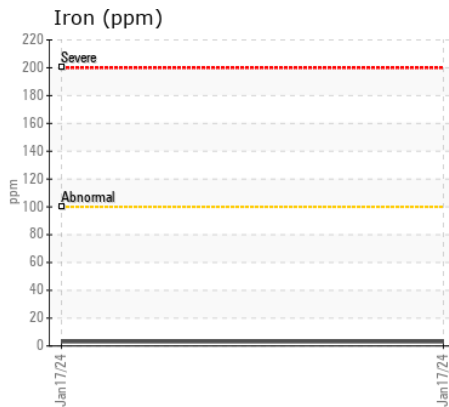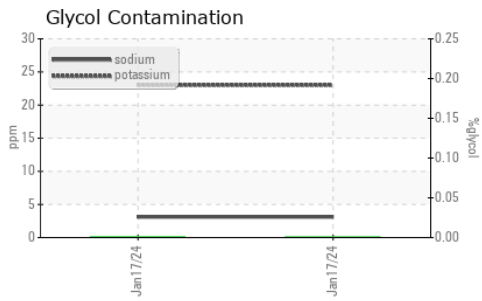

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0022625
Lab Number : 02609616
Unique Number : 5710702
Test Package : MOB 1 (Additional Tests: Glycol, Visual)

CUMMINS EASTERN CANADA INC.
 122 CLYDE AVENUE
 MOUNT PEARL, NL
 CA A1N 4S3
 Contact: DARRYL CAREY
 DARRYL.CAREY@CUMMINS.COM
 T: (709)747-1135
 F: (709)747-1084

*To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.*