



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
P23386
 Component
Gearbox
 Fluid
CHEVRON MEROPA 220 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

WEAR

All component wear rates are normal.









CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CB0031621	CB0031611	CB0030868
Sample Date		Client Info		10 Jan 2024	28 Nov 2023	06 Nov 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>200	6	6	6
Chromium	ppm	ASTM D5185(m)	>15	0	0	0
Nickel	ppm	ASTM D5185(m)	>15	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	<1
Aluminum	ppm	ASTM D5185(m)	>25	<1	<1	0
Lead	ppm	ASTM D5185(m)	>100	0	0	0
Copper	ppm	ASTM D5185(m)	>200	2	2	2
Tin	ppm	ASTM D5185(m)	>25	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185(m)	>50	1	1	1
Potassium	ppm	ASTM D5185(m)	>20	2	0	<1
Water		WC Method	>0.2	NEG	NEG	NEG
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Sodium	ppm	ASTM D5185(m)		1	1	2
Boron	ppm	ASTM D5185(m)		9	10	10
Barium	ppm	ASTM D5185(m)		0	<1	<1
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		<1	<1	<1
Calcium	ppm	ASTM D5185(m)		6	6	6
Phosphorus	ppm	ASTM D5185(m)		220	220	224
Zinc	ppm	ASTM D5185(m)		8	8	8
Sulfur	ppm	ASTM D5185(m)		7250	7034	7015
Acid Number (AN)	mg KOH/g	ASTM D974*		0.60	0.63	0.53
Visc @ 40°C	cSt	ASTM D7279(m)	209	218	218	217

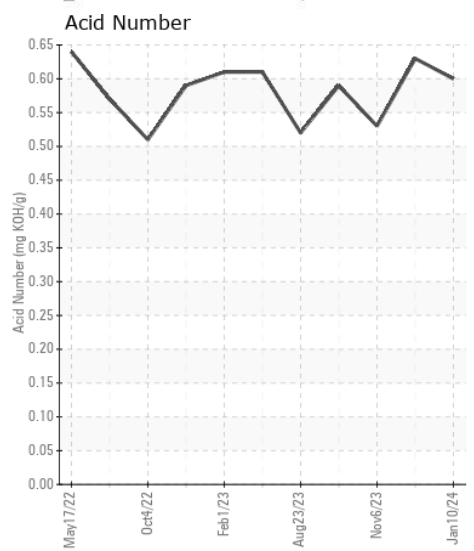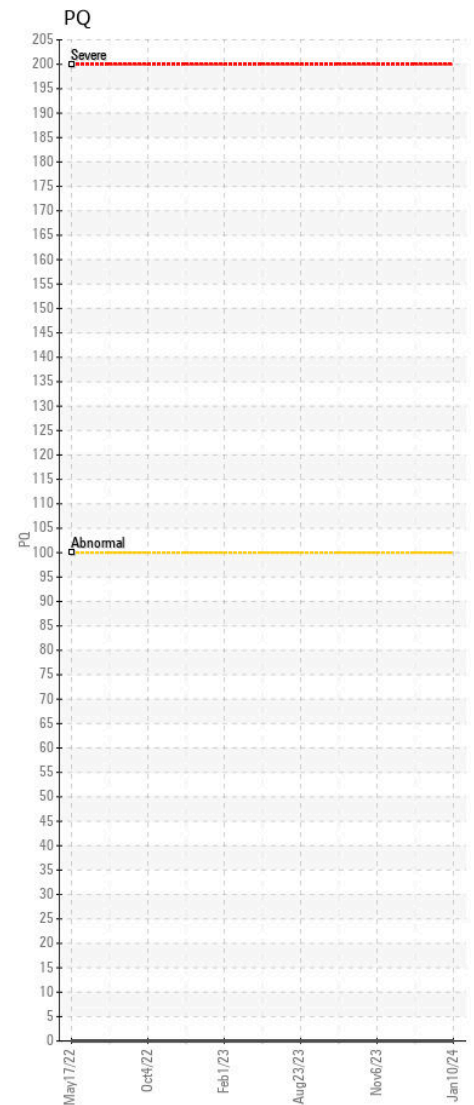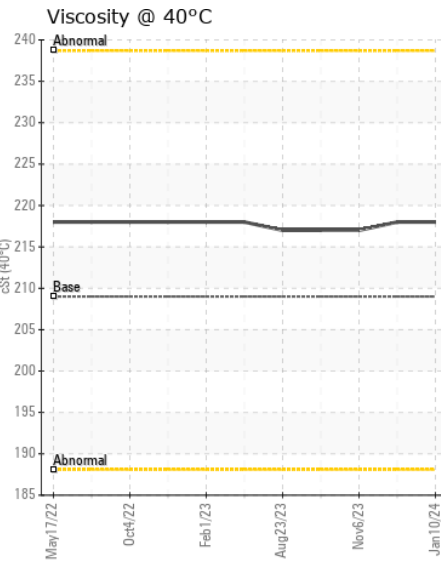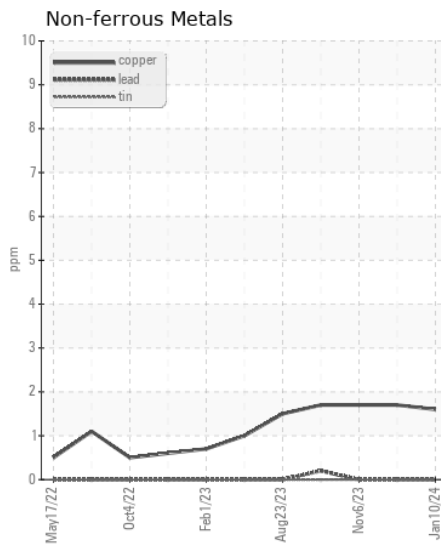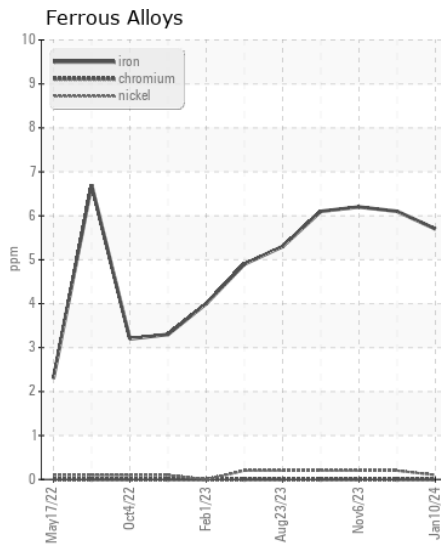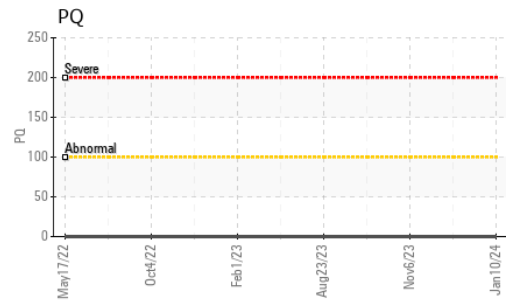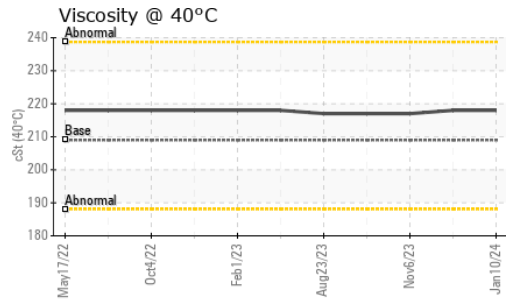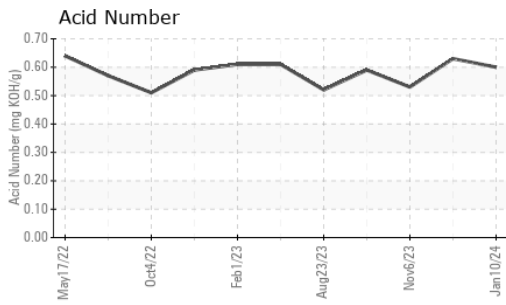

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CB0031621 **Received** : 18 Jan 2024
Lab Number : 02609787 **Diagnosed** : 19 Jan 2024
Unique Number : 5710873 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Pepsico Foods Canada
 34 Hunter S.W.
 Peterborough, ON
 CA K9J 7B2
 Contact: Tom Mclean
 tom.mclean@pepsico.com
 T:
 F: (705)876-4114