



**POWER SYSTEMS**  
**SYSTÈMES DE PUISSANCE**

OIL ANALYSIS REPORT

|                 |               |
|-----------------|---------------|
| WEAR            | <b>NORMAL</b> |
| CONTAMINATION   | <b>NORMAL</b> |
| FLUID CONDITION | <b>NORMAL</b> |

Area

**HAMPTON INN [6100230771]**

Machine Id

**JOHN DEERE PE4045D844672**

Component

**Diesel Engine**

Fluid

**PETRO CANADA DURON SAE 15W40 (--- GAL)**

**RECOMMENDATION**

Confirm the source of the lubricant being utilized for top-up/fill.  
Resample at the next service interval to monitor.

| Test           | UOM | Method      | Limit/Abn | Current            | History1    | History2    |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number  |     | Client Info |           | <b>WA0020867</b>   | WA0018581   | WA0016308   |
| Sample Date    |     | Client Info |           | <b>18 Jan 2024</b> | 08 Dec 2022 | 08 Oct 2021 |
| Machine Age    | hrs | Client Info |           | <b>56</b>          | 0           | 31          |
| Oil Age        | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Filter Age     | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Oil Changed    |     | Client Info |           | <b>Changed</b>     | Changed     | Changed     |
| Filter Changed |     | Client Info |           | <b>Changed</b>     | Changed     | Changed     |
| Sample Status  |     |             |           | <b>NORMAL</b>      | NORMAL      | NORMAL      |

**WEAR**

Metal levels are typical for a new component breaking in.

|              |        |               |      |              |     |     |
|--------------|--------|---------------|------|--------------|-----|-----|
| Iron         | ppm    | ASTM D5185(m) | >51  | <b>1</b>     | 2   | 2   |
| Chromium     | ppm    | ASTM D5185(m) | >11  | <b>0</b>     | 0   | 0   |
| Nickel       | ppm    | ASTM D5185(m) | >5   | <b>0</b>     | 0   | <1  |
| Titanium     | ppm    | ASTM D5185(m) |      | <b>0</b>     | <1  | 0   |
| Silver       | ppm    | ASTM D5185(m) | >3   | <b>0</b>     | 0   | <1  |
| Aluminum     | ppm    | ASTM D5185(m) | >31  | <b>1</b>     | <1  | <1  |
| Lead         | ppm    | ASTM D5185(m) | >26  | <b>0</b>     | 0   | <1  |
| Copper       | ppm    | ASTM D5185(m) | >26  | <b>&lt;1</b> | <1  | <1  |
| Tin          | ppm    | ASTM D5185(m) | >4   | <b>0</b>     | 0   | <1  |
| Vanadium     | ppm    | ASTM D5185(m) |      | <b>0</b>     | 0   | 0   |
| White Metal  | scalar | Visual*       | NONE | <b>NONE</b>  | --- | --- |
| Yellow Metal | scalar | Visual*       | NONE | <b>NONE</b>  | --- | --- |

**CONTAMINATION**











There is no indication of any contamination in the oil.

|                  |          |               |       |                |       |       |
|------------------|----------|---------------|-------|----------------|-------|-------|
| Silicon          | ppm      | ASTM D5185(m) | >22   | <b>3</b>       | 4     | 5     |
| Potassium        | ppm      | ASTM D5185(m) | >20   | <b>2</b>       | 5     | 7     |
| Fuel             |          | WC Method     | >2.1  | <b>&lt;1.0</b> | <1.0  | <1.0  |
| Water            |          | WC Method     | >0.21 | <b>NEG</b>     | NEG   | NEG   |
| Glycol           |          | WC Method     |       | <b>NEG</b>     | 0.0   | 0.0   |
| Soot %           | %        | ASTM D7844*   | >3    | <b>0</b>       | 0     | 0     |
| Nitration        | Abs/cm   | ASTM D7624*   | >20   | <b>5.2</b>     | 4.3   | 6.0   |
| Sulfation        | Abs/.1mm | ASTM D7415*   | >30   | <b>16.6</b>    | 16.4  | 21.1  |
| Silt             | scalar   | Visual*       | NONE  | <b>NONE</b>    | ---   | ---   |
| Debris           | scalar   | Visual*       | NONE  | <b>VLITE</b>   | ---   | ---   |
| Sand/Dirt        | scalar   | Visual*       | NONE  | <b>NONE</b>    | ---   | ---   |
| Appearance       | scalar   | Visual*       | NORML | <b>NORML</b>   | ---   | ---   |
| Odor             | scalar   | Visual*       | NORML | <b>NORML</b>   | NORML | NORML |
| Emulsified Water | scalar   | Visual*       | >0.21 | <b>NEG</b>     | NEG   | NEG   |

**FLUID CONDITION**

Additive levels indicate the addition of a different brand, or type of oil.  
The condition of the oil is acceptable for the time in service.

|              |          |               |      |             |      |      |
|--------------|----------|---------------|------|-------------|------|------|
| Sodium       | ppm      | ASTM D5185(m) | >31  | <b>1</b>    | 2    | 2    |
| Boron        | ppm      | ASTM D5185(m) | 1    | <b>12</b>   | 133  | 178  |
| Barium       | ppm      | ASTM D5185(m) | 1    | <b>0</b>    | 0    | 0    |
| Molybdenum   | ppm      | ASTM D5185(m) | 60   | <b>19</b>   | <1   | 4    |
| Manganese    | ppm      | ASTM D5185(m) | 1    | <b>0</b>    | <1   | <1   |
| Magnesium    | ppm      | ASTM D5185(m) | 1010 | <b>312</b>  | 18   | 67   |
| Calcium      | ppm      | ASTM D5185(m) | 1070 | <b>1873</b> | 2219 | 2080 |
| Phosphorus   | ppm      | ASTM D5185(m) | 1150 | <b>923</b>  | 1014 | 1037 |
| Zinc         | ppm      | ASTM D5185(m) | 1270 | <b>1038</b> | 1067 | 1132 |
| Sulfur       | ppm      | ASTM D5185(m) | 2060 | <b>3057</b> | 3108 | 3060 |
| Oxidation    | Abs/.1mm | ASTM D7414*   | >25  | <b>10.5</b> | 9.4  | 16.6 |
| Visc @ 100°C | cSt      | ASTM D7279(m) | 15.6 | <b>14.8</b> | 14.5 | 14.3 |

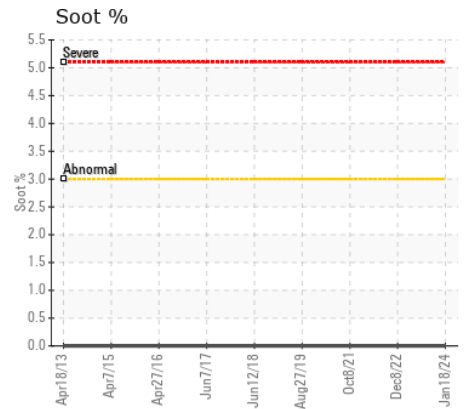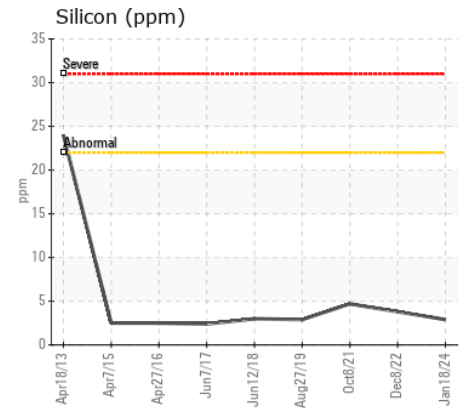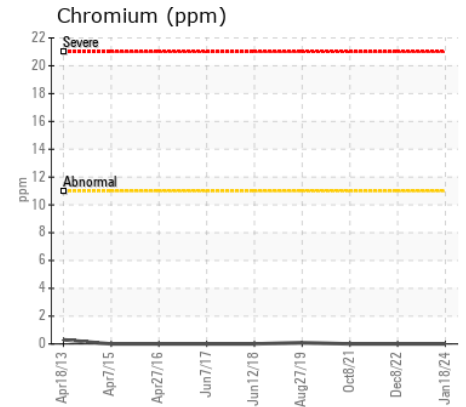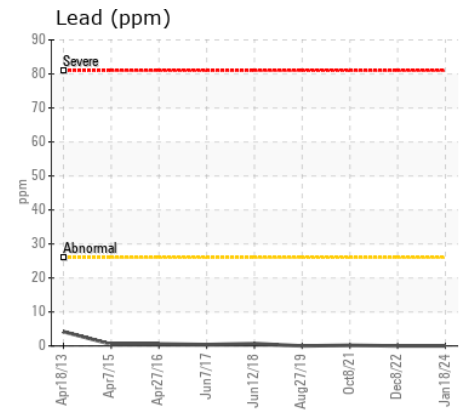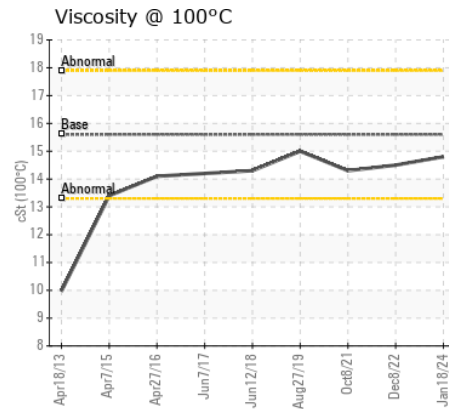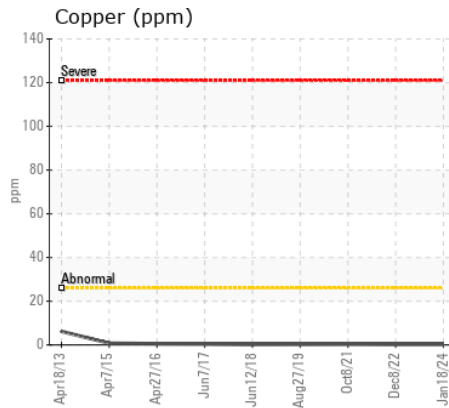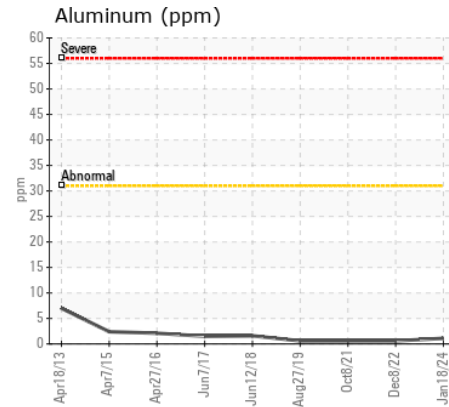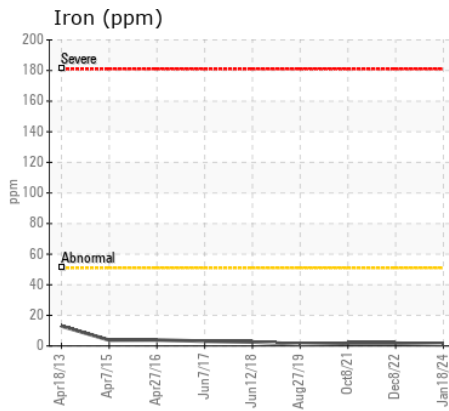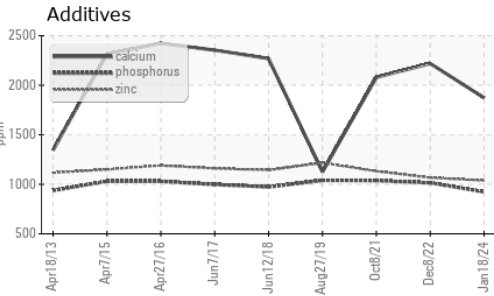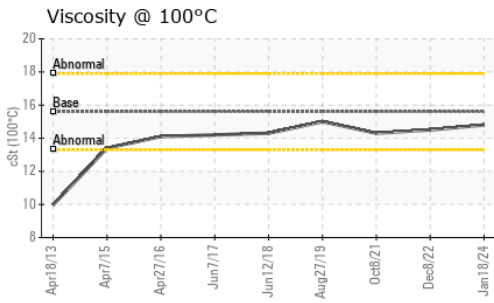

ISO 17025:2017  
Accredited  
Laboratory

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0020867 **Received** : 23 Jan 2024  
**Lab Number** : 02610525 **Diagnosed** : 23 Jan 2024  
**Unique Number** : 5711611 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: Visual )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Wajax Power Systems**  
 70 Raddall Avenue  
 Dartmouth, NS  
 CA B3B 1T7  
 Contact: Danelle Hoffman  
 dhoffman@wajax.com  
 T: (902)468-6200  
 F: (902)468-3325