
WEAR CONTAMINATION **FLUID CONDITION**

NORMAL NORMAL NORMAL

ONTARIO GAMING GTA [149331] Machine Id 2

2							
Component Diesel Engine							
{not provided} (GAL)							
				11 2/41		 Lie	
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.	Sample Number		Client Info		CU0021804		
	Sample Date		Client Info		31 Jan 2024		
	Machine Age	hrs	Client Info		86		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		Changed		
	Filter Changed		Client Info		Changed		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185(m)	>90	2		
Metal levels are typical for a new component breaking in.	Chromium	ppm	ASTM D5185(m)	>20	0		
	Nickel	ppm	ASTM D5185(m)	>2	<1		
	Titanium	ppm	ASTM D5185(m)	>2	0		
	Silver	ppm	ASTM D5185(m)	>2	0		
	Aluminum	ppm	ASTM D5185(m)	>20	1		
	Lead	ppm	ASTM D5185(m)	>40	<1		
	Copper	ppm	ASTM D5185(m)	>330	11		
	Tin	ppm	ASTM D5185(m)	>15	<1		
	Vanadium	ppm	ASTM D5185(m)		0		
	White Metal	scalar	Visual*	NONE	NONE		
	Yellow Metal	scalar	Visual*	NONE	NONE		
CONTANUNATION			10TH DE (05)		_		
CONTAMINATION	Silicon	ppm	. ,	>25	5		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185(m)		8		
	Fuel		WC Method	>3.0	<1.0		
	Water	0/	WC Method	>0.2	NEG		
	Glycol	%	ASTM D7922*	0	0.0		
	Soot %	% Aba/am	ASTM D7844*		0		
	Nitration	Abs/cm	ASTM D7624*	>20	6.4		
	Sulfation Silt	Abs/.1mm	ASTM D7415*	>30	20.0 NONE		
	Debris	scalar	Visual* Visual*	NONE	NONE		
	Sand/Dirt	scalar scalar	Visual*	NONE	NONE		
			Visual*	NORML	NORML		
	Appearance Odor	scalar	Visual*	NORML	NORML		
	Emulsified Water		Visual*	>0.2	NEG		
	Emaioried Water						
FLUID CONDITION	Sodium	ppm	ASTM D5185(m)		3		
The condition of the cilia cocentable for the time in comice	Boron	ppm	ASTM D5185(m)		41		
The condition of the oil is acceptable for the time in service.	Barium	ppm	ASTM D5185(m)		0		
	Molybdenum	ppm	ASTM D5185(m)		45		
	Manganese	ppm	ASTM D5185(m)		0		
	Magnesium	ppm	ASTM D5185(m)		751		
	Calcium	ppm	ASTM D5185(m)		1191		
	Phosphorus	ppm	ASTM D5185(m)		721		
	Zinc	ppm	ASTM D5185(m)		800		
	Sulfur	ppm	ASTM D5185(m)		2048		
	Oxidation	Abs/.1mm	ASTM D7414*	>25	17.3		
	Visc @ 100°C	cSt	ASTM D7279(m)		14.0		



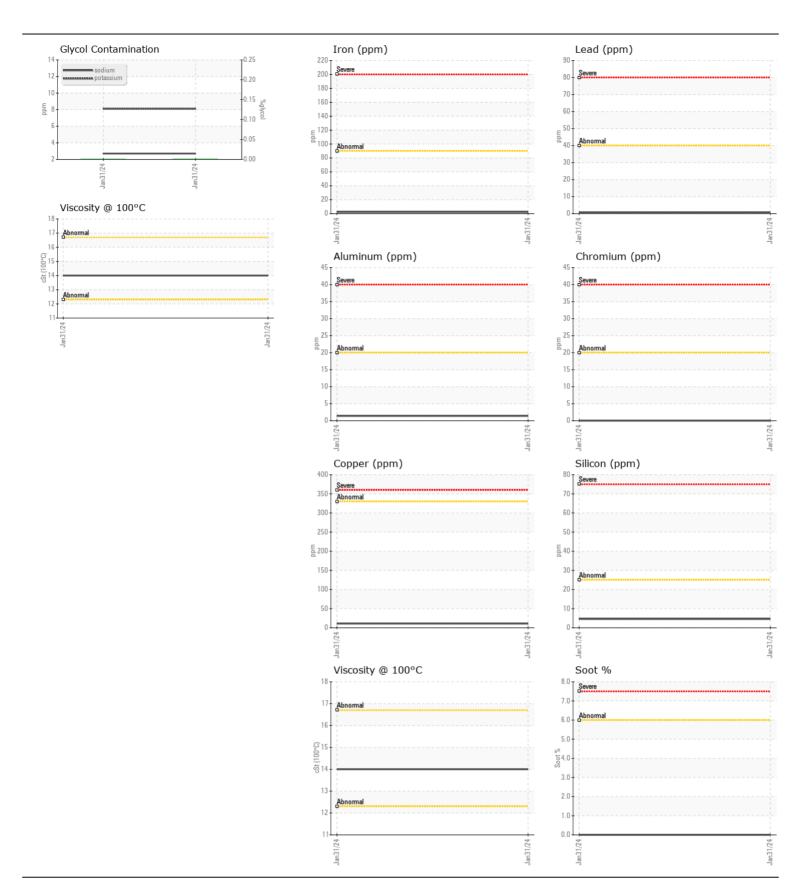

CALA ISO 17025:2017 Accredited

Laboratory

Laboratory Sample No.

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 CUMMINS CANADA ULC - GENERATOR DIVISION

: CU0021804 Lab Number : 02615885 Unique Number : 5732995

Received **Tested**

: 15 Feb 2024 Diagnosed Test Package: MOB 1 (Additional Tests: Glycol, Visual)

: 15 Feb 2024 - Wes Davis

: 15 Feb 2024

CA L5T 2A5 Contact: Elisia Johnson elisia.johnson@cummins.com T: (905)795-0050

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

7175 PACIFIC CIRCLE

MISSISSAUGA, ON

F: (905)795-9252