



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
SCHLEGEL VILLAGES [148517]
 Machine Id
79507490
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CU0021833	CU0014161	CU0013141
Sample Date		Client Info		09 Jan 2024	15 Aug 2018	09 Feb 2018
Machine Age	hrs	Client Info		130	51	0
Oil Age	hrs	Client Info		2	0	0
Filter Age	hrs	Client Info		2	0	0
Oil Changed		Client Info		Changed	Changed	N/A
Filter Changed		Client Info		Changed	Changed	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>90	2	1	2
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	<1	0	<1
Titanium	ppm	ASTM D5185(m)	>2	<1	0	<1
Silver	ppm	ASTM D5185(m)	>2	0	0	▲ 3
Aluminum	ppm	ASTM D5185(m)	>20	1	<1	2
Lead	ppm	ASTM D5185(m)	>40	0	0	<1
Copper	ppm	ASTM D5185(m)	>330	<1	0	1
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	<1
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	7	7	8
Potassium	ppm	ASTM D5185(m)	>20	<1	0	▲ 11
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	0.0	▲ 0.10
Soot %	%	ASTM D7844*	>6	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.4	6.1	7.5
Sulfation	Abs/.1mm	ASTM D7415*	>30	20.1	19.8	13.6
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	▲ .5%

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	3	0	▲ 62
Boron	ppm	ASTM D5185(m)	250	43	69	308
Barium	ppm	ASTM D5185(m)	10	0	0	1
Molybdenum	ppm	ASTM D5185(m)	100	46	43	106
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)	450	778	578	465
Calcium	ppm	ASTM D5185(m)	3000	1215	1415	1282
Phosphorus	ppm	ASTM D5185(m)	1150	722	922	707
Zinc	ppm	ASTM D5185(m)	1350	808	1125	880
Sulfur	ppm	ASTM D5185(m)	4250	2061	2564	2282
Oxidation	Abs/.1mm	ASTM D7414*	>25	16.5	15.5	13.6
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.0	14.9	14.3

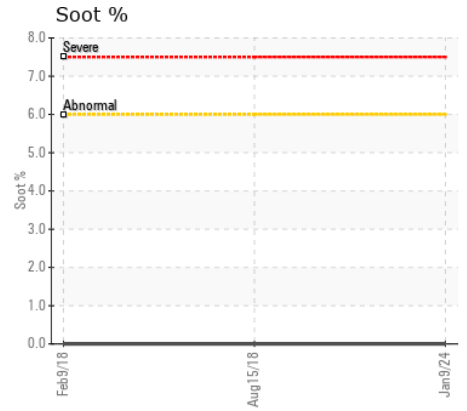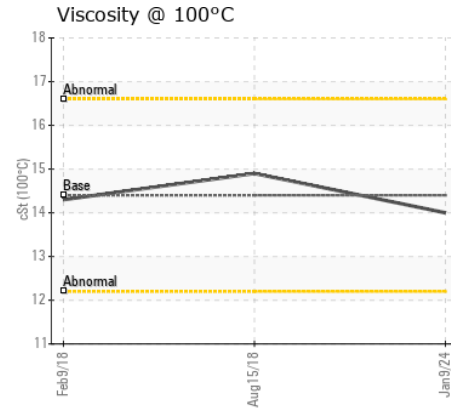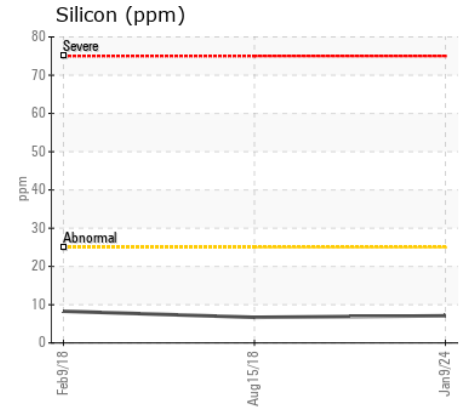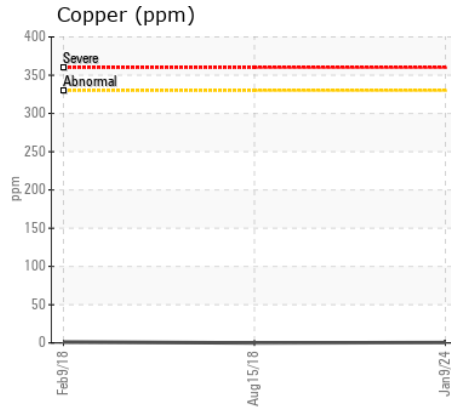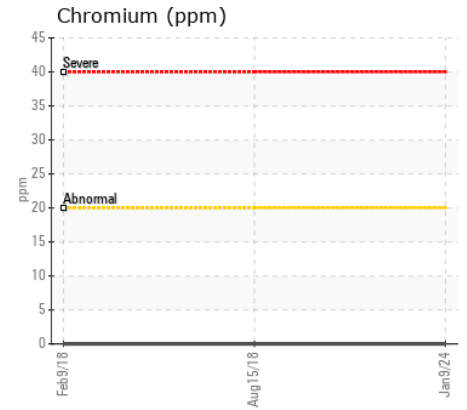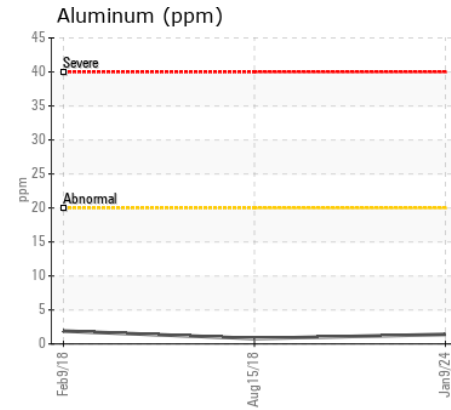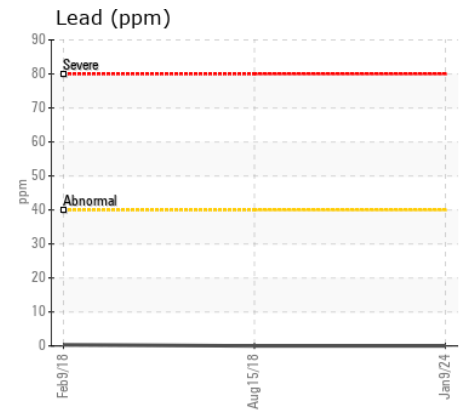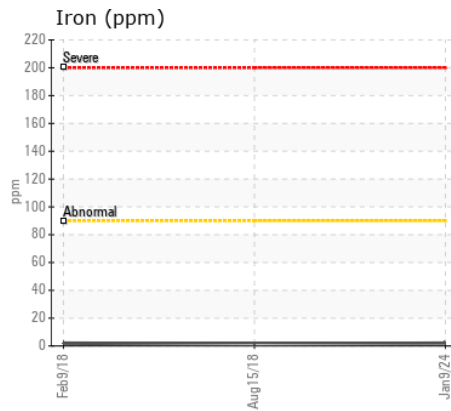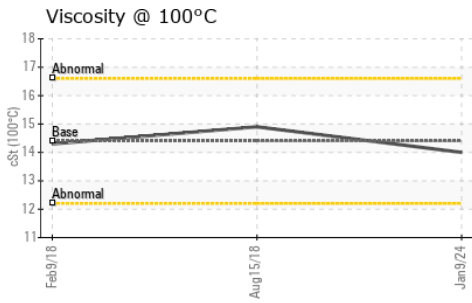

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0021833 **Received** : 15 Feb 2024
Lab Number : 02615886 **Tested** : 15 Feb 2024
Unique Number : 5732996 **Diagnosed** : 15 Feb 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

CUMMINS CANADA ULC - GENERATOR DIVISION
 7175 PACIFIC CIRCLE
 MISSISSAUGA, ON
 CA L5T 2A5
 Contact: Elisia Johnson
 elisia.johnson@cummins.com
 T: (905)795-0050
 F: (905)795-9252

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.