



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
299 WALKER DRIVE BRAMPTON, UNIT #2 BELL CANADA EST01251

Component
Right Diesel Engine

Fluid
ESSO XD-3 EXTRA 15W40 (70 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005689	PN0003330	PN0298755
Sample Date		Client Info		14 Feb 2024	24 Mar 2022	16 Jul 2018
Machine Age	hrs	Client Info		289	247	170
Oil Age	hrs	Client Info		10	0	14
Filter Age	hrs	Client Info		10	0	14
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	1	1	2
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	0	<1	0
Titanium	ppm	ASTM D5185(m)	>2	0	0	0
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>25	2	3	<1
Lead	ppm	ASTM D5185(m)	>40	<1	0	<1
Copper	ppm	ASTM D5185(m)	>330	<1	1	<1
Tin	ppm	ASTM D5185(m)	>15	0	<1	0
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	3	7	6
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.2	3.8	4.9
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.8	14.2	21.7
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	1	2	3
Boron	ppm	ASTM D5185(m)		23	76	56
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		61	86	38
Manganese	ppm	ASTM D5185(m)		0	0	<1
Magnesium	ppm	ASTM D5185(m)		702	92	477
Calcium	ppm	ASTM D5185(m)	3780	1340	2108	1576
Phosphorus	ppm	ASTM D5185(m)	1370	1028	1087	793
Zinc	ppm	ASTM D5185(m)	1500	1136	1163	859
Sulfur	ppm	ASTM D5185(m)	3800	2942	3232	2212
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.2	6.7	18.4
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.8	13.3	12.8

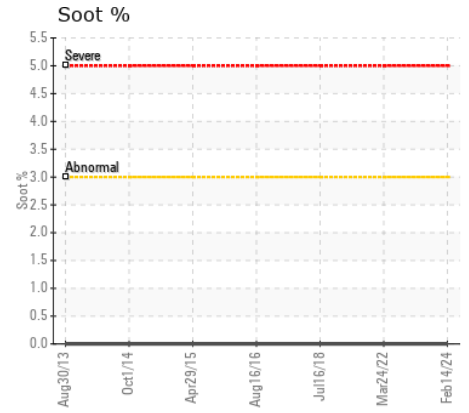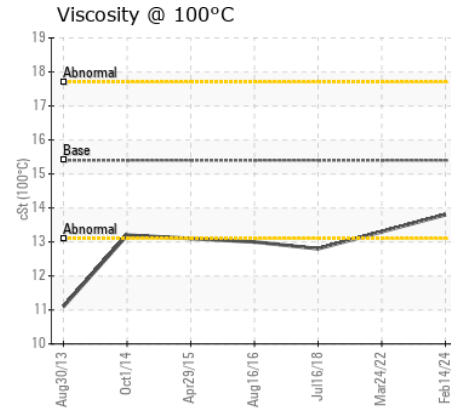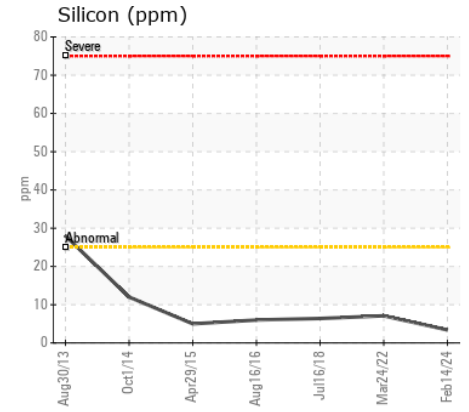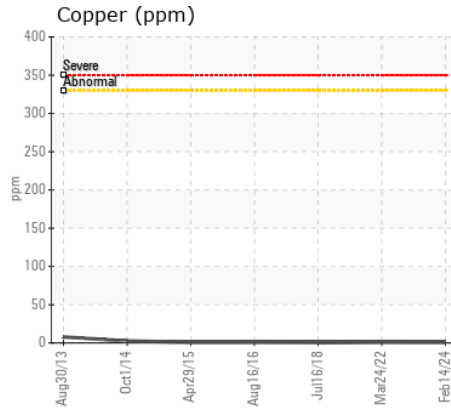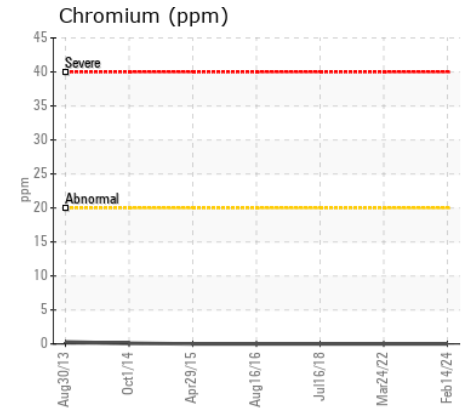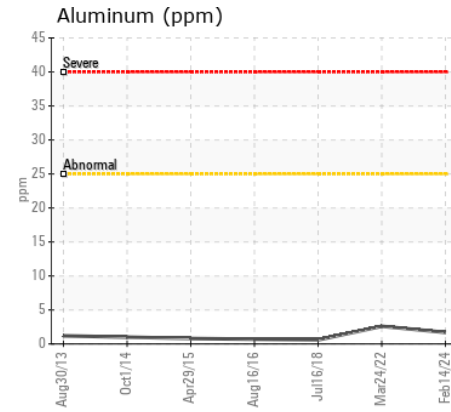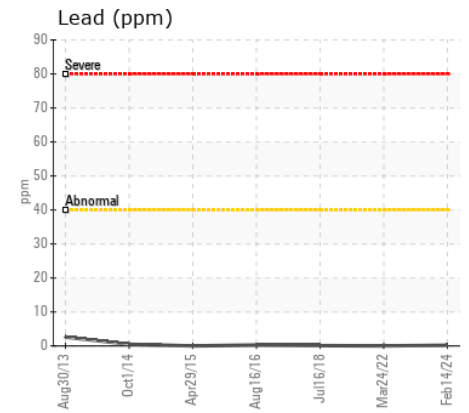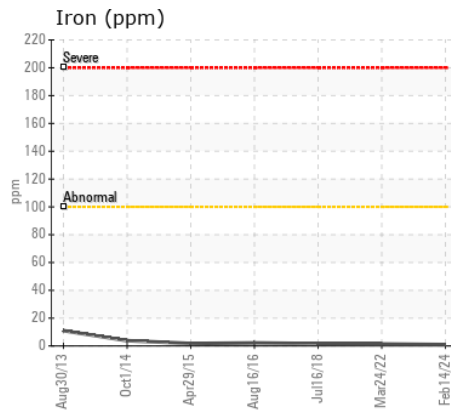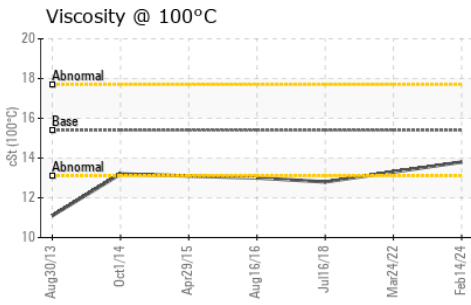

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005689 **Received** : 15 Feb 2024
Lab Number : 02615904 **Tested** : 15 Feb 2024
Unique Number : 5733014 **Diagnosed** : 15 Feb 2024 - Kevin Marson
Test Package : MOB 1

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Ryan Udall
 rudall@pwrstn.com
 T: (905)565-1621
 F: (905)629-1499

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.