



Machine Id
562 RUNNYMEDE TORONTO, 441205 BELL CANADA 16VA17722

Component
Right Diesel Engine

Fluid
ESSO XD-3 EXTRA SAE 40 (65 LTR)

RECOMMENDATION

We advise that you check the fuel injection system. The oil change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005774	PN0004077	PN0002630
Sample Date		Client Info		13 Feb 2024	23 Sep 2022	27 Jul 2021
Machine Age	hrs	Client Info		176	157	124
Oil Age	hrs	Client Info		19	0	0
Filter Age	hrs	Client Info		19	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				SEVERE	ABNORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>200	3	4	3
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	>2	0	0	0
Silver	ppm	ASTM D5185(m)	>2	<1	0	<1
Aluminum	ppm	ASTM D5185(m)	>30	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>30	<1	1	<1
Copper	ppm	ASTM D5185(m)	>30	2	1	1
Tin	ppm	ASTM D5185(m)	>15	<1	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION











There is a high amount of fuel present in the oil. Tests confirm the presence of fuel in the oil.

Silicon	ppm	ASTM D5185(m)	>30	4	3	3
Potassium	ppm	ASTM D5185(m)	>20	2	3	3
Fuel	%	ASTM D7593*	>3.0	7.7	4.3	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	3.4	4.0	3.9
Sulfation	Abs/.1mm	ASTM D7415*	>30	13.6	14.5	13.9
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

Sodium	ppm	ASTM D5185(m)		2	4	6
Boron	ppm	ASTM D5185(m)		4	11	17
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		3	10	14
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)		615	23	33
Calcium	ppm	ASTM D5185(m)	2550	1659	3408	3007
Phosphorus	ppm	ASTM D5185(m)	1000	915	707	773
Zinc	ppm	ASTM D5185(m)	1120	1001	713	819
Sulfur	ppm	ASTM D5185(m)		2679	2894	2313
Oxidation	Abs/.1mm	ASTM D7414*	>25	7.1	6.3	5.9
Visc @ 100°C	cSt	ASTM D7279(m)	14.3	10.9	11.3	11.7

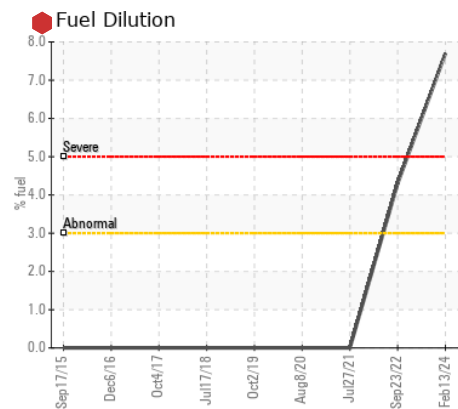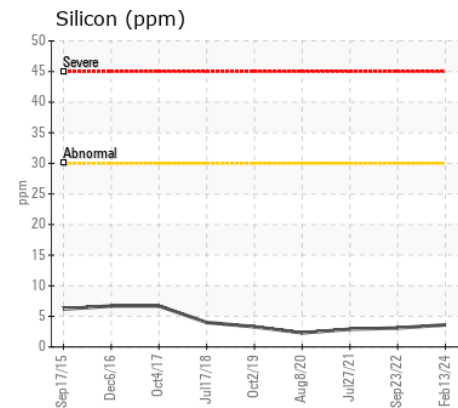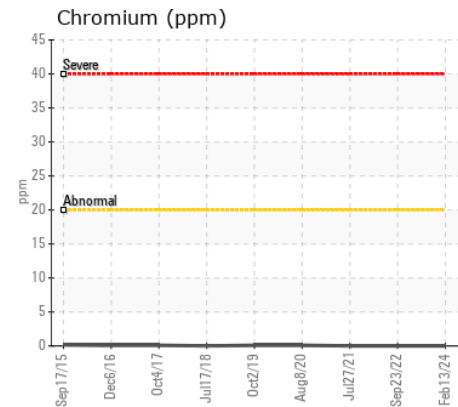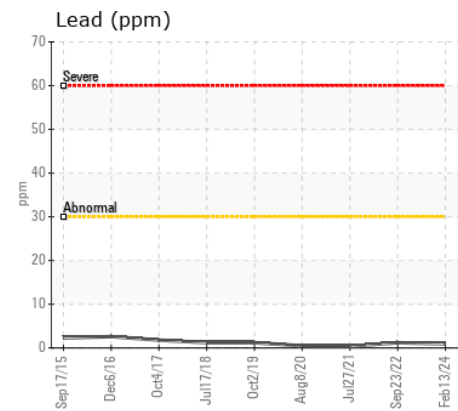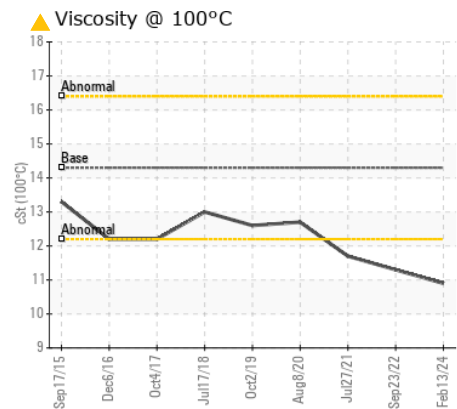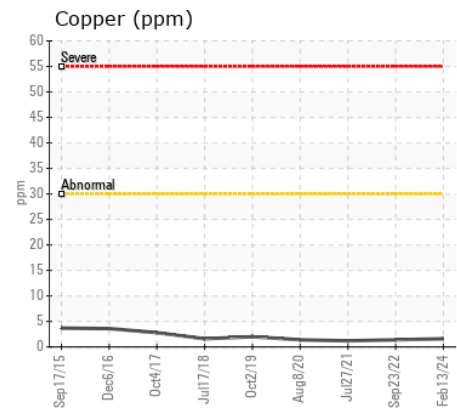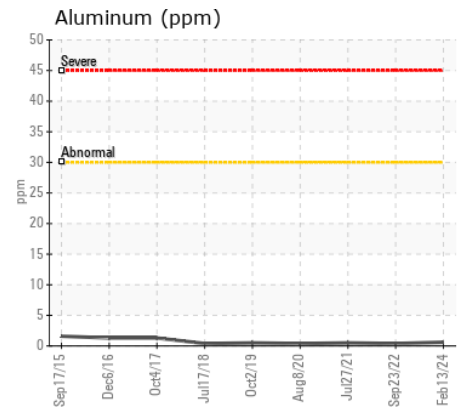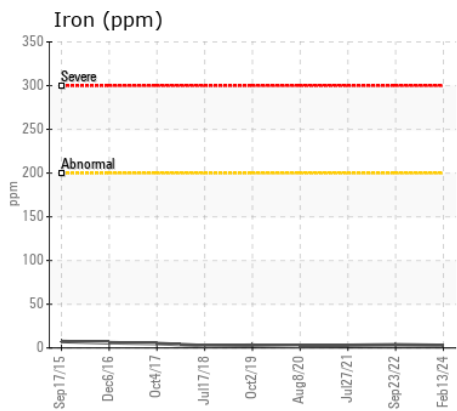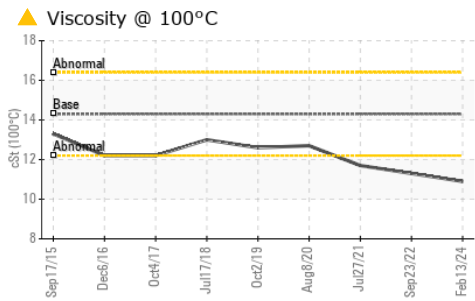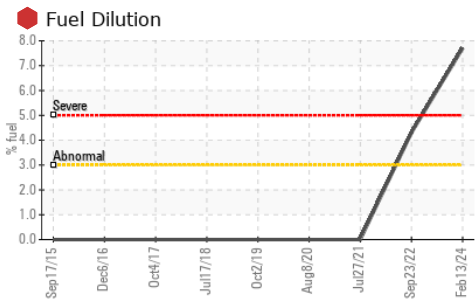

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005774 **Received** : 15 Feb 2024
Lab Number : 02615914 **Tested** : 16 Feb 2024
Unique Number : 5733024 **Diagnosed** : 16 Feb 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: PercentFuel)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)665-8544