



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
BELL CANADA BELL CANADA
 Component
Rear Diesel Engine
 Fluid
ESSO XD-3 EXTRA 15W40 (10 LTR)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005842	---	---
Sample Date		Client Info		14 Feb 2024	---	---
Machine Age	hrs	Client Info		53	---	---
Oil Age	hrs	Client Info		30	---	---
Filter Age	hrs	Client Info		30	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	7	---	---
Chromium	ppm	ASTM D5185(m)	>20	<1	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	2	---	---
Lead	ppm	ASTM D5185(m)	>40	1	---	---
Copper	ppm	ASTM D5185(m)	>330	6	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION


The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	15	---	---
Potassium	ppm	ASTM D5185(m)	>20	2	---	---
Fuel		WC Method	>5	<1.0	---	---
Water	%	ASTM D6304*	>0.2	0.052	---	---
ppm Water	ppm	ASTM D6304*	>2000	522	---	---
Glycol	%	ASTM D7922*		0.0	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	7.4	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.2	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	.5%	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	4	---	---
Boron	ppm	ASTM D5185(m)		40	---	---
Barium	ppm	ASTM D5185(m)		4	---	---
Molybdenum	ppm	ASTM D5185(m)		48	---	---
Manganese	ppm	ASTM D5185(m)		2	---	---
Magnesium	ppm	ASTM D5185(m)		831	---	---
Calcium	ppm	ASTM D5185(m)	3780	1059	---	---
Phosphorus	ppm	ASTM D5185(m)	1370	773	---	---
Zinc	ppm	ASTM D5185(m)	1500	836	---	---
Sulfur	ppm	ASTM D5185(m)	3800	2494	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	16.9	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.1	---	---

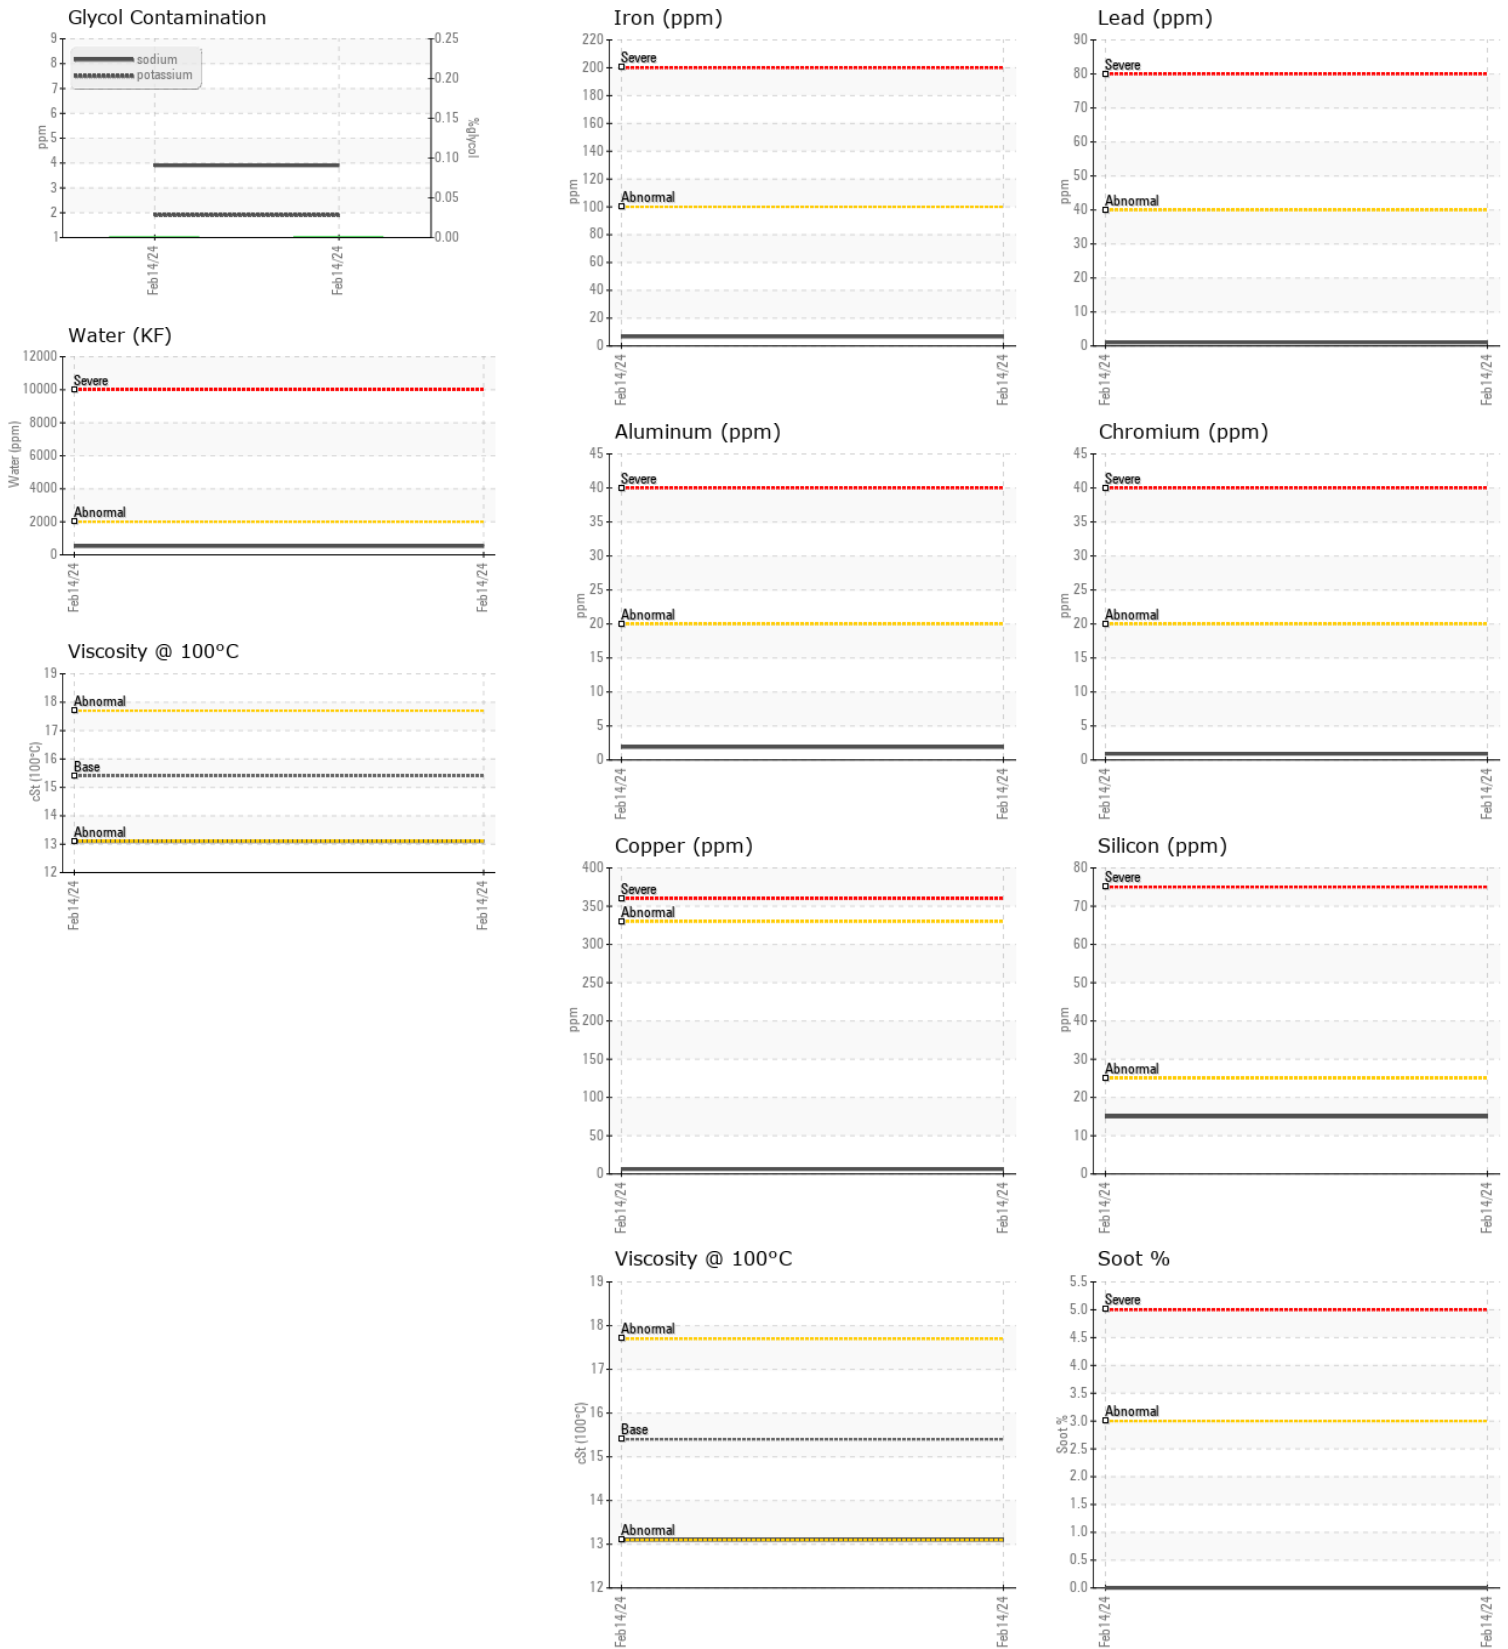

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005842
Lab Number : 02616837
Unique Number : 5733947
Test Package : MOB 1 (Additional Tests: Glycol, KF, Visual)

Received : 21 Feb 2024
Tested : 22 Feb 2024
Diagnosed : 22 Feb 2024 - Wes Davis

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544