

CONTAMINATION
FLUID CONDITION

NORMAL

NORMAL

NORMAL

**WEAR** 

[332408]

### 

# Diesel Engine

## DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION							
	-						

Resample at the next service interval to monitor.

WEAR
------

All component wear rates are normal.

### CONTAMINATION


There is no indication of any contamination in the oil.


#### FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CU0023045		
Sample Date		Client Info		16 Feb 2024		
Machine Age	hrs	Client Info		2982		
Oil Age	hrs	Client Info		0		
Filter Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Filter Changed		Client Info		Changed		
Sample Status				NORMAL		
				40		
Iron	ppm	ASTM D5185(m)	>90	18		
Chromium	ppm	ASTM D5185(m)	>20	<1		
Nickel	ppm	ASTM D5185(m)	>2	<1		
Titanium	ppm	ASTM D5185(m)	>2	0		
Silver	ppm	ASTM D5185(m)	>2	0		
Aluminum	ppm	ASTM D5185(m)	>20	2		
Lead	ppm	ASTM D5185(m)	>40	1		
Copper	ppm	ASTM D5185(m)	>330	2		
Tin	ppm	ASTM D5185(m)	>15	0		
Vanadium	ppm	ASTM D5185(m)		0		
Silicon	ppm	ASTM D5185(m)	>25	5		
Potassium	ppm	ASTM D5185(m)	>20	2		
Fuel		WC Method	>3.0	<1.0		
Water		WC Method	>0.2	NEG		
Glycol		WC Method		NEG		
Soot %	%	ASTM D7844*	>6	0.3		
Nitration	Abs/cm	ASTM D7624*	>20	10.7		
Sulfation	Abs/.1mm	ASTM D7415*	>30	22.4		
Emulsified Water	scalar	Visual*	>0.2	NEG		
Sodium	ppm	ASTM D5185(m)	>158	4		
Boron	ppm	ASTM D5185(m)	250	35		
Barium	ppm	ASTM D5185(m)	10	0		
Molybdenum	ppm	ASTM D5185(m)	100	54		
Manganese	ppm	ASTM D5185(m)		0		
Magnesium	ppm	ASTM D5185(m)	450	899		
Calcium	ppm	ASTM D5185(m)	3000	1094		
Phosphorus	ppm	ASTM D5185(m)	1150	830		
Zinc	ppm	ASTM D5185(m)	1350	956		
Sulfur	ppm	ASTM D5185(m)	4250	2282		
Oxidation	Abs/.1mm	ASTM D7414*	>25	22.7		
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.3		

Contact/Location: Jean Verret - DIESTE



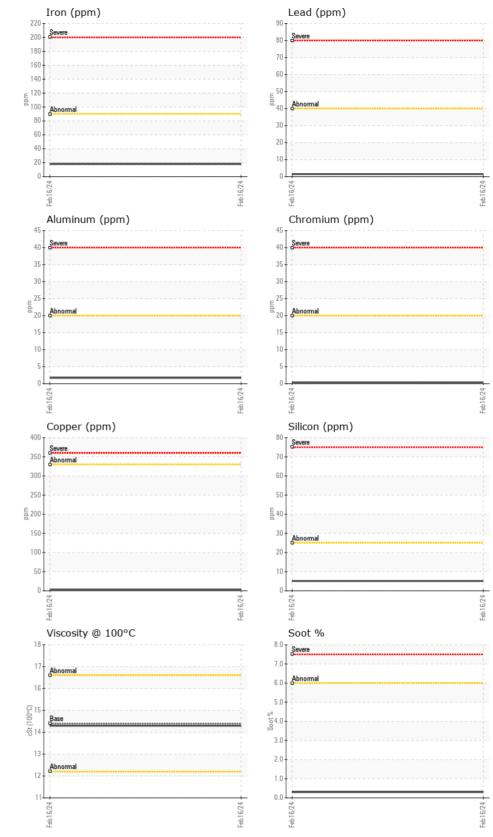

**CUMMINS DIESEL** Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 CALA Sample No. Received : 21 Feb 2024 2400 AV WATT : CU0023045 Lab Number : 02616909 Tested : 21 Feb 2024 Quebec City, QC ISO 17025:2017 Diagnosed Accredited Unique Number : 5734019 : 21 Feb 2024 - Wes Davis CA G1P 3T3 Laboratory Test Package : MOB 1 Contact: Jean Verret To discuss this sample report, contact Customer Service at 1-800-268-2131. verret.jean@cummins.com T: (418)651-2911 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

Contact/Location: Jean Verret - DIESTE

Page 2 of 2