



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[84422]
 Machine Id
105 SCARSDALE RD TORONTO, UNIT 1 BELL CANADA 5272011231

Component
Left Diesel Engine
 Fluid
ESSO XD-3 EXTRA 15W40 (320 LTR)

RECOMMENDATION

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MOB 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. this testkit includes BN to determine the suitability of the oil for continued use.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005676	PN0002014	PN0000783
Sample Date		Client Info		14 Feb 2024	08 Dec 2020	17 Dec 2019
Machine Age	hrs	Client Info		855	0	525
Oil Age	hrs	Client Info		88	61	0
Filter Age	hrs	Client Info		88	61	0
Oil Changed		Client Info		Changed	Not Changd	Not Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in. Component wear rates appear to be normal (unconfirmed).

Iron	ppm	ASTM D5185(m)	>100	3	5	4
Chromium	ppm	ASTM D5185(m)	>20	0	<1	<1
Nickel	ppm	ASTM D5185(m)	>4	0	0	0
Titanium	ppm	ASTM D5185(m)		0	<1	<1
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	2	2	1
Lead	ppm	ASTM D5185(m)	>40	<1	<1	<1
Copper	ppm	ASTM D5185(m)	>330	1	2	2
Tin	ppm	ASTM D5185(m)	>15	0	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	VLITE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	5	4
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	9.1	6.9	7.1
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.8	22.6	25.8
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	VLITE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service (unconfirmed).

Sodium	ppm	ASTM D5185(m)	>192	1	3	2
Boron	ppm	ASTM D5185(m)		51	50	52
Barium	ppm	ASTM D5185(m)		0	0	<1
Molybdenum	ppm	ASTM D5185(m)		43	40	41
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)		155	512	508
Calcium	ppm	ASTM D5185(m)	3780	2168	1827	1832
Phosphorus	ppm	ASTM D5185(m)	1370	1087	787	798
Zinc	ppm	ASTM D5185(m)	1500	1198	954	948
Sulfur	ppm	ASTM D5185(m)	3800	3446	2314	2275
Oxidation	Abs/.1mm	ASTM D7414*	>25	15.4	21.5	20.8
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	14.4	13.1	13.4

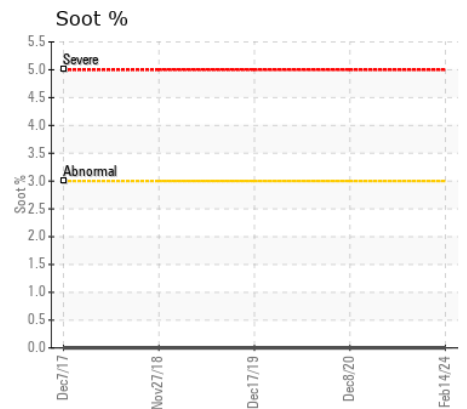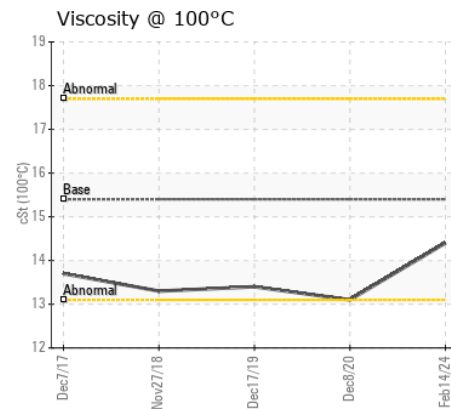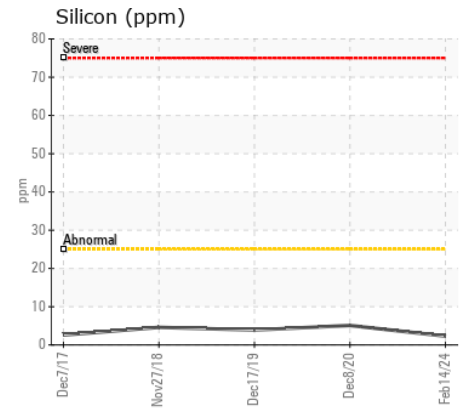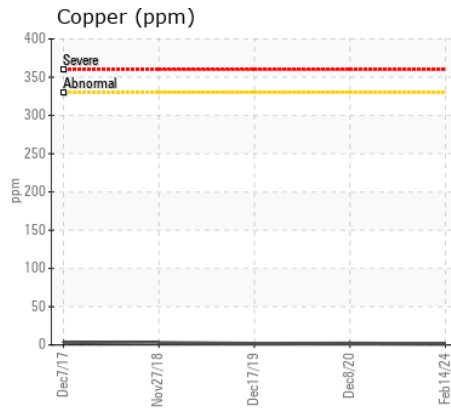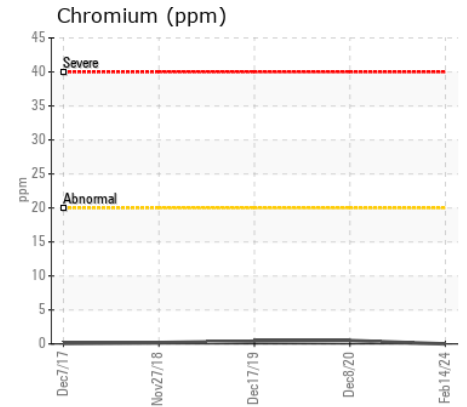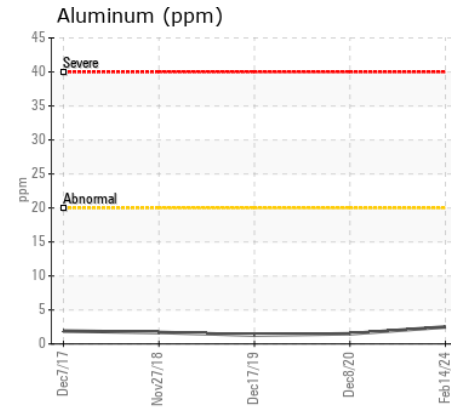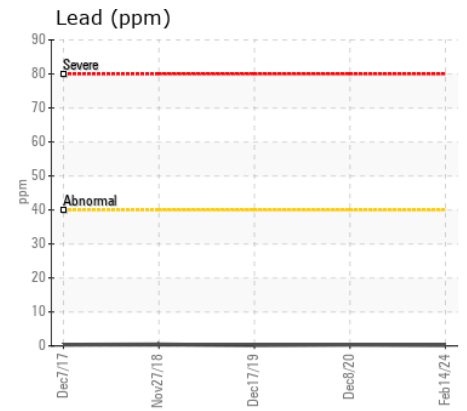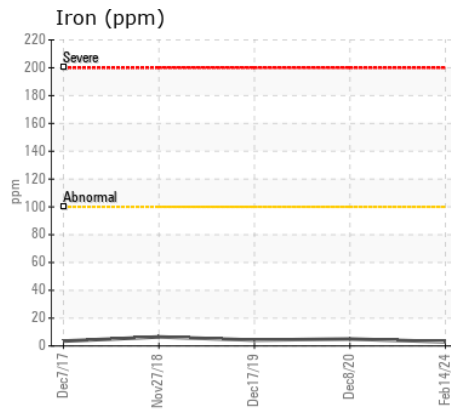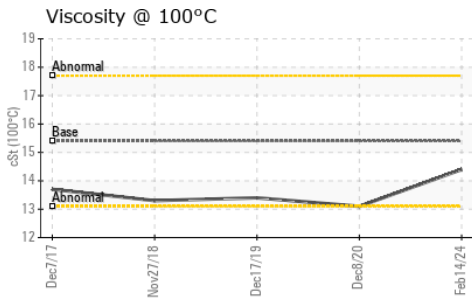

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005676 **Received** : 21 Feb 2024
Lab Number : 02616983 **Tested** : 22 Feb 2024
Unique Number : 5734093 **Diagnosed** : 22 Feb 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)665-8544