
WEAR CONTAMINATION **FLUID CONDITION** **NORMAL NORMAL NORMAL**

HUSSMAN PS2-040-095 RACK A

Component Reciprocating Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number	OOW	Client Info	LITTIONOTI	WC		
Resample at the next service interval to monitor. Please note that there was insufficient sample submitted to perform all assigned tests.	Sample Date		Client Info		12 Feb 2024		
	Machine Age	yrs	Client Info		25		
	Oil Age	yrs	Client Info		25		
	Filter Age	yrs	Client Info		1		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
/CAD			40714854054				
WEAR	Iron	ppm	ASTM D5185(m)		2		
All component wear rates are normal.	Chromium	ppm	ASTM D5185(m)	>10	0		
	Nickel	ppm	ASTM D5185(m)		0		
	Titanium Silver	ppm	ASTM D5185(m)		0		
	Aluminum	ppm	ASTM D5185(m) ASTM D5185(m)	>25	0 <1		
	Lead	ppm	ASTM D5185(m)	>25	<1 <1		
	Copper	ppm	ASTM D5185(m)		<1		
	Tin	ppm	ASTM D5185(m)	>15	0		
	Vanadium	ppm	ASTM D5185(m)	710	0		
	White Metal	scalar	Visual*	NONE	NONE		
	Yellow Metal	scalar	Visual*	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185(m)	>25	<1		
Insufficient sample was received to conduct all the routine laboratory tests.	Potassium	ppm	ASTM D5185(m)	>20	1		
	Water	%	ASTM D6304*	>0.1	0.041		
	ppm Water	ppm	ASTM D6304*	>1000	412		
	Silt	scalar	Visual*	NONE	NONE		
	Debris	scalar	Visual*	NONE	NONE		
	Sand/Dirt	scalar	Visual*	NONE	NONE		
	Appearance	scalar	Visual*	NORML	NORML		
	Odor	scalar	Visual*	NORML	NORML		
LUID CONDITION	Sodium	ppm	ASTM D5185(m)		0		
The condition of the oil is acceptable for the time in service (unconfirmed).	Boron	ppm	ASTM D5185(m)	0	<1		
	Barium	ppm	ASTM D5185(m)	0	0		
	Molybdenum	ppm	ASTM D5185(m)	0	0		
	Manganese	ppm	ASTM D5185(m)		0		
	Magnesium	ppm	ASTM D5185(m)	0	0		
	Calcium	ppm	ASTM D5185(m)	0	<1		
	Phosphorus	ppm	ASTM D5185(m)	5	<1		
	Zinc	ppm	ASTM D5185(m)	10	<1		



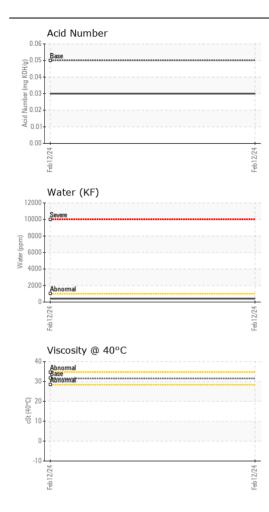

CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No.

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 : WC Lab Number : 02617282

Unique Number : 5734392

Received **Tested** Diagnosed : 21 Feb 2024

: 27 Feb 2024

: 27 Feb 2024 - Kevin Marson

Test Package : TEST (Additional Tests: ICP, KF, KV40, TAN Man)

mike.squires@neelands.com T: (905)975-0794 F: (905)334-7090

Neelands Group Limited

4131 Palladium Way

Contact: Mike Squires

Burlington, ON

CA L7M 0V9

To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.