WEAR CONTAMINATION **FLUID CONDITION**


NORMAL NORMAL NORMAL

[001337-1]

410000010949 RACK C

Component Reciprocating Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor. Please note that there was insufficient sample submitted to perform all assigned test.	Sample Number		Client Info		WC0907732		
	Sample Date		Client Info		13 Feb 2024		
	Machine Age	yrs	Client Info		10		
	Oil Age	yrs	Client Info		10		
	Filter Age	yrs	Client Info		1		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
WEAR	la a		AOTM DE40E()				
WEAR	Iron	ppm	ASTM D5185(m)		3		
All component wear rates are normal.	Chromium Nickel	ppm	ASTM D5185(m)	>10	0		
		ppm	ASTM D5185(m) ASTM D5185(m)		<1 0		
	Titanium Silver	ppm	ASTM D5185(III) ASTM D5185(m)		0		
	Aluminum	ppm	ASTM D5185(m)	>25	<1		
	Lead	ppm	ASTM D5185(m)		<1		
	Copper	ppm	ASTM D5185(m)		3		
	Tin	ppm	ASTM D5185(m)		0		
	Vanadium	ppm	ASTM D5185(m)		0		
	White Metal	scalar	Visual*	NONE	NONE		
	Yellow Metal	scalar	Visual*	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185(m)		2		
Insufficient sample was received to conduct all the routine laboratory tests.	Potassium	ppm	, ,	>20	1		
	Water	%	ASTM D6304*	>0.1	0.054		
	ppm Water	ppm	ASTM D6304*	>1000	547 NONE		
	Silt	scalar	Visual*	NONE	NONE		
	Debris Sand/Dirt	scalar	Visual*	NONE	NONE		
	Appearance	scalar	Visual* Visual*	NONE	NONE NORML		
	Odor		Visual*	NORML	NORML		
			· · · · · · · · · · · · · · · · · · ·				
FLUID CONDITION	Sodium	ppm	ASTM D5185(m)		0		
The condition of the oil is acceptable for the time in service (unconfirmed).	Boron	ppm	ASTM D5185(m)		<1		
	Barium	ppm	ASTM D5185(m)		0		
	Molybdenum	ppm	ASTM D5185(m)		0		
	Manganese	ppm	ASTM D5185(m)		0		
	Magnesium	ppm	ASTM D5185(m)		<1		
	Calcium	ppm	ASTM D5185(m)		0		
	Phosphorus	ppm	ASTM D5185(m)		0		
	Zinc	ppm	ASTM D5185(m)		3		
	Sulfur		ASTM D5185(m)		0		

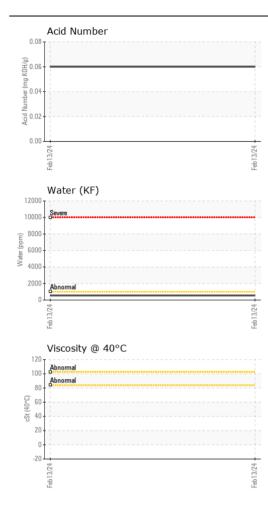



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No.

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 : WC0907732 Lab Number : 02617290

Unique Number : 5734400 Test Package : TEST (Additional Tests: ICP, KF, KV40, TAN Man)

Received **Tested** Diagnosed

: 21 Feb 2024 : 27 Feb 2024

: 27 Feb 2024 - Kevin Marson

Contact: Mike Squires

mike.squires@neelands.com T: (905)975-0794 F: (905)334-7090

Neelands Group Limited

4131 Palladium Way

Burlington, ON

CA L7M 0V9

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Validity of results and interpretation are based on the sample and information as supplied.