



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[001315-1]
 Machine Id
COSTCO #1169 MISSISSAUGA RACK "A" HILL PHOENIX RACK MOPDEL #69454 (S/N 410000033074)
 Component
Reciprocating Compressor
 Fluid
EMKARATE RL 32H (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please note that there was insufficient sample submitted to perform all assigned tests.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0907693	WC0672580	WC0556252
Sample Date		Client Info		09 Feb 2024	22 Feb 2022	28 Feb 2021
Machine Age	yrs	Client Info		10	7	10
Oil Age	yrs	Client Info		10	7	10
Filter Age	yrs	Client Info		1	1	1
Oil Changed		Client Info		N/A	N/A	Changed
Filter Changed		Client Info		N/A	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>50	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)		0	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>25	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>25	<1	<1	0
Copper	ppm	ASTM D5185(m)	>50	4	3	2
Tin	ppm	ASTM D5185(m)	>15	0	<1	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE

CONTAMINATION




Insufficient sample was received to conduct all the routine laboratory tests.

Silicon	ppm	ASTM D5185(m)	>25	1	2	2
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Water	%	ASTM D6304*	>0.1	0.047	---	---
ppm Water	ppm	ASTM D6304*	>1000	478	---	---
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	FREON	NORML

FLUID CONDITION

The condition of the oil is acceptable for the time in service (unconfirmed).

Sodium	ppm	ASTM D5185(m)		0	0	0
Boron	ppm	ASTM D5185(m)	0	<1	<1	<1
Barium	ppm	ASTM D5185(m)	0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	0	<1
Calcium	ppm	ASTM D5185(m)	0	0	0	0
Phosphorus	ppm	ASTM D5185(m)	5	0	<1	<1
Zinc	ppm	ASTM D5185(m)	10	<1	<1	<1
Sulfur	ppm	ASTM D5185(m)	50	0	<1	8
Acid Number (AN)	mg KOH/g	ASTM D974*	.05	0.04	0.01	0.04
Visc @ 40°C	cSt	ASTM D7279(m)	31.5	---	29.6	28.4

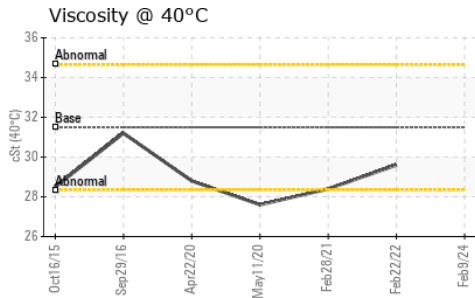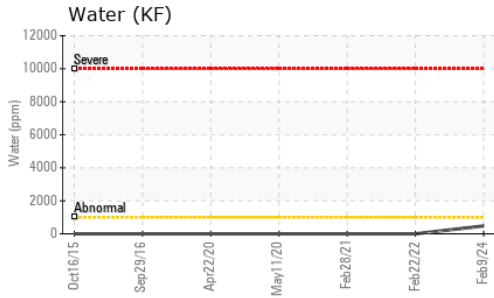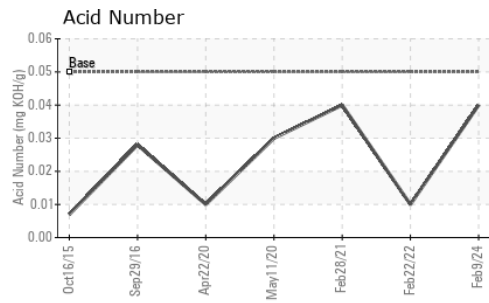

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0907693 **Received** : 21 Feb 2024
Lab Number : 02617293 **Tested** : 27 Feb 2024
Unique Number : 5734403 **Diagnosed** : 27 Feb 2024 - Kevin Marson
Test Package : TEST (Additional Tests: ICP, KF, KV40, TAN Man)

Neelands Group Limited
 4131 Palladium Way
 Burlington, ON
 CA L7M 0V9
 Contact: Mike Squires
 mike.squires@neelands.com
 T: (905)975-0794
 F: (905)334-7090

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.