



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ABNORMAL

Area
[6186686]
 Machine Id
5005-PR05-TAB01
 Component
Gearbox
 Fluid
DAVLEY DARMEX RPL-NT0140 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

WEAR

All component wear rates are normal.









CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

Viscosity of sample indicates oil is within ISO 220 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CB0031641	CB0031201	CB
Sample Date		Client Info		27 Jan 2024	14 Jan 2023	07 Jan 2022
Machine Age	hrs	Client Info		45490	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	N/A	N/A
Filter Changed		Client Info		Not Changd	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>200	2	1	1
Chromium	ppm	ASTM D5185(m)	>15	0	0	0
Nickel	ppm	ASTM D5185(m)	>15	<1	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	<1
Aluminum	ppm	ASTM D5185(m)	>25	<1	0	0
Lead	ppm	ASTM D5185(m)	>100	0	0	0
Copper	ppm	ASTM D5185(m)	>200	1	<1	<1
Tin	ppm	ASTM D5185(m)	>25	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185(m)	>50	1	3	2
Potassium	ppm	ASTM D5185(m)	>20	<1	0	<1
Water		WC Method	>0.2	NEG	NEG	NEG
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Sodium	ppm	ASTM D5185(m)		0	0	0
Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		0	0	0
Calcium	ppm	ASTM D5185(m)		<1	0	<1
Phosphorus	ppm	ASTM D5185(m)		143	153	160
Zinc	ppm	ASTM D5185(m)		12	13	14
Sulfur	ppm	ASTM D5185(m)		573	279	170
Acid Number (AN)	mg KOH/g	ASTM D974*		0.47	0.45	0.49
Visc @ 40°C	cSt	ASTM D7279(m)	441	▲ 244	▲ 208	▲ 273

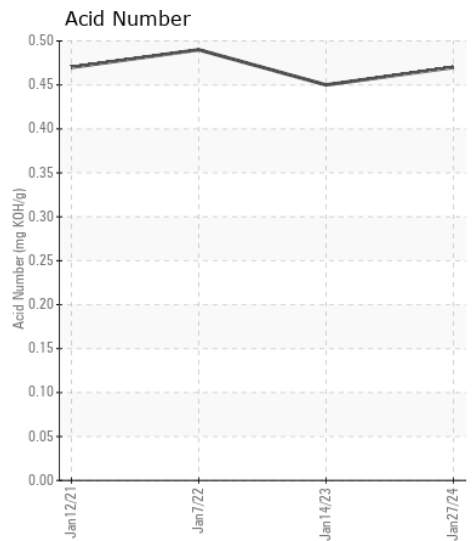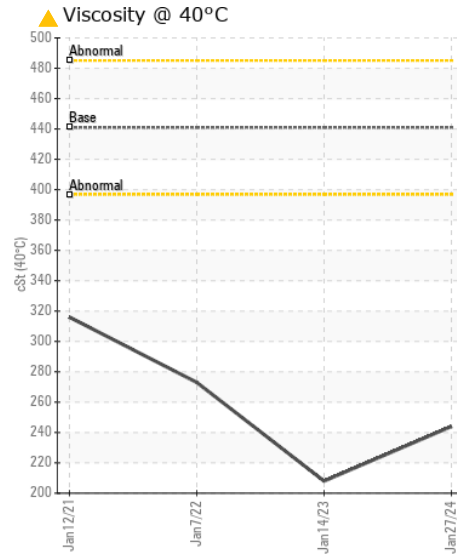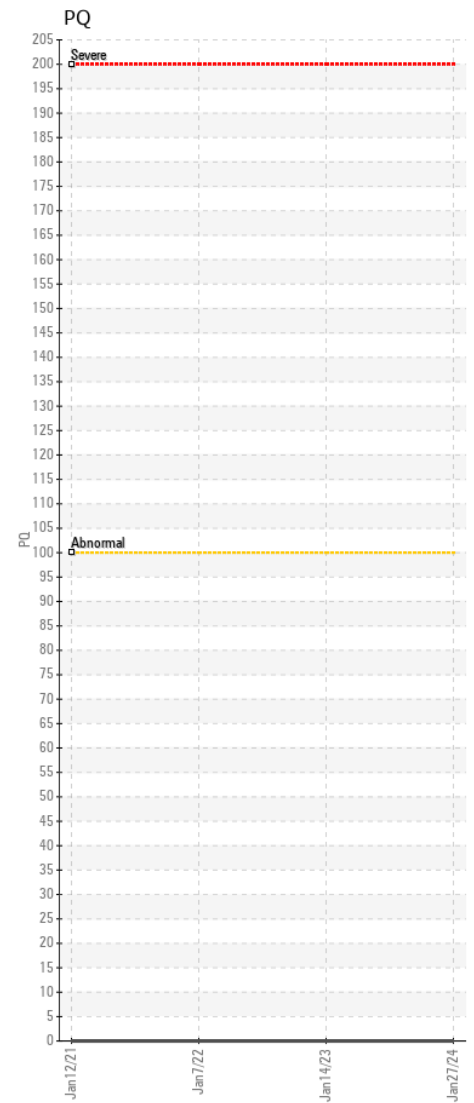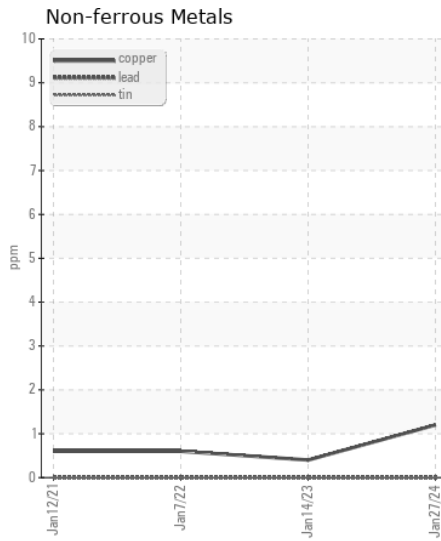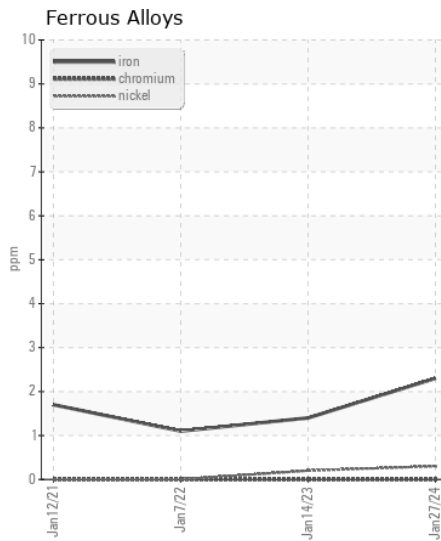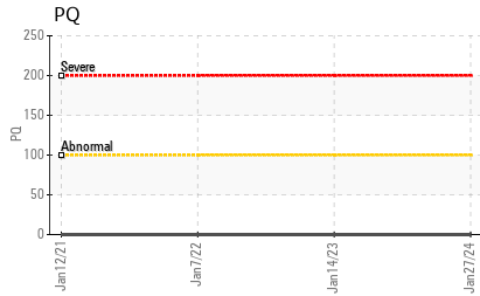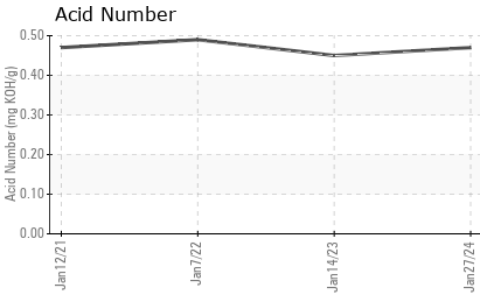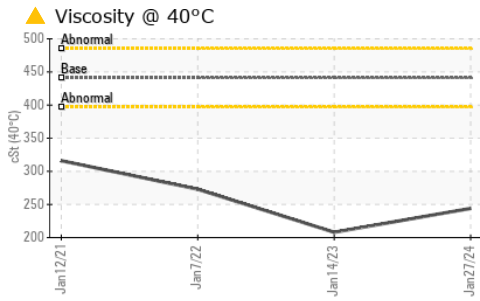

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CB0031641 **Received** : 26 Feb 2024
Lab Number : 02618141 **Tested** : 29 Feb 2024
Unique Number : 5735251 **Diagnosed** : 29 Feb 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

Synovos/Apotex
 50 Steinway Blvd.
 Etobicoke, ON
 CA M9W 6Y3
 Contact: Emmanuel Okelue
 eokelue@apotex.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.