



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[6202562]
 Machine Id
5005-PR01-PRC01-LIFT01
 Component
Gearbox
 Fluid
PETRO CANADA ENDURATEX EP 220 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CB0031533	CB0031213	CB
Sample Date		Client Info		08 Feb 2024	20 Dec 2022	29 Dec 2021
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>200	3	1	1
Chromium	ppm	ASTM D5185(m)	>15	0	0	0
Nickel	ppm	ASTM D5185(m)	>15	<1	0	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	<1
Aluminum	ppm	ASTM D5185(m)	>25	<1	0	<1
Lead	ppm	ASTM D5185(m)	>100	0	0	0
Copper	ppm	ASTM D5185(m)	>200	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>25	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE

CONTAMINATION









There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>50	4	1	1
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Water		WC Method	>0.2	NEG	NEG	NEG
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)		<1	<1	<1
Boron	ppm	ASTM D5185(m)	60	60	7	9
Barium	ppm	ASTM D5185(m)	0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	<1	0
Magnesium	ppm	ASTM D5185(m)	0	<1	<1	<1
Calcium	ppm	ASTM D5185(m)	0	1	1	3
Phosphorus	ppm	ASTM D5185(m)	270	245	388	368
Zinc	ppm	ASTM D5185(m)	0	3	8	8
Sulfur	ppm	ASTM D5185(m)	11200	10971	8283	8243
Acid Number (AN)	mg KOH/g	ASTM D974*	0.40	0.37	0.52	0.48
Visc @ 40°C	cSt	ASTM D7279(m)	220	222	221	222

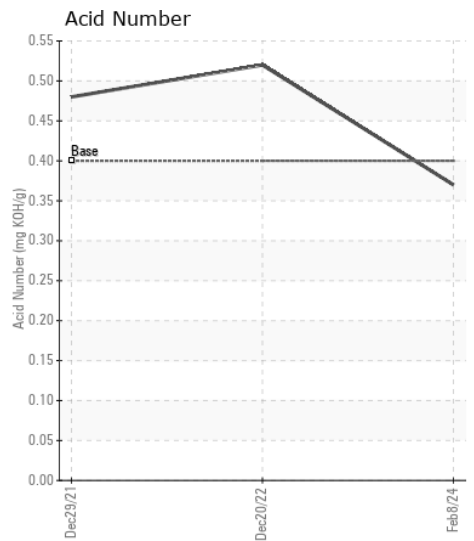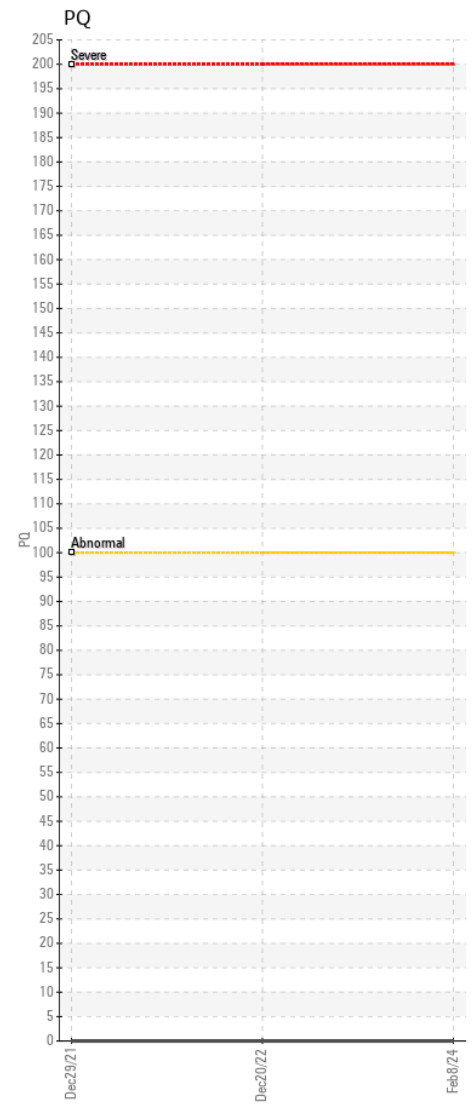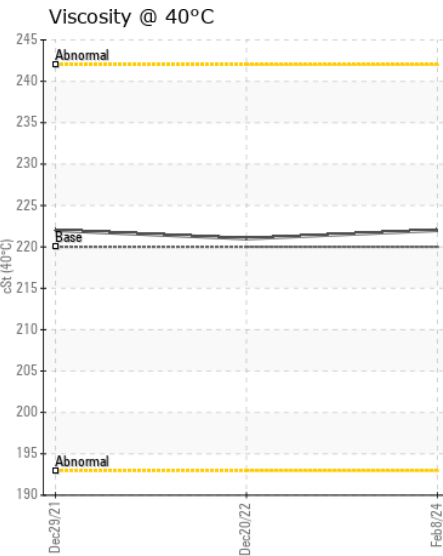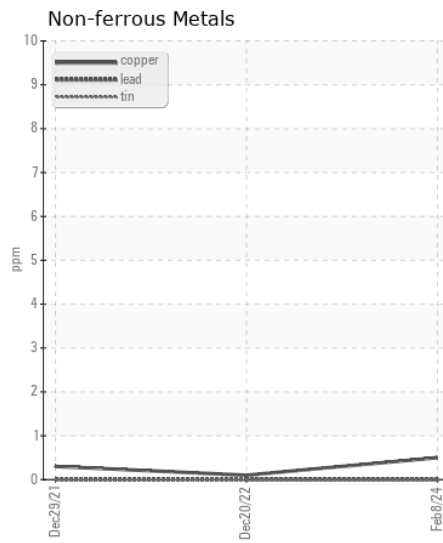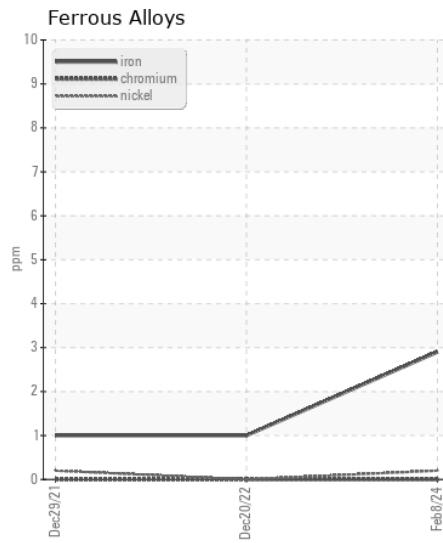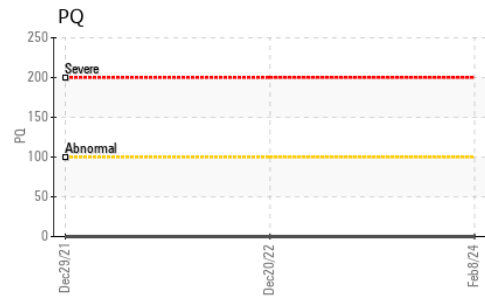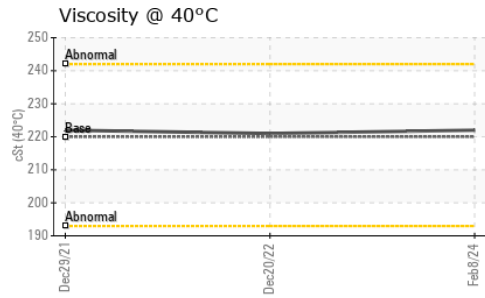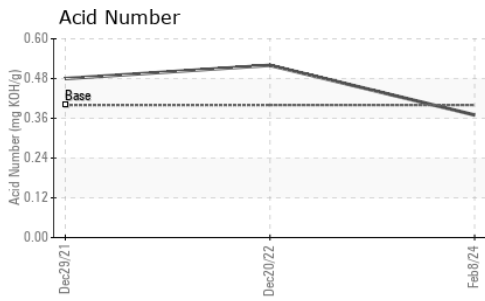

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CB0031533 **Received** : 26 Feb 2024
Lab Number : 02618157 **Tested** : 27 Feb 2024
Unique Number : 5735267 **Diagnosed** : 27 Feb 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: TAN Man)

Synovos/Apotex
 50 Steinway Blvd.
 Etobicoke, ON
 CA M9W 6Y3
 Contact: Emmanuel Okelue
 eokelue@apotex.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T:
F: