**WEAR** CONTAMINATION **FLUID CONDITION** 


**NORMAL NORMAL NORMAL** 

**OIL ANALYSIS REPORT** 

## **SIEMENS SIEMENS**

Component Natural Gas Engine

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	Hictory	History2
	Sample Number	UOIVI	Client Info	LITTIL/ADTI	TR02618309	History1	mistory2
The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.	Sample Date		Client Info		06 Feb 2024		
	Machine Age	hrs	Client Info		8634		
	Oil Age	hrs	Client Info		862		
	Filter Age	hrs	Client Info		862		
	Oil Changed	1113	Client Info		Changed		
	Filter Changed		Client Info		Changed		
	Sample Status		Oliciti illio		NORMAL		
WEAR	Iron	ppm	ASTM D5185(m)	>50	10		
All component wear rates are normal.	Chromium	ppm	ASTM D5185(m)	>4	0		
	Nickel	ppm	ASTM D5185(m)	>2	<1		
	Titanium	ppm	ASTM D5185(m)		0		
	Silver	ppm	ASTM D5185(m)	>3	0		
	Aluminum	ppm	ASTM D5185(m)	>9	2		
	Lead	ppm	ASTM D5185(m)	>30	20		
	Copper	ppm	ASTM D5185(m)	>35	3		
	Tin	ppm	ASTM D5185(m)	>4	0		
	Vanadium	ppm	ASTM D5185(m)		0		
CONTAMINATION	Silicon		ACTM DE10E/m)	100	•		
CONTAMINATION		ppm	ASTM D5185(m)		2		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185(m)		1 NEC		
	Water	0/	WC Method	>0.1	NEG 0		
	Soot % Nitration	%	ASTM D7844* ASTM D7624*	>20			
		Abs/tmm			7.0 22.0		
	Sulfation Emulsified Water	Abs/.1mm	ASTM D7415* Visual*	>30	NEG		
	Emuisined water	scalar	VISUAI	>0.1			
FLUID CONDITION	Sodium	ppm	ASTM D5185(m)		1		
The i-pH level is abnormally low. The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.	Boron	ppm	ASTM D5185(m)		1		
	Barium	ppm	ASTM D5185(m)		0		
	Molybdenum	ppm	ASTM D5185(m)		<1		
	Manganese	ppm	ASTM D5185(m)		0		
	Magnesium	ppm	ASTM D5185(m)		6		
	Calcium	ppm	ASTM D5185(m)		1729		
	Phosphorus	ppm	ASTM D5185(m)		300		
	Zinc	ppm	ASTM D5185(m)		370		
	Sulfur	ppm	ASTM D5185(m)		5027		
	Oxidation	Abs/.1mm	ASTM D7414*	>25	18.5		
	Acid Number (AN)	mg KOH/g	ASTM D974*		2.30		
	Base Number (BN)	mg KOH/g	ASTM D2896*		3.38		
	i-pH	Scale 0-14	ASTM D7946*	<4.5	3.62		
	Visc @ 100°C	cSt	ASTM D7279(m)		15.8		

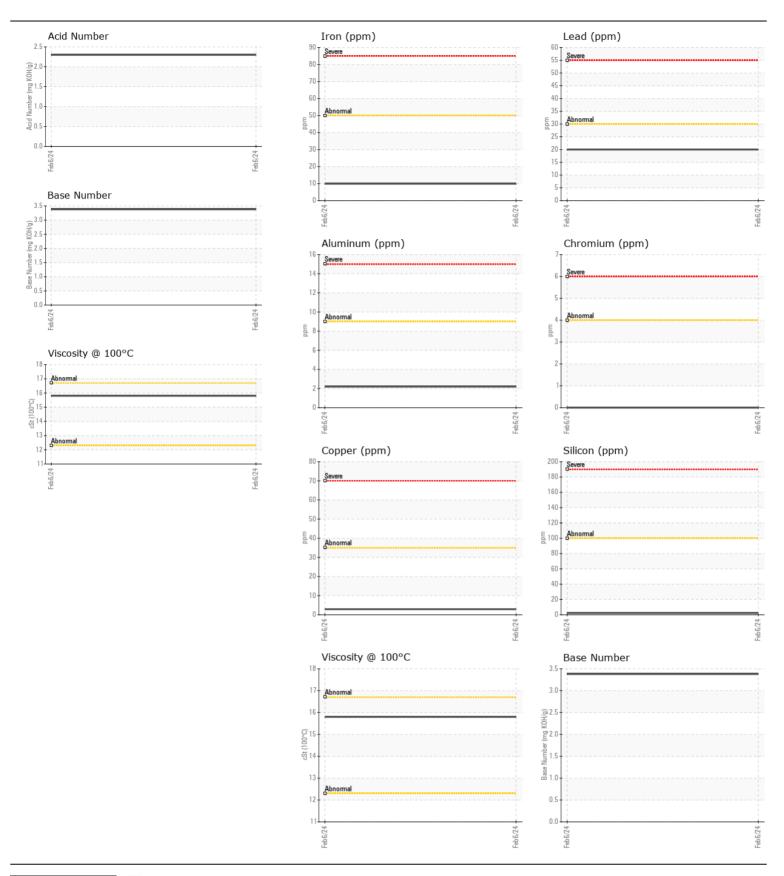



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No.

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 HARTLAND COLONY (HLAND FARMING) Lab Number : 02618309

: TR02618309 Unique Number : 5735419

Received **Tested** Diagnosed

: 27 Feb 2024 : 27 Feb 2024

: 28 Feb 2024 - Kevin Marson Test Package : MOB 2 (Additional Tests: i-pH, TAN Auto, TAN Man)

Contact: DAVID WALDNER

To discuss this sample report, contact Customer Service at 1-800-827-0711.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

RR #1

BASHAW, AB

CA TOB 0H0

T: (403)588-9240

F: (780)372-3685