



Machine Id
1037 PORTAGE RD KIRKFIELD BELL CANADA BELL CANADA

Component
Diesel Engine

Fluid
ESSO XD-3 EXTRA 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005769	---	---
Sample Date		Client Info		15 Feb 2024	---	---
Machine Age	hrs	Client Info		77	---	---
Oil Age	hrs	Client Info		25	---	---
Filter Age	hrs	Client Info		25	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>150	7	---	---
Chromium	ppm	ASTM D5185(m)	>20	<1	---	---
Nickel	ppm	ASTM D5185(m)	>2	<1	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	4	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>30	11	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	14	---	---
Potassium	ppm	ASTM D5185(m)	>20	4	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol	%	ASTM D7922*		0.0	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	7.5	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.1	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	26	---	---
Boron	ppm	ASTM D5185(m)		37	---	---
Barium	ppm	ASTM D5185(m)		<1	---	---
Molybdenum	ppm	ASTM D5185(m)		45	---	---
Manganese	ppm	ASTM D5185(m)		1	---	---
Magnesium	ppm	ASTM D5185(m)		825	---	---
Calcium	ppm	ASTM D5185(m)	3780	1082	---	---
Phosphorus	ppm	ASTM D5185(m)	1370	784	---	---
Zinc	ppm	ASTM D5185(m)	1500	852	---	---
Sulfur	ppm	ASTM D5185(m)	3800	2604	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	16.8	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	116	97.5	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.3	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	140	135	---	---

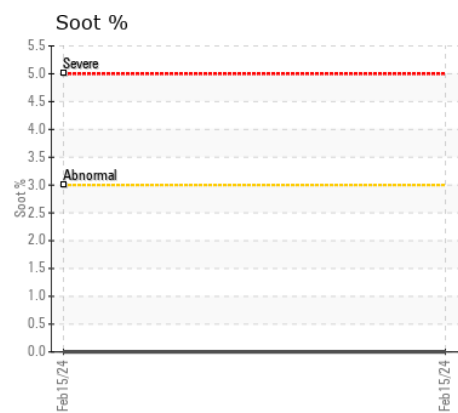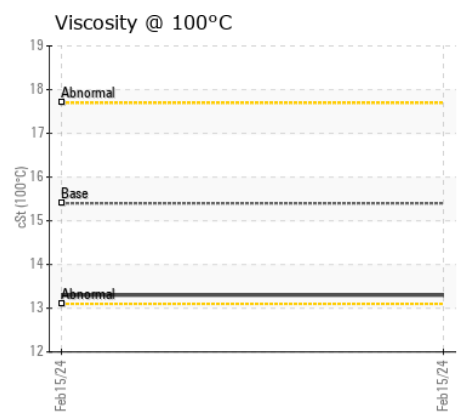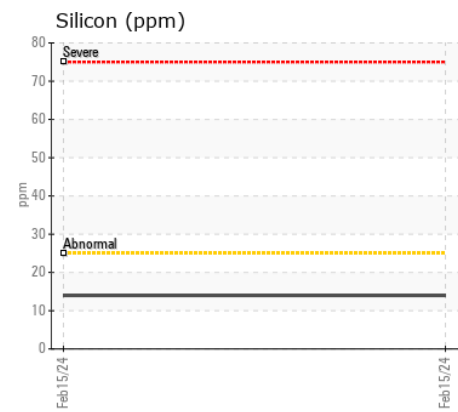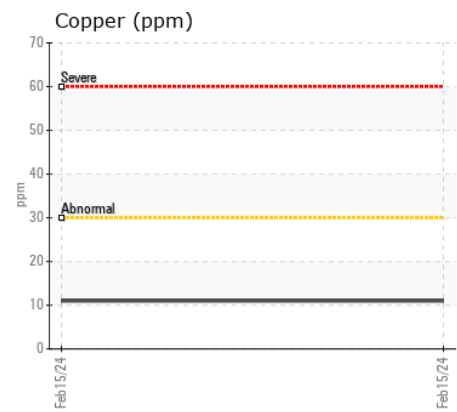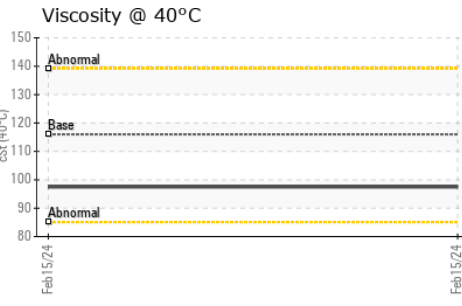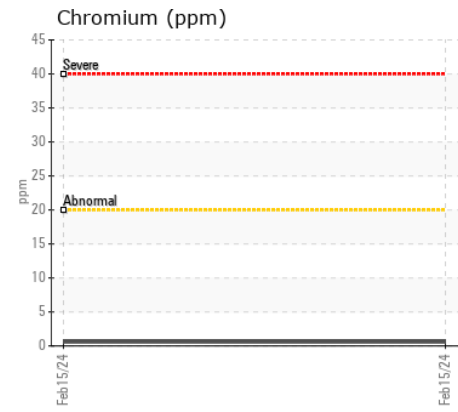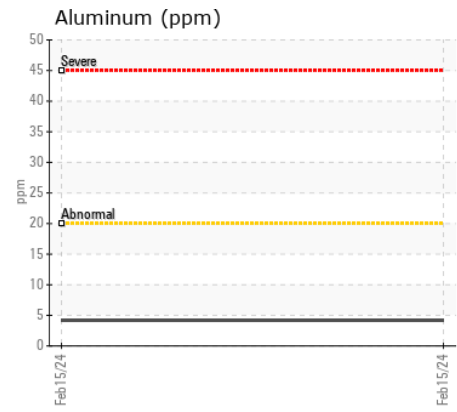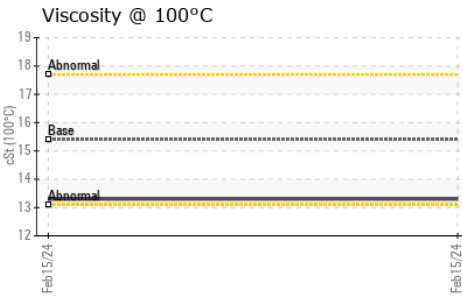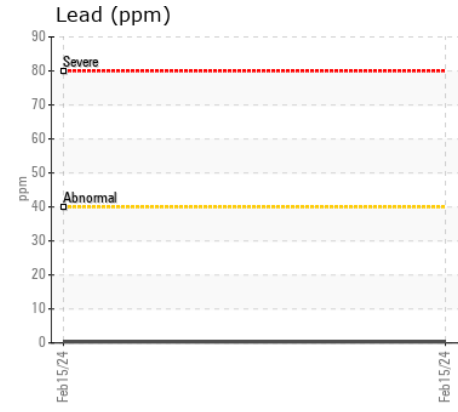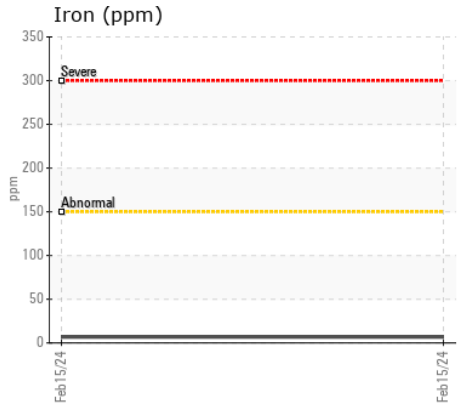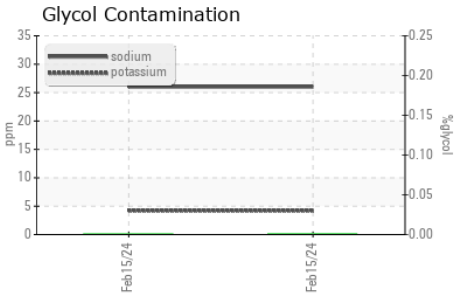

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005769 **Received** : 29 Feb 2024
Lab Number : 02618934 **Tested** : 29 Feb 2024
Unique Number : 5736044 **Diagnosed** : 29 Feb 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Glycol, KV40, VI)

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.