



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**146 FOX**  
Component  
**Diesel Engine**  
Fluid  
**PETRO CANADA XR 4 SAE 15W40 (--- LTR)**

## RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0897615</b>	---	---
Sample Date		Client Info		<b>26 Feb 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Filter Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed		Client Info		<b>N/A</b>	---	---
Filter Changed		Client Info		<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	<b>2</b>	---	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)	>4	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	>3	<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185(m)	>330	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---

## CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>4</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>7</b>	---	---
Fuel		WC Method	>5	<b>&lt;1.0</b>	---	---
Water		WC Method	>0.2	<b>NEG</b>	---	---
Glycol	%	ASTM D7922*		<b>0.0</b>	---	---
Soot %	%	ASTM D7844*	>3	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>5.4</b>	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>20.2</b>	---	---
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	---	---

## FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		<b>2</b>	---	---
Boron	ppm	ASTM D5185(m)	1	<b>169</b>	---	---
Barium	ppm	ASTM D5185(m)	1	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	1	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)	10	<b>13</b>	---	---
Calcium	ppm	ASTM D5185(m)	3032	<b>2096</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	1054	<b>963</b>	---	---
Zinc	ppm	ASTM D5185(m)	1332	<b>1066</b>	---	---
Sulfur	ppm	ASTM D5185(m)	3985	<b>3083</b>	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>16.3</b>	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	<b>14.7</b>	---	---

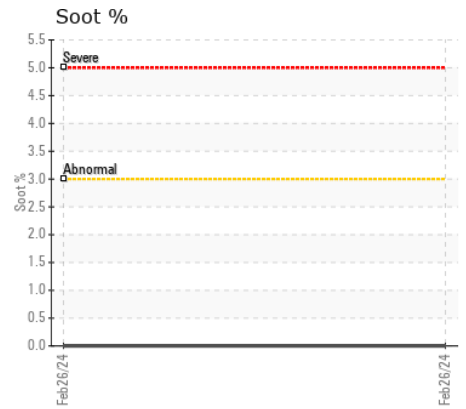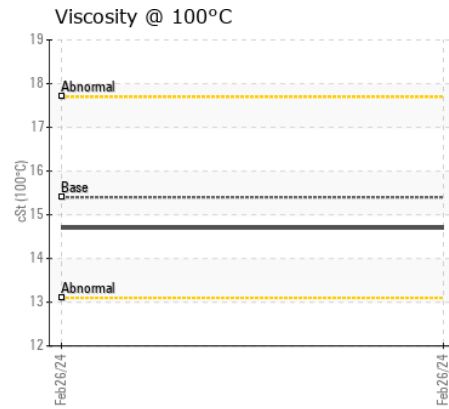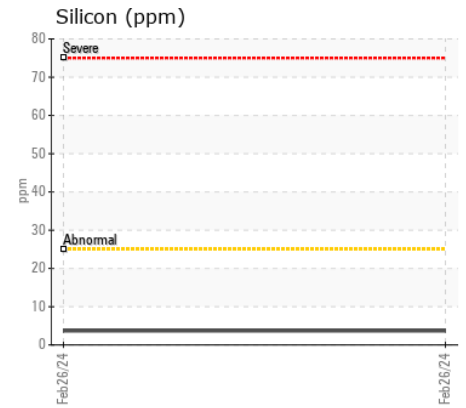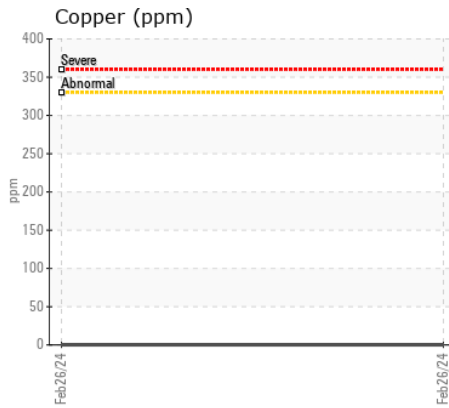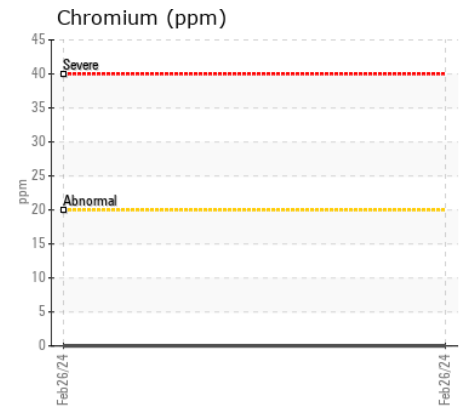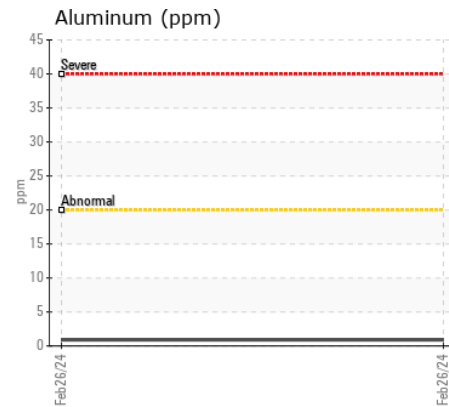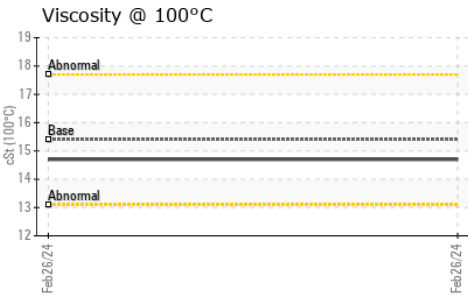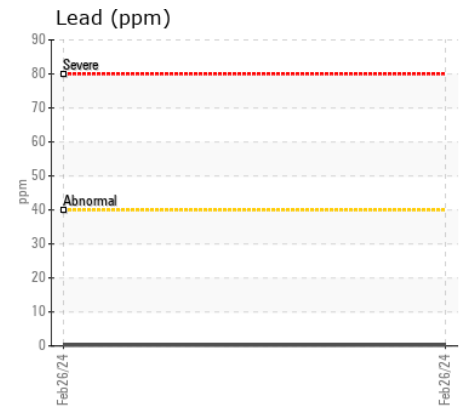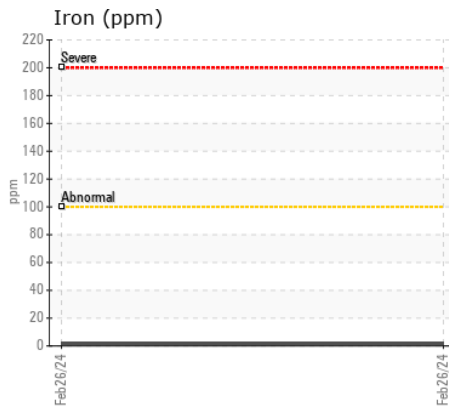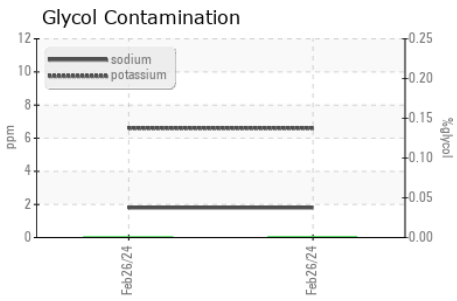

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0897615 **Received** : 01 Mar 2024  
**Lab Number** : 02619223 **Tested** : 01 Mar 2024  
**Unique Number** : 5736333 **Diagnosed** : 01 Mar 2024 - Kevin Marson  
**Test Package** : MOB 1 ( Additional Tests: Glycol )

**NORTHERN GENERATOR CO. LTD.**  
 80 ASHBRIDGE CIRCLE., UNIT #1 & 2  
 WOODBRIDGE, ON  
 CA L4L 3R5  
 Contact: Selome Afework  
 selome@northerngenerator.com  
 T: (905)264-9744  
 F: (905)264-9714

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.