



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**NO UNIT GFL0088684**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 30 (--- GAL)**

## RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 30. Please confirm.

Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>GFL0088684</b>	---	---
Sample Date		Client Info		<b>05 Mar 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Filter Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed		Client Info		<b>N/A</b>	---	---
Filter Changed		Client Info		<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	<b>6</b>	---	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)	>4	<b>0</b>	---	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>1</b>	---	---
Lead	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185(m)	>330	<b>1</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---

## CONTAMINATION











Fuel content negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>4</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	---	---
Fuel	%	ASTM D7593*	>5	<b>0.9</b>	---	---
Water		WC Method	>0.2	<b>NEG</b>	---	---
Glycol		WC Method		<b>NEG</b>	---	---
Soot %	%	ASTM D7844*	>3	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>5.1</b>	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>17.9</b>	---	---
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	---	---

## FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>75	<b>1</b>	---	---
Boron	ppm	ASTM D5185(m)	250	<b>8</b>	---	---
Barium	ppm	ASTM D5185(m)	10	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	100	<b>58</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)	450	<b>938</b>	---	---
Calcium	ppm	ASTM D5185(m)	3000	<b>1090</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	<b>1015</b>	---	---
Zinc	ppm	ASTM D5185(m)	1350	<b>1164</b>	---	---
Sulfur	ppm	ASTM D5185(m)	4250	<b>2777</b>	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>13.3</b>	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	10.9	<b>11.3</b>	---	---

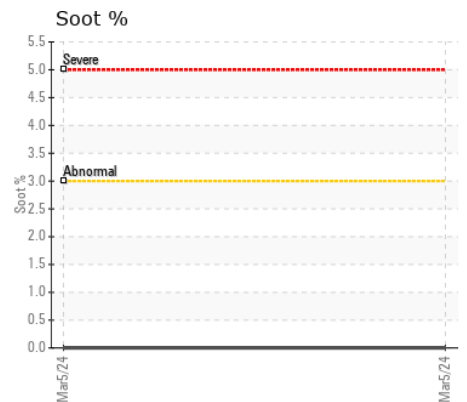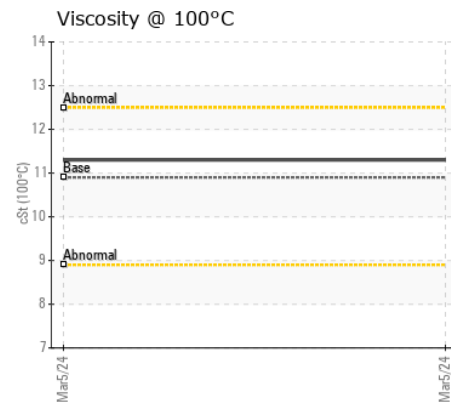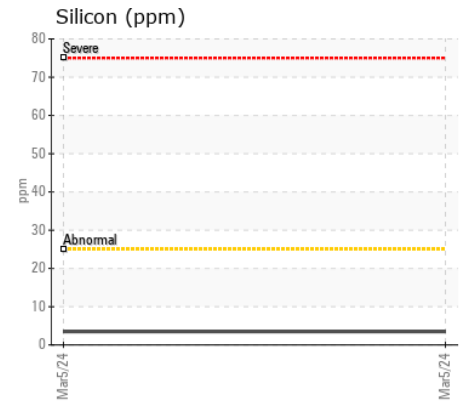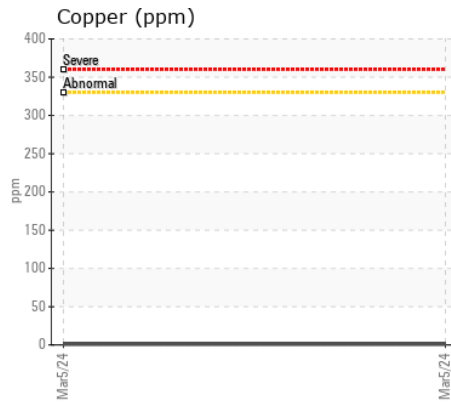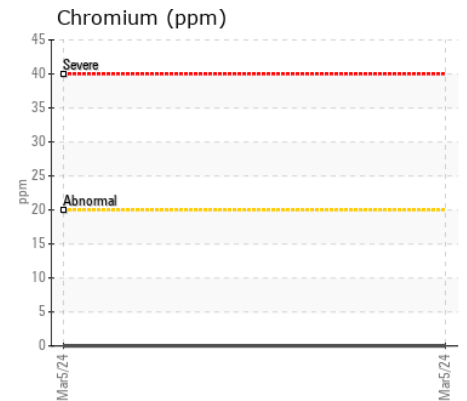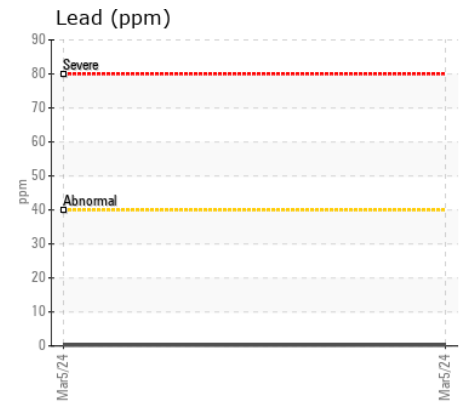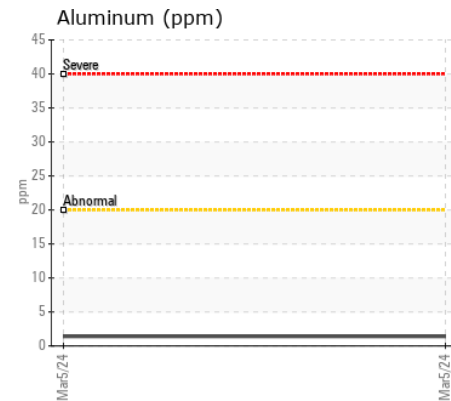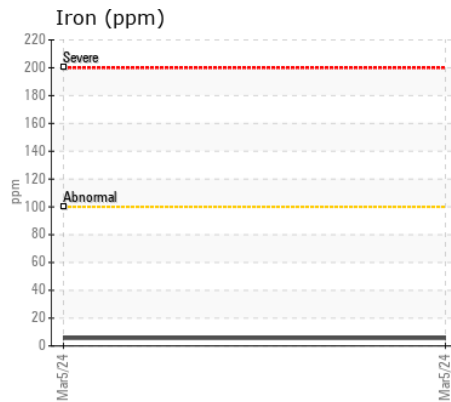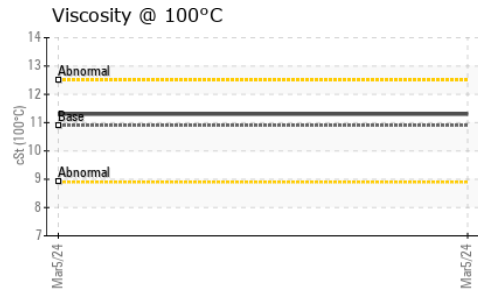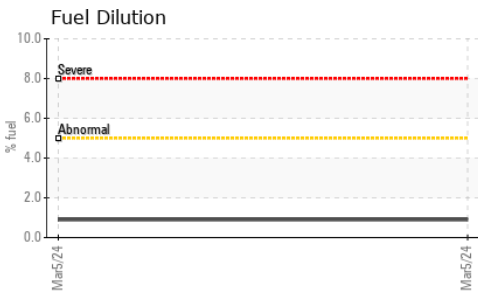

ISO 17025:2017  
Accredited  
Laboratory

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : GFL0088684 **Received** : 06 Mar 2024  
**Lab Number** : 02620065 **Tested** : 07 Mar 2024  
**Unique Number** : 5737175 **Diagnosed** : 07 Mar 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: FuelDilution, PercentFuel )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**LES ENTREPRISES JLE**  
 5009 IRWIN STREET  
 LaSalle, QC  
 CA H8N 1A1  
 Contact: Eric Lessard  
 eric@gojle.com  
 T: (514)368-8720  
 F: