



TRAAP

Texas Refinery Advanced Analysis Program

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
SEMANS 9999
 Component
Natural Gas Engine
 Fluid
PETRO CANADA SENTRON LD 5000 (120 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TR02620180	TR02618308	---
Sample Date		Client Info		15 Feb 2024	15 Feb 2024	---
Machine Age	hrs	Client Info		9096	9096	---
Oil Age	hrs	Client Info		1665	1665	---
Filter Age	hrs	Client Info		1665	1665	---
Oil Changed		Client Info		Oil Added	N/A	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	NORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>50	3	3	---
Chromium	ppm	ASTM D5185(m)	>4	0	0	---
Nickel	ppm	ASTM D5185(m)	>2	0	<1	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)	>3	0	0	---
Aluminum	ppm	ASTM D5185(m)	>9	2	2	---
Lead	ppm	ASTM D5185(m)	>30	8	8	---
Copper	ppm	ASTM D5185(m)	>35	2	2	---
Tin	ppm	ASTM D5185(m)	>4	0	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>+100	2	2	---
Potassium	ppm	ASTM D5185(m)	>20	<1	2	---
Water		WC Method	>0.1	NEG	NEG	---
Soot %	%	ASTM D7844*		0	0	---
Nitration	Abs/cm	ASTM D7624*	>20	5.3	5.3	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.2	19.2	---
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)		<1	1	---
Boron	ppm	ASTM D5185(m)	2	1	1	---
Barium	ppm	ASTM D5185(m)	3	0	0	---
Molybdenum	ppm	ASTM D5185(m)	0	<1	<1	---
Manganese	ppm	ASTM D5185(m)	0	0	0	---
Magnesium	ppm	ASTM D5185(m)	4	22	23	---
Calcium	ppm	ASTM D5185(m)	1727	1979	1985	---
Phosphorus	ppm	ASTM D5185(m)	272	310	305	---
Zinc	ppm	ASTM D5185(m)	333	383	382	---
Sulfur	ppm	ASTM D5185(m)	3415	2995	2968	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.4	13.6	---
Acid Number (AN)	mg KOH/g	ASTM D974*	1.1	2.28	2.13	---
Base Number (BN)	mg KOH/g	ASTM D2896*	4.9	3.86	4.34	---
i-pH	Scale 0-14	ASTM D7946*	<4.5	---	4.18	---
Visc @ 100°C	cSt	ASTM D7279(m)	13.4	14.1	14.2	---

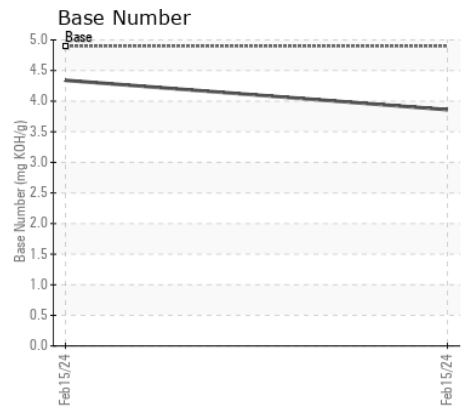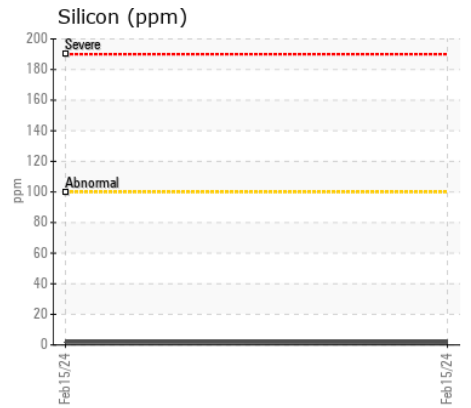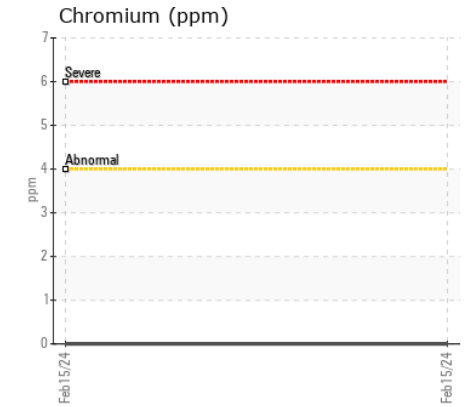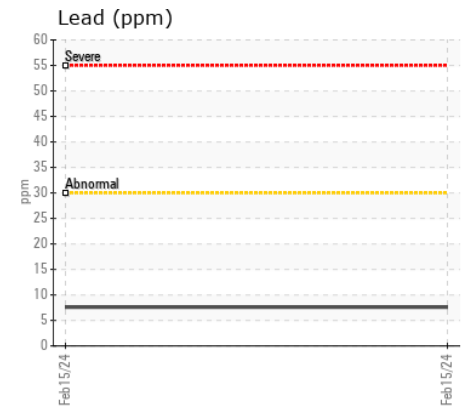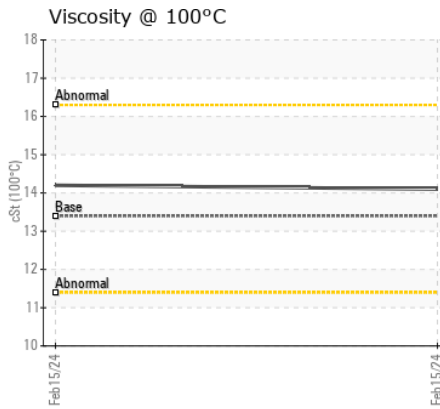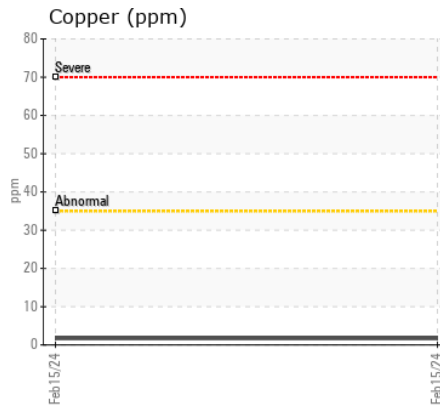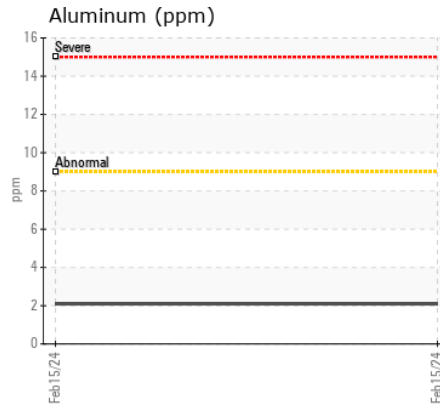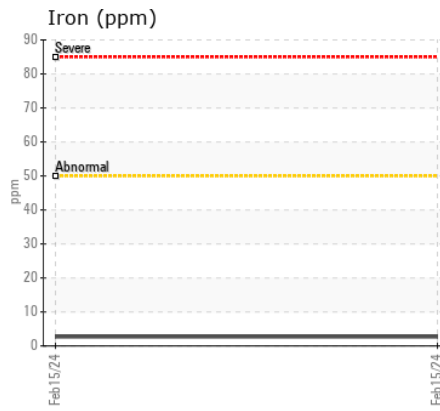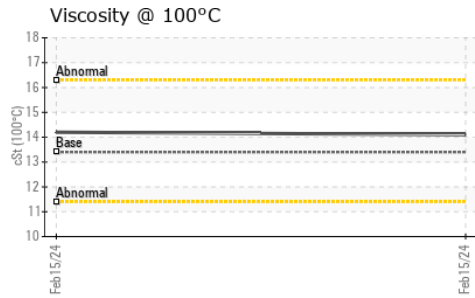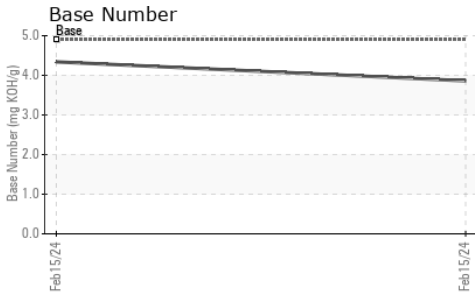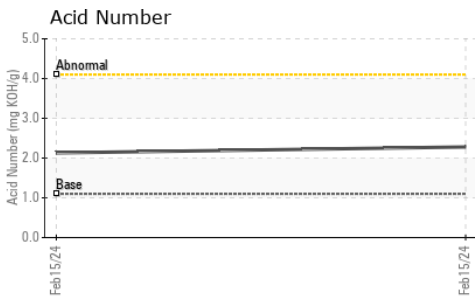

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **HARTLAND COLONY (HLAND FARMING)**
Sample No. : TR02620180 **Received** : 06 Mar 2024 **RR #1**
Lab Number : 02620180 **Tested** : 06 Mar 2024 **BASHAW, AB**
Unique Number : 5737290 **Diagnosed** : 06 Mar 2024 - Kevin Marson **CA T0B 0H0**
Test Package : MOB 2 (Additional Tests: i-pH, TAN Auto, TAN Man) **Contact: DAVID WALDNER**

To discuss this sample report, contact Customer Service at 1-800-827-0711.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (403)588-9240

F: (780)372-3685