



Machine Id
145 Harry Walker Pkw N/A YORK REGION TRAILER 300 KW 06R1036190

Component
Left Diesel Engine

Fluid
ESSO XD-3 EXTRA 15W40 (--- LTR)

RECOMMENDATION

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. No other corrective action is recommended at this time.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005811	---	---
Sample Date		Client Info		04 Mar 2024	---	---
Machine Age	hrs	Client Info		167	---	---
Oil Age	hrs	Client Info		11	---	---
Filter Age	hrs	Client Info		11	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				ABNORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>200	7	---	---
Chromium	ppm	ASTM D5185(m)	>20	<1	---	---
Nickel	ppm	ASTM D5185(m)	>2	<1	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>30	1	---	---
Lead	ppm	ASTM D5185(m)	>30	<1	---	---
Copper	ppm	ASTM D5185(m)	>30	3	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION











Light fuel dilution occurring. No other contaminants were detected in the oil.

Silicon	ppm	ASTM D5185(m)	>30	7	---	---
Potassium	ppm	ASTM D5185(m)	>20	1	---	---
Fuel	%	ASTM D7593*	>3.0	1	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	6.8	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	22.3	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

Viscosity of sample indicates oil is within SAE 30 range, advise investigate. The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	3	---	---
Boron	ppm	ASTM D5185(m)		41	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		45	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)		609	---	---
Calcium	ppm	ASTM D5185(m)	3780	1537	---	---
Phosphorus	ppm	ASTM D5185(m)	1370	957	---	---
Zinc	ppm	ASTM D5185(m)	1500	1086	---	---
Sulfur	ppm	ASTM D5185(m)	3800	2632	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	20.2	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	▲ 11.8	---	---

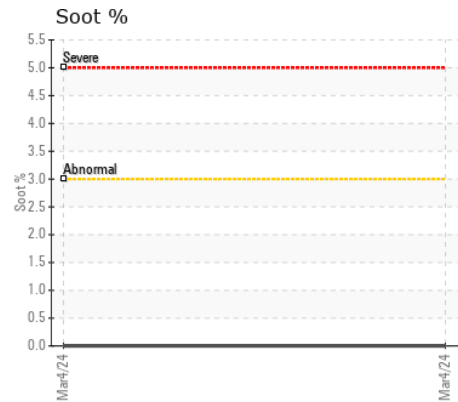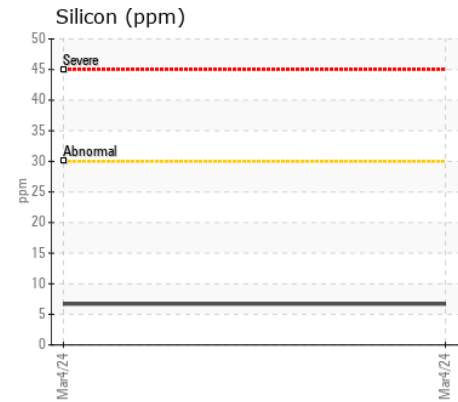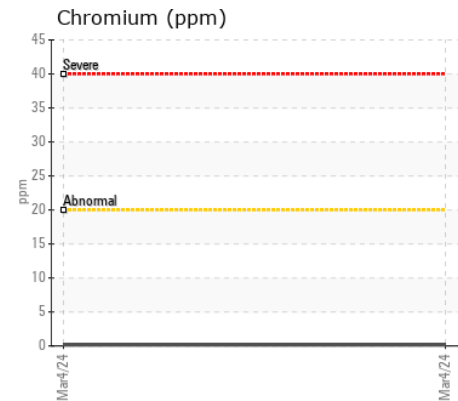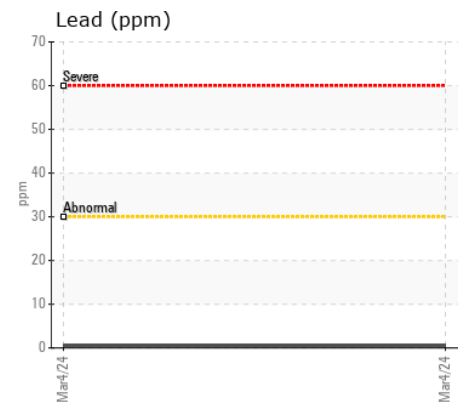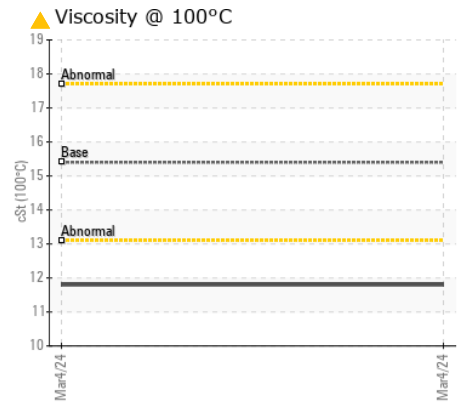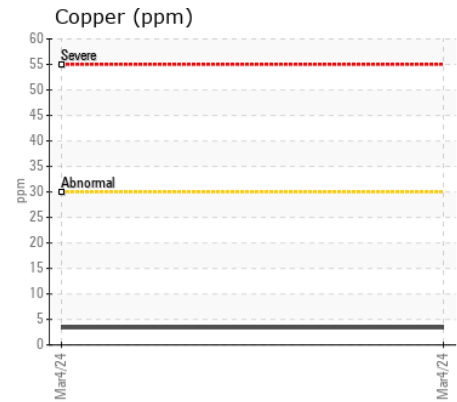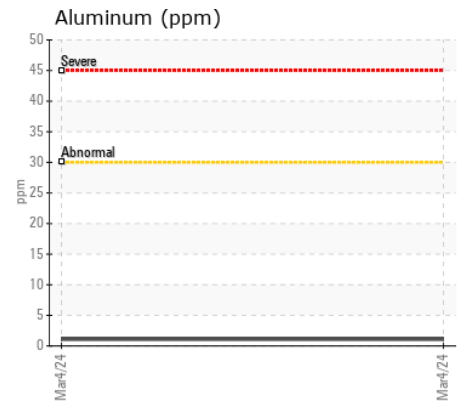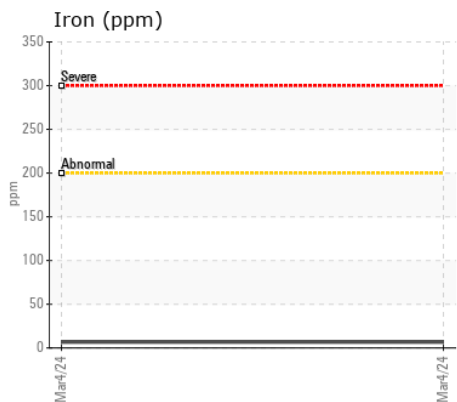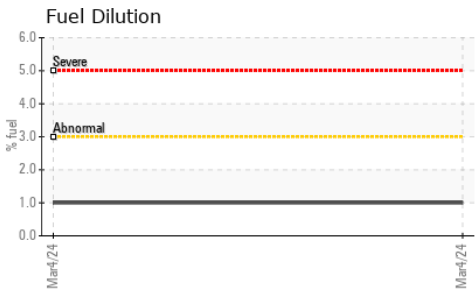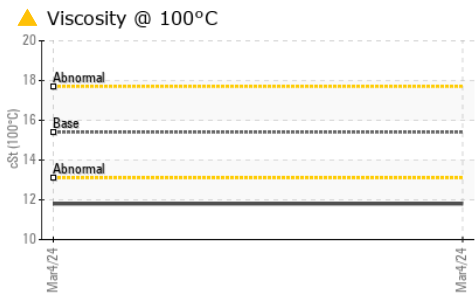

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005811 **Received** : 07 Mar 2024
Lab Number : 02620460 **Tested** : 08 Mar 2024
Unique Number : 5737570 **Diagnosed** : 08 Mar 2024 - Kevin Marson
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel)

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Ryan Udall
 rudall@pwrstn.com
 T: (905)565-1621
 F: (905)629-1499

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.