



Machine Id
51 DOCKSIDE DR TORONTO GEORGE BROWN COLLEGE 5283701316

Component
Left Natural Gas Engine

Fluid
ESSO XD-3 EXTRA 15W40 (440 LTR)

RECOMMENDATION

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MOB 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. this testkit includes BN to determine the suitability of the oil for continued use.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005820	---	---
Sample Date		Client Info		29 Feb 2024	---	---
Machine Age	hrs	Client Info		190	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in. Component wear rates appear to be normal (unconfirmed).

Iron	ppm	ASTM D5185(m)	>50	1	---	---
Chromium	ppm	ASTM D5185(m)	>4	0	---	---
Nickel	ppm	ASTM D5185(m)	>2	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>9	1	---	---
Lead	ppm	ASTM D5185(m)	>30	0	---	---
Copper	ppm	ASTM D5185(m)	>35	<1	---	---
Tin	ppm	ASTM D5185(m)	>4	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>+100	3	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Water		WC Method	>0.1	NEG	---	---
Soot %	%	ASTM D7844*		0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.8	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.1	---	---
Emulsified Water	scalar	Visual*	>0.1	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service (unconfirmed).

Sodium	ppm	ASTM D5185(m)	>192	1	---	---
Boron	ppm	ASTM D5185(m)		34	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		62	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		564	---	---
Calcium	ppm	ASTM D5185(m)	3780	1528	---	---
Phosphorus	ppm	ASTM D5185(m)	1370	1046	---	---
Zinc	ppm	ASTM D5185(m)	1500	1148	---	---
Sulfur	ppm	ASTM D5185(m)	3800	3094	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	12.7	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	14.3	---	---

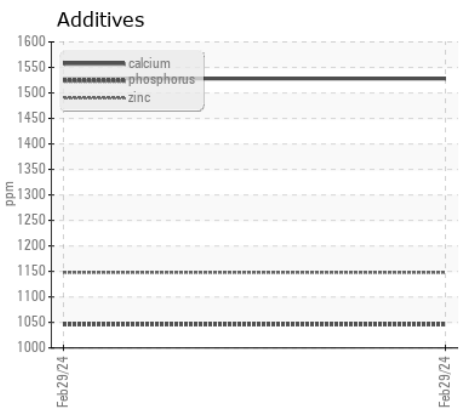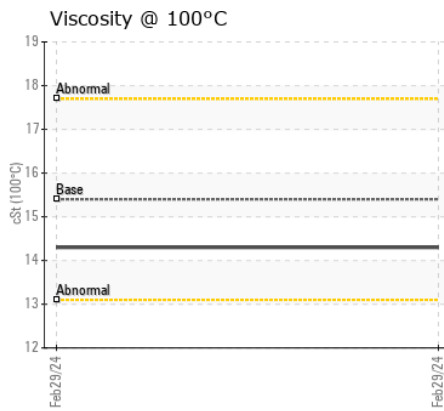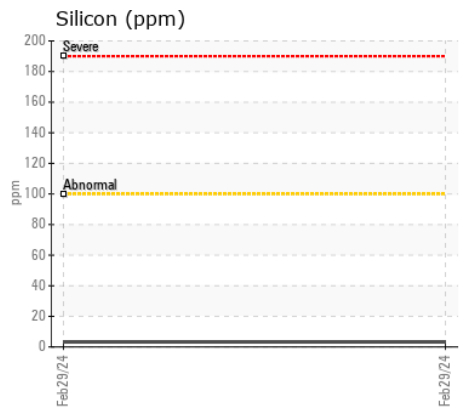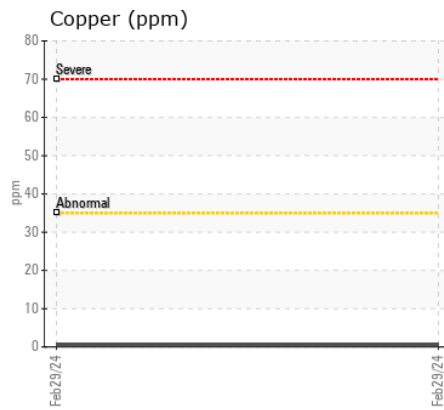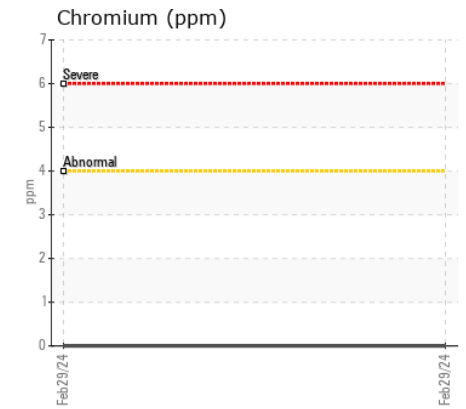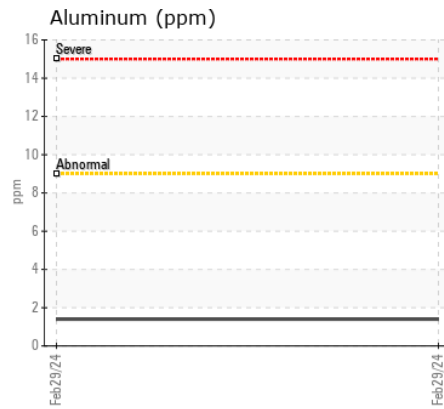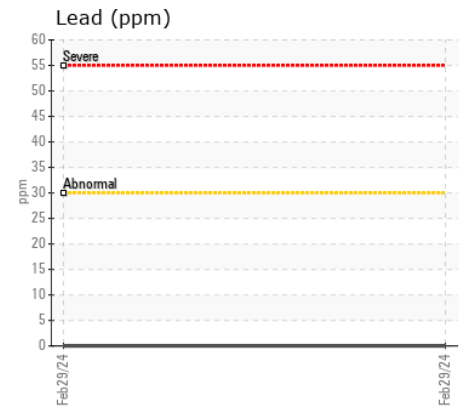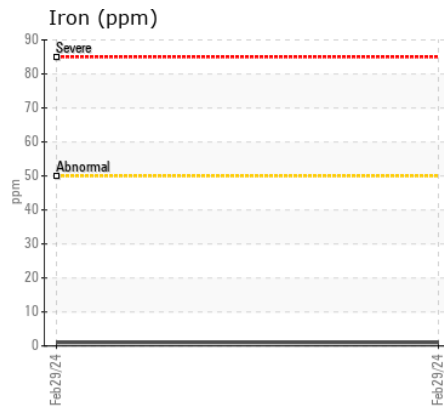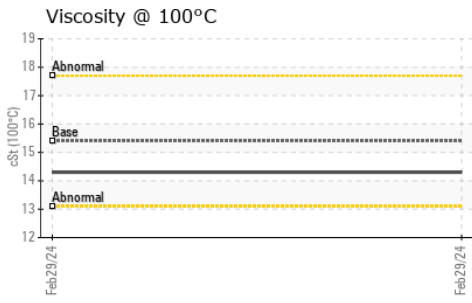

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005820
Lab Number : 02620508
Unique Number : 5737618
Test Package : MOB 1
Received : 07 Mar 2024
Tested : 07 Mar 2024
Diagnosed : 07 Mar 2024 - Wes Davis

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.