



Machine Id
40 NELSON ST ALLISTON, MAIN LEVEL GEN RM BELL CANADA 6A170325

Component
Rear Gasoline Engine

Fluid
ESSO XD-3 EXTRA SAE 30 (30 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005794	---	---
Sample Date		Client Info		29 Feb 2024	---	---
Machine Age	hrs	Client Info		565	---	---
Oil Age	hrs	Client Info		14	---	---
Filter Age	hrs	Client Info		14	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				ABNORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>150	2	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>5	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>40	<1	---	---
Lead	ppm	ASTM D5185(m)	>50	<1	---	---
Copper	ppm	ASTM D5185(m)	>155	2	---	---
Tin	ppm	ASTM D5185(m)	>10	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>30	3	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Fuel		WC Method	>4.0	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*		0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	3.0	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	12.5	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

Viscosity of sample indicates oil is within SAE 40 range, advise investigate. The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>16	1	---	---
Boron	ppm	ASTM D5185(m)		9	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		3	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		787	---	---
Calcium	ppm	ASTM D5185(m)	2550	1301	---	---
Phosphorus	ppm	ASTM D5185(m)	1000	1039	---	---
Zinc	ppm	ASTM D5185(m)	1120	1144	---	---
Sulfur	ppm	ASTM D5185(m)		2718	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	5.7	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	12.0	▲ 13.9	---	---

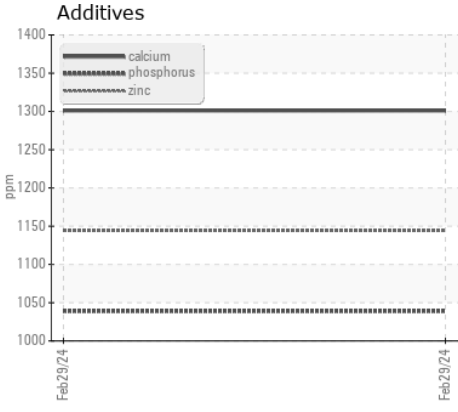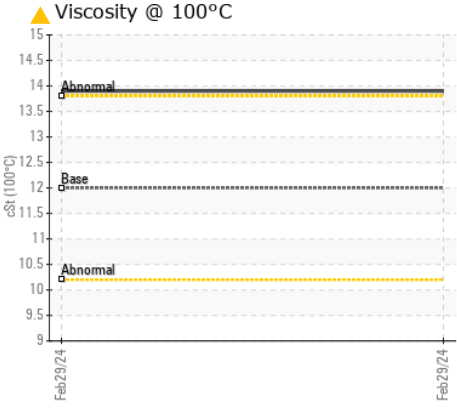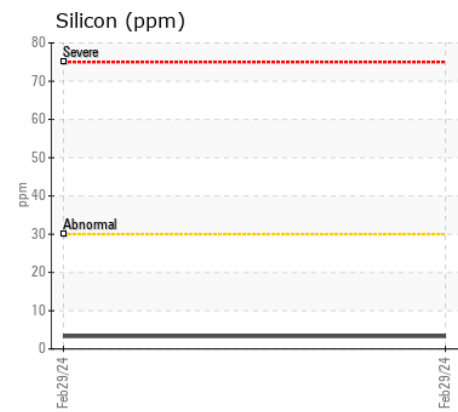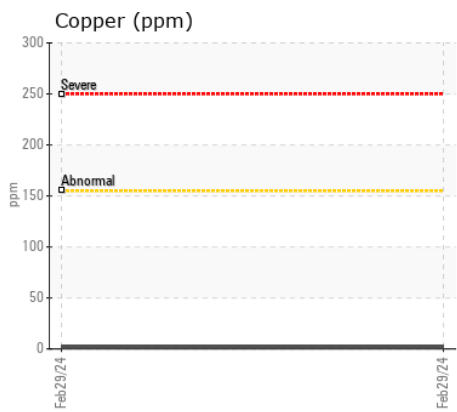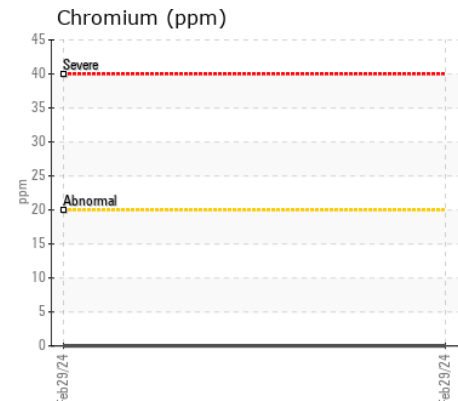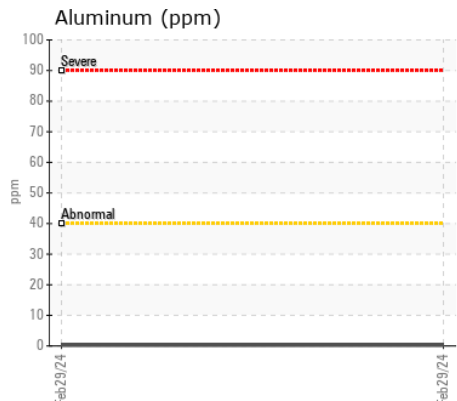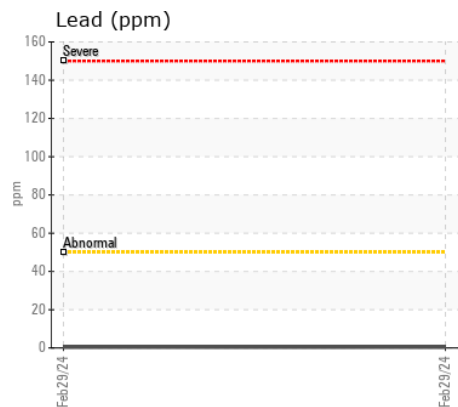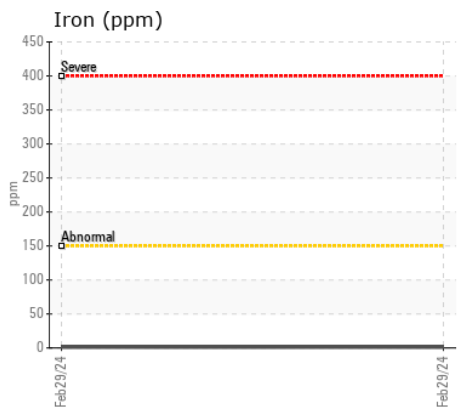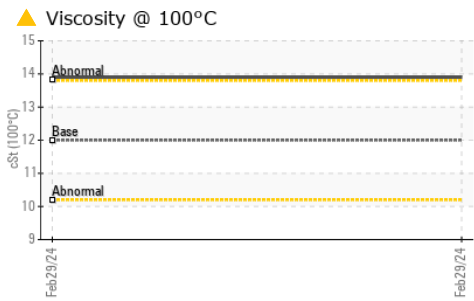

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005794
Lab Number : 02620521
Unique Number : 5737631
Test Package : MOB 1
Received : 07 Mar 2024
Tested : 07 Mar 2024
Diagnosed : 08 Mar 2024 - Kevin Marson

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Ryan Udall
 rudall@pwrstn.com
 T: (905)565-1621
 F: (905)629-1499

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.