



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area  
**WALMART CANADA [4501235207]**  
 Machine Id  
**FRICK COMPRESSOR #2 (S/N 0389)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**FRICK COMPRESSOR OIL #3 (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0895877</b>	WC0848628	WC0778480
Sample Date		Client Info		<b>29 Feb 2024</b>	22 Sep 2023	03 Apr 2023
Machine Age	hrs	Client Info		<b>66051</b>	64211	62052
Oil Age	hrs	Client Info		<b>66051</b>	64211	62052
Filter Age	hrs	Client Info		<b>66051</b>	3080	0
Oil Changed		Client Info		<b>Not Changd</b>	Not Changd	Not Changd
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

PQ		ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m)	>50	<b>3</b>	1	1
Chromium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)		<b>0</b>	0	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185(m)	>25	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185(m)	>25	<b>0</b>	<1	0
Copper	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**










The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>1</b>	2	1
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304*	>0.1	<b>0.001</b>	0.001	0.00
ppm Water	ppm	ASTM D6304*	>1000	<b>5</b>	14.2	0.00
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>AMMON</b>	AMMON	AMMON
Emulsified Water	scalar	Visual*	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)		<b>2</b>	<1	0
Boron	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Barium	ppm	ASTM D5185(m)		<b>&lt;1</b>	1	1
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0
Phosphorus	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Zinc	ppm	ASTM D5185(m)		<b>4</b>	2	2
Sulfur	ppm	ASTM D5185(m)		<b>73</b>	81	115
Acid Number (AN)	mg KOH/g	ASTM D974*		<b>0.04</b>	0.03	0.06
Visc @ 40°C	cSt	ASTM D7279(m)	73	<b>65.1</b>	66.2	65.7

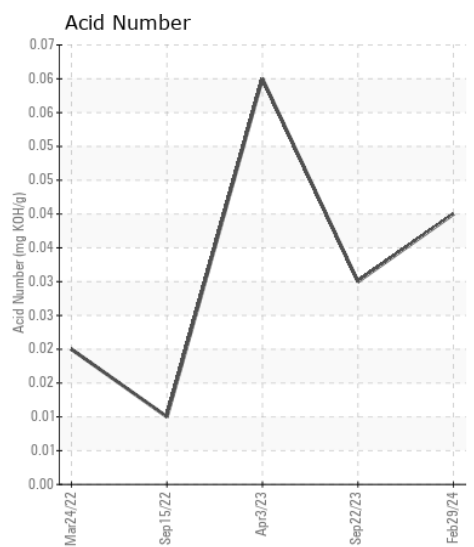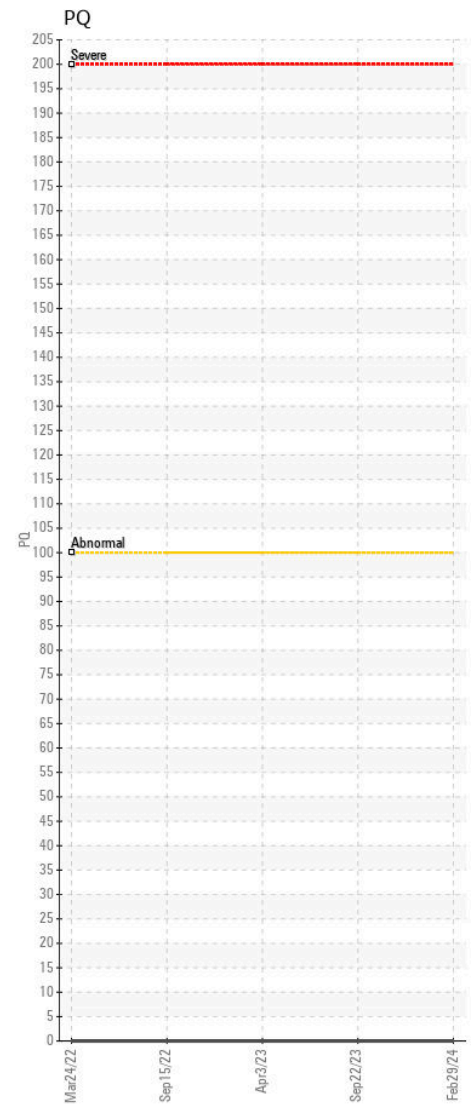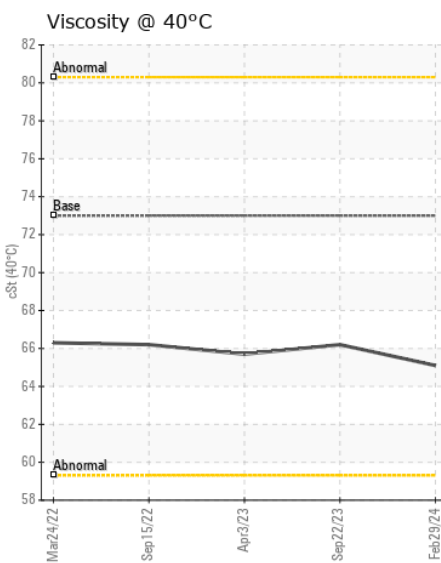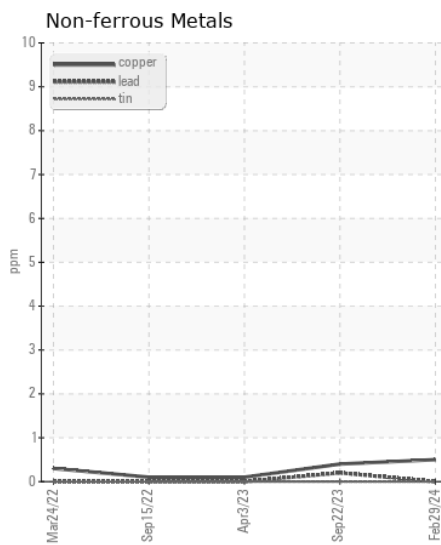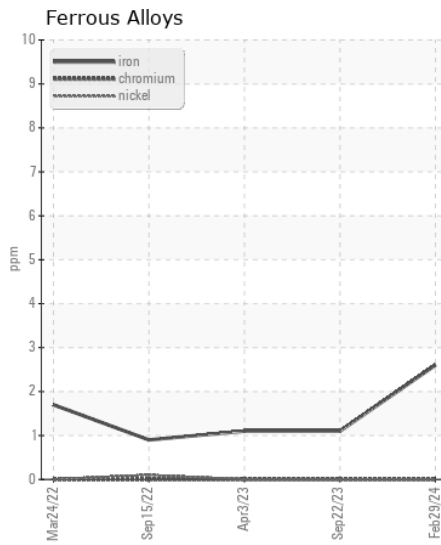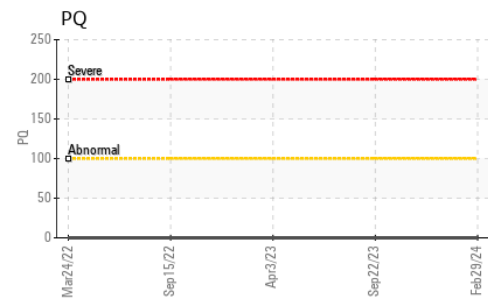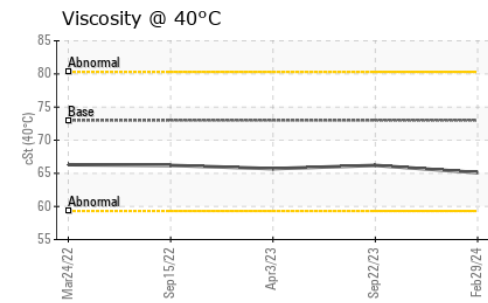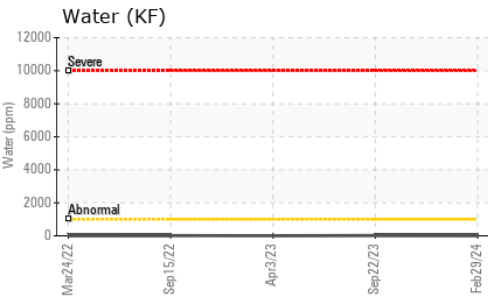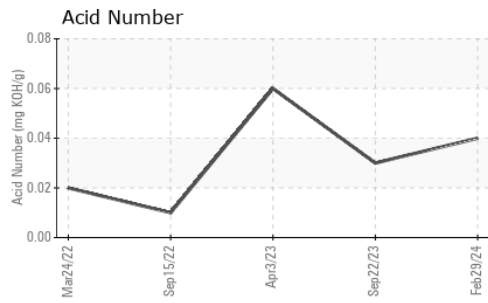

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0895877 **Received** : 07 Mar 2024  
**Lab Number** : 02620573 **Tested** : 08 Mar 2024  
**Unique Number** : 5737683 **Diagnosed** : 11 Mar 2024 - Bill Quesnel  
**Test Package** : IND 2 ( Additional Tests: KF )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**CIMCO Refrigeration**  
 1551 Corporate Drive  
 Burlington, ON  
 CA L7L 6M3  
 Contact: DAVID PARISE  
 DPARISE@ToROMONT.COM  
 T: (416)465-7581  
 F: (416)465-8815