



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**TJ034931/QQ6128**  
 Component  
**Diesel Engine**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0563092	---	---
Sample Date		Client Info		07 Mar 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	4	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>330	<1	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

## CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	3	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.4	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	16.7	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

## FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	3	---	---
Boron	ppm	ASTM D5185(m)	250	248	---	---
Barium	ppm	ASTM D5185(m)	10	0	---	---
Molybdenum	ppm	ASTM D5185(m)	100	48	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)	450	368	---	---
Calcium	ppm	ASTM D5185(m)	3000	1301	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	938	---	---
Zinc	ppm	ASTM D5185(m)	1350	1069	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2624	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.9	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.7	---	---

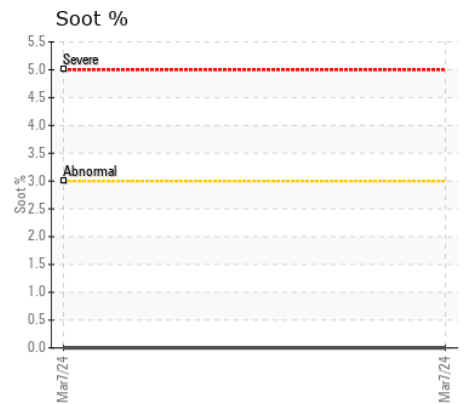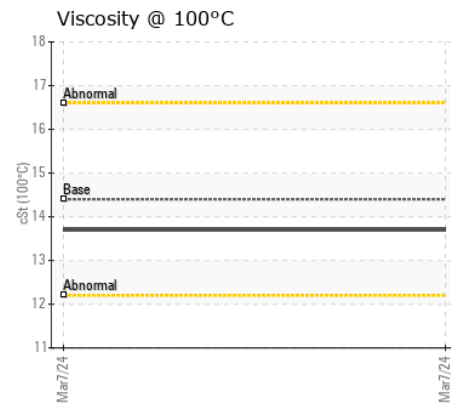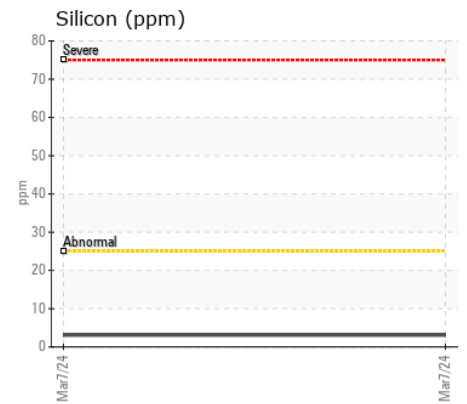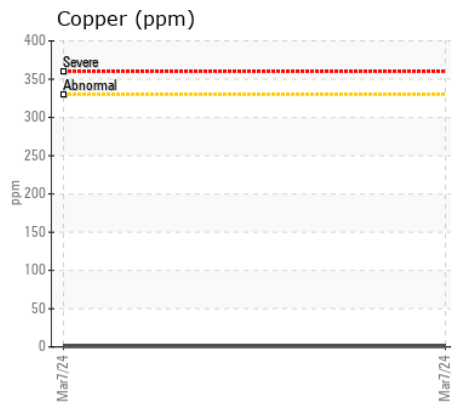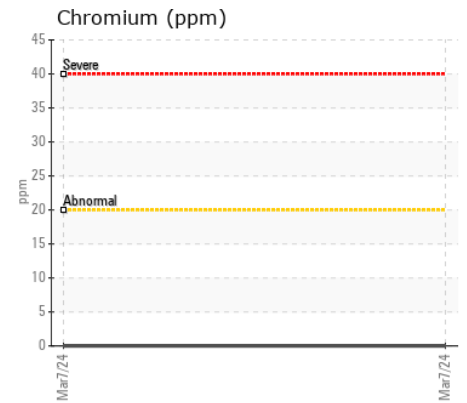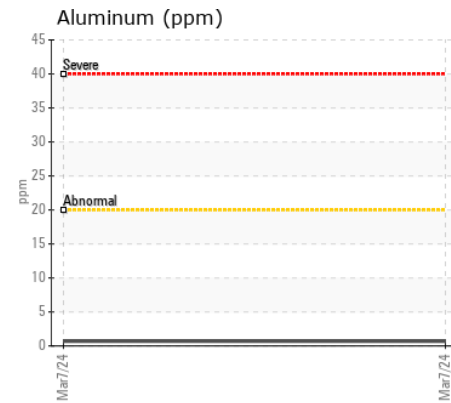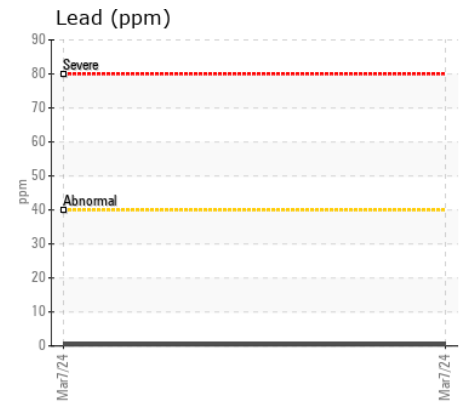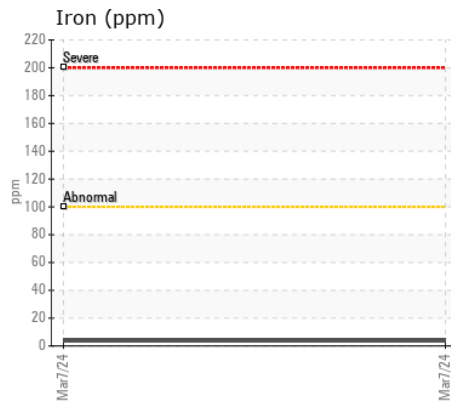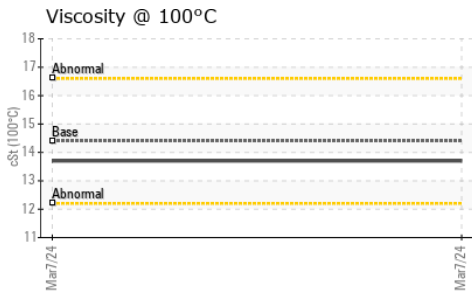

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0563092  
**Lab Number** : 02620724  
**Unique Number** : 5737834  
**Test Package** : MOB 1  
**Received** : 08 Mar 2024  
**Tested** : 08 Mar 2024  
**Diagnosed** : 08 Mar 2024 - Wes Davis

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**GENREP LTD.**  
 121 WATLINE AVENUE  
 MISSISSAUGA, ON  
 CA L4Z 1P2  
 Contact: Amit Singh  
 asingh@genrep.com  
 T: (905)502-9950  
 F: (905)502-9960