



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**TJ034211**  
Component  
**Diesel Engine**  
Fluid  
**{not provided} (--- GAL)**

## RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

## WEAR

All component wear rates are normal.












## CONTAMINATION

Fuel content negligible. There is no indication of any contamination in the oil.

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. Viscosity of sample indicates oil is within SAE 30 range, advise investigate. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0885740	---	---
Sample Date		Client Info		27 Feb 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---
Iron	ppm	ASTM D5185(m)	>100	9	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	5	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>330	1	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
Silicon	ppm	ASTM D5185(m)	>25	8	---	---
Potassium	ppm	ASTM D5185(m)	>20	1	---	---
Fuel	%	ASTM D7593*	>5	0.3	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.1	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	15.5	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Sodium	ppm	ASTM D5185(m)		4	---	---
Boron	ppm	ASTM D5185(m)		79	---	---
Barium	ppm	ASTM D5185(m)		<1	---	---
Molybdenum	ppm	ASTM D5185(m)		159	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		472	---	---
Calcium	ppm	ASTM D5185(m)		1317	---	---
Phosphorus	ppm	ASTM D5185(m)		650	---	---
Zinc	ppm	ASTM D5185(m)		776	---	---
Sulfur	ppm	ASTM D5185(m)		1717	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	8.6	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*		8.61	---	---
Visc @ 100°C	cSt	ASTM D7279(m)		10.0	---	---

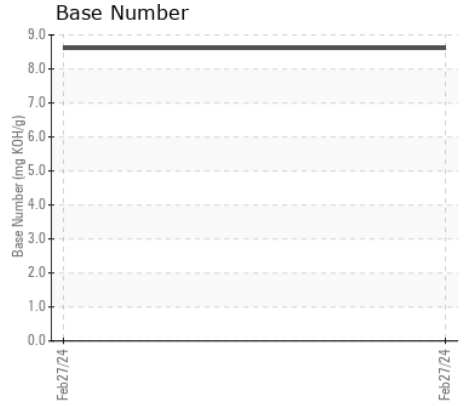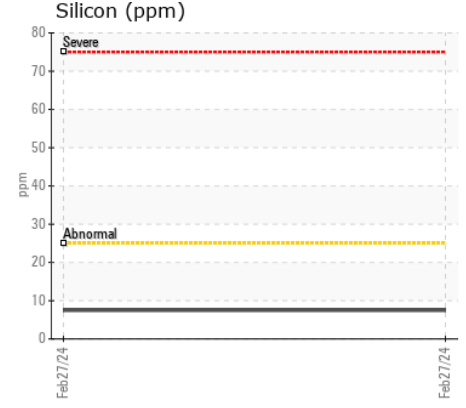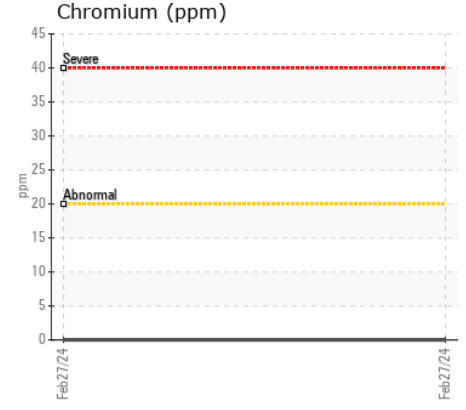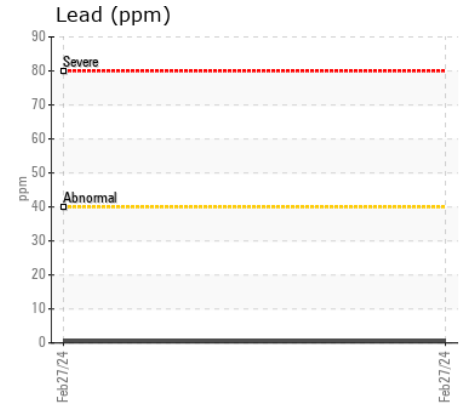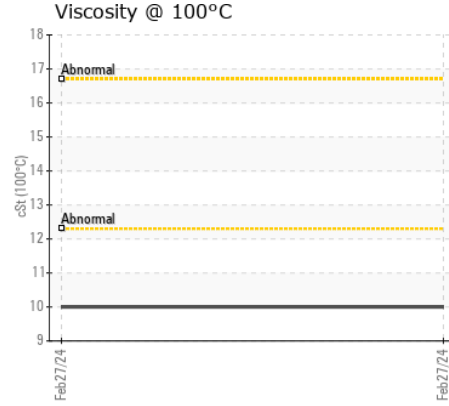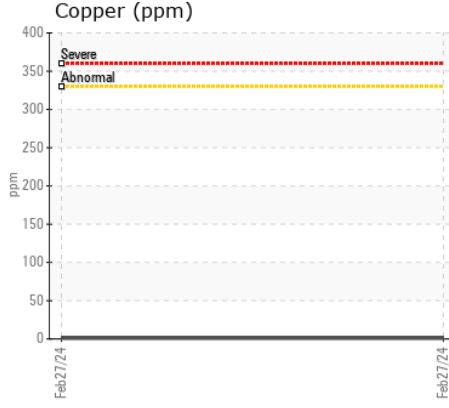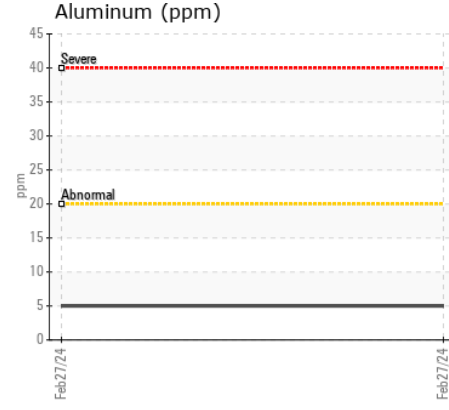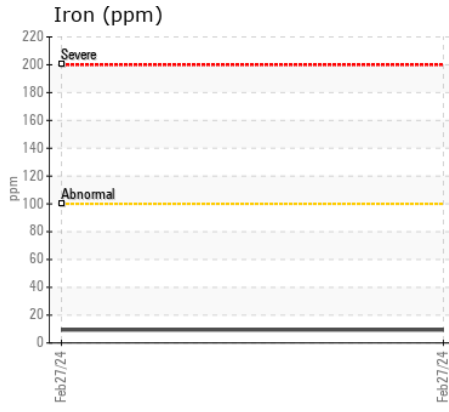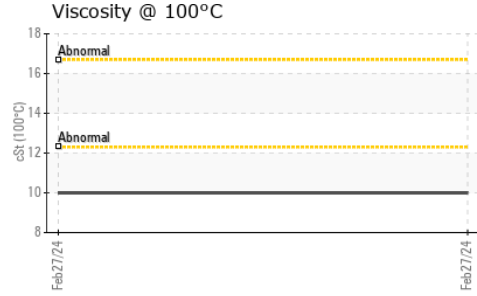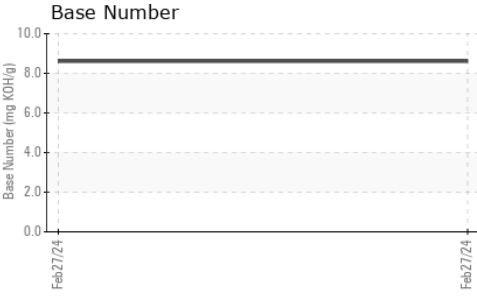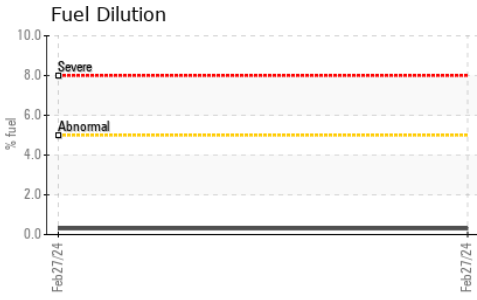

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0885740 **Received** : 08 Mar 2024  
**Lab Number** : 02620725 **Tested** : 11 Mar 2024  
**Unique Number** : 5737835 **Diagnosed** : 11 Mar 2024 - Kevin Marson  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**GENREP LTD.**  
 134 RIVALDA ROAD  
 NORTH YORK, ON  
 CA M9M 2M8  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

T:  
F: