



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
100 NORDEAGLE AVE WHITBY SOBEYS WHITBY RETL SUPP CNTR 45878577

Component
Right Diesel Engine

Fluid
ESSO XD-3 EXTRA 15W40 (20 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005923	PN0004375	PN0003321
Sample Date		Client Info		31 Dec 2023	08 Feb 2023	04 Mar 2022
Machine Age	hrs	Client Info		557	531	506
Oil Age	hrs	Client Info		18	0	0
Filter Age	hrs	Client Info		18	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Not Changd	Not Changd	Changed
Sample Status				NORMAL	NORMAL	ABNORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>90	1	2	3
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	0	0	<1
Titanium	ppm	ASTM D5185(m)	>2	0	<1	0
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	1	2	<1
Lead	ppm	ASTM D5185(m)	>40	0	<1	2
Copper	ppm	ASTM D5185(m)	>330	4	10	14
Tin	ppm	ASTM D5185(m)	>15	0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	10	7	11
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Fuel		WC Method	>3.0	<1.0	1.3	▲ 1.6
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>6	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.6	7.2	4.4
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.1	21.2	20.9
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	1	2	2
Boron	ppm	ASTM D5185(m)		48	64	24
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		42	80	43
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)		444	132	982
Calcium	ppm	ASTM D5185(m)	3780	1661	2103	1076
Phosphorus	ppm	ASTM D5185(m)	1370	984	1141	1069
Zinc	ppm	ASTM D5185(m)	1500	1114	1166	1114
Sulfur	ppm	ASTM D5185(m)	3800	2901	3108	▲ 1605
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.6	13.8	12.9
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.1	12.8	▲ 9

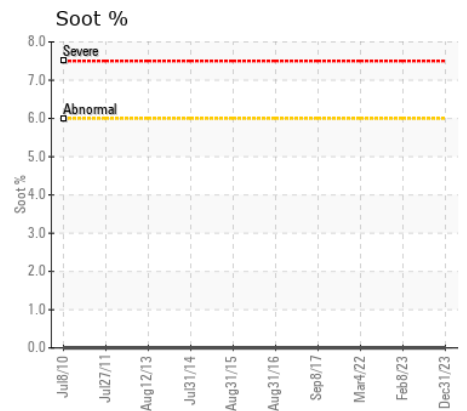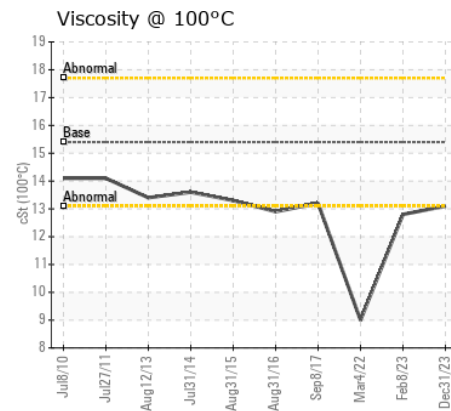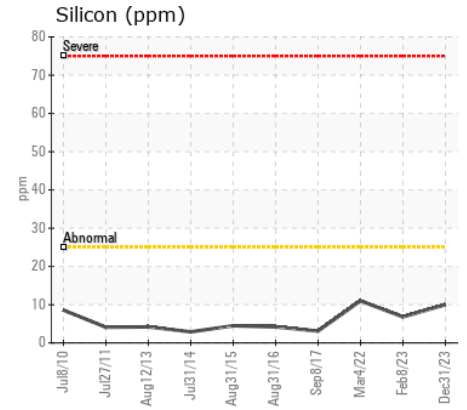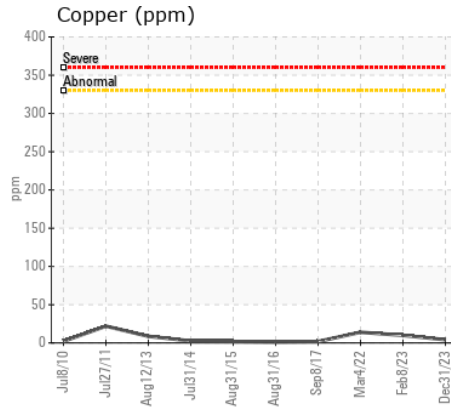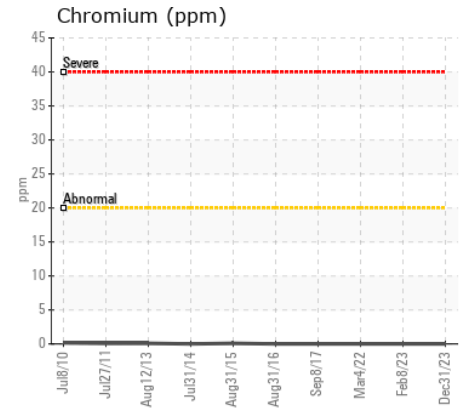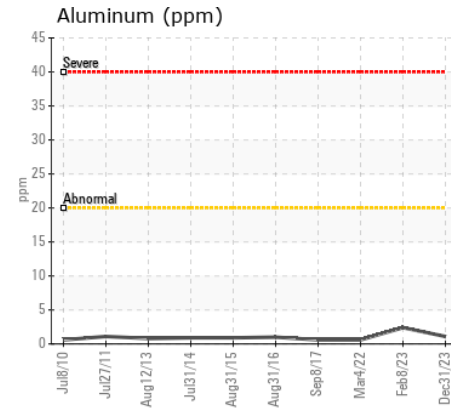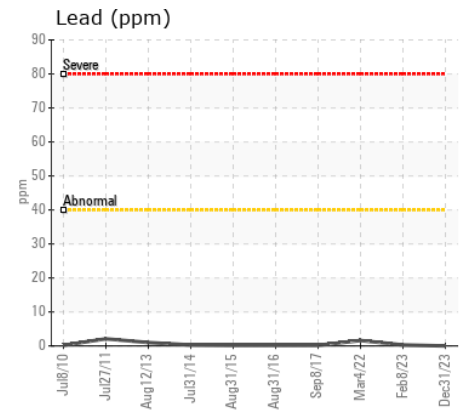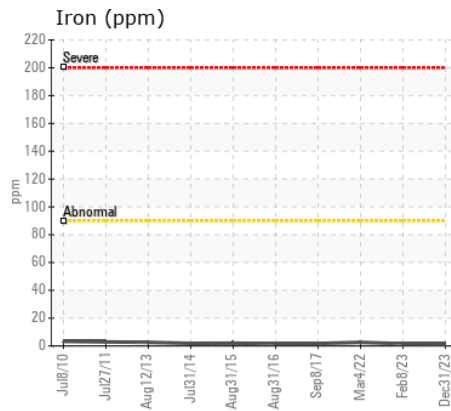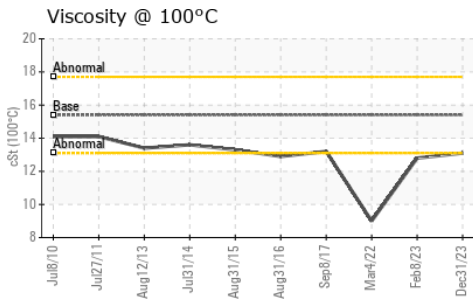

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005923
Lab Number : 02625598
Unique Number : 5750717
Test Package : MOB 1
Received : 01 Apr 2024
Tested : 01 Apr 2024
Diagnosed : 01 Apr 2024 - Wes Davis

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Ryan Udall
 rudall@pwrstn.com
 T: (905)565-1621
 F: (905)629-1499

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.