



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**[85156]**  
 Machine Id  
**72 EGLINTON AVE E TORONTO BELL CANADA 1FZ02071**

Component  
**Front Diesel Engine**  
 Fluid  
**ESSO XD-3 EXTRA 15W40 (300 LTR)**

**RECOMMENDATION**

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MOB 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. this testkit includes BN to determine the suitability of the oil for continued use.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PN0005880</b>	PN0004368	PN0003238
Sample Date		Client Info		<b>25 Mar 2024</b>	13 Mar 2023	25 Apr 2022
Machine Age	hrs	Client Info		<b>397</b>	385	345
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	MARGINAL	NORMAL

**WEAR**

Metal levels are typical for a new component breaking in. Component wear rates appear to be normal (unconfirmed).

Iron	ppm	ASTM D5185(m)	>100	<b>3</b>	3	3
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>2	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185(m)	>2	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>25	<b>&lt;1</b>	1	1
Lead	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185(m)	>330	<b>3</b>	3	3
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0

**CONTAMINATION**










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>&lt;1</b>	2	3
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	1
Fuel		WC Method	>5	<b>&lt;1.0</b>	▲ 2.7	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>6.9</b>	7.2	4.9
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>16.9</b>	19.4	14.5
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service (unconfirmed).

Sodium	ppm	ASTM D5185(m)	>192	<b>7</b>	7	7
Boron	ppm	ASTM D5185(m)		<b>18</b>	19	19
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>45</b>	46	44
Manganese	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185(m)		<b>649</b>	654	676
Calcium	ppm	ASTM D5185(m)	3780	<b>1445</b>	1504	1418
Phosphorus	ppm	ASTM D5185(m)	1370	<b>990</b>	1095	1057
Zinc	ppm	ASTM D5185(m)	1500	<b>1142</b>	1162	1169
Sulfur	ppm	ASTM D5185(m)	3800	<b>3034</b>	3197	3125
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>13.4</b>	13.6	9.0
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	<b>12.9</b>	13.0	13.3

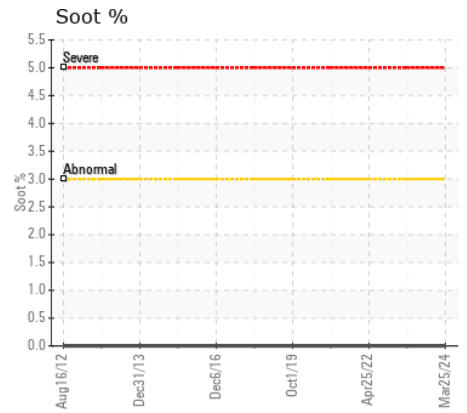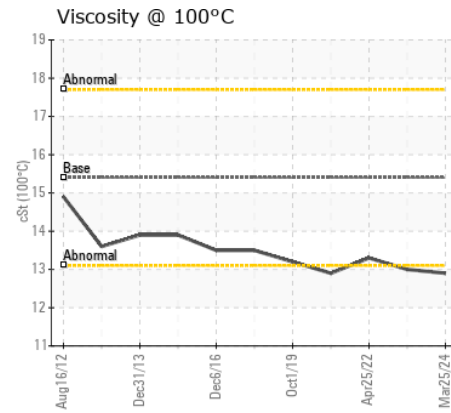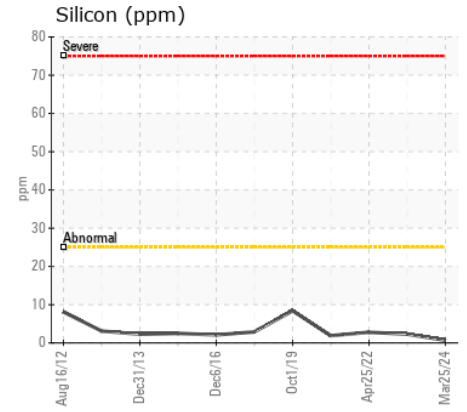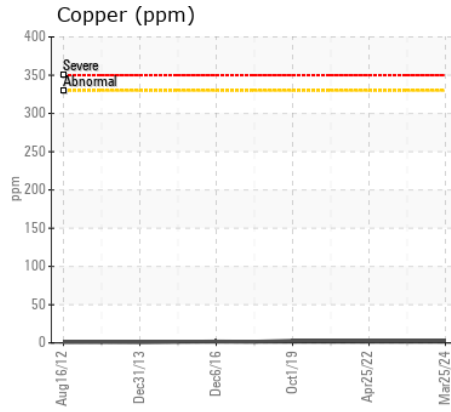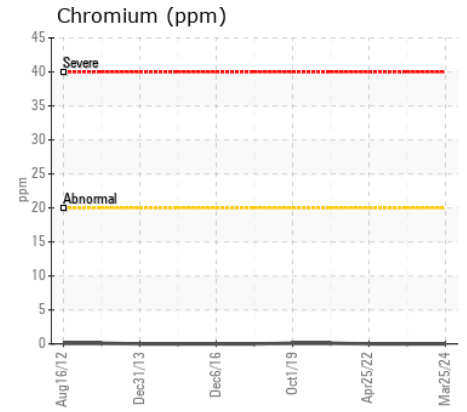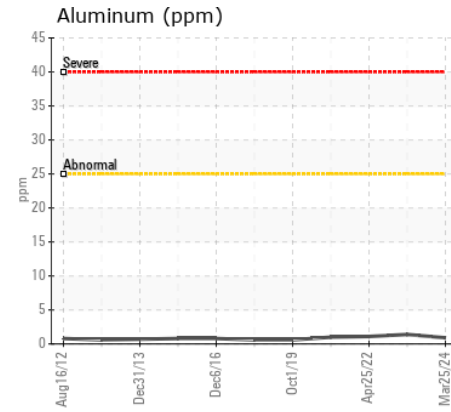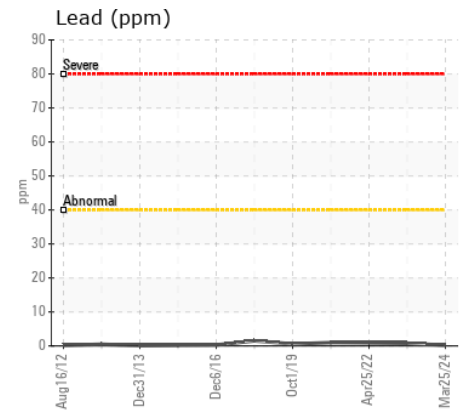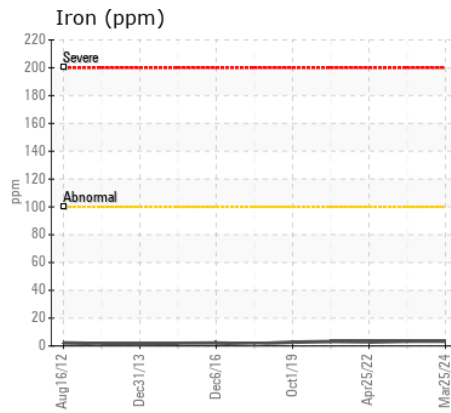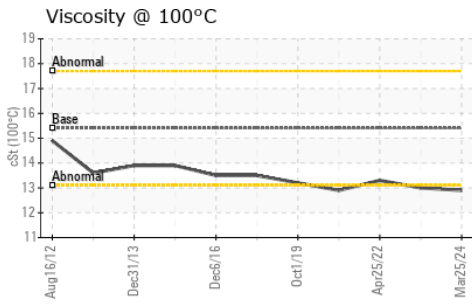

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PN0005880 **Received** : 01 Apr 2024  
**Lab Number** : 02625599 **Tested** : 01 Apr 2024  
**Unique Number** : 5750718 **Diagnosed** : 01 Apr 2024 - Wes Davis  
**Test Package** : MOB 1

**POWER STATION INC.**  
 1050 JAYSON COURT  
 MISSISSAUGA, ON  
 CA L4W 2V5  
 Contact: Brett Kinkley  
 Bkinkley@pwrstn.com  
 T:  
 F: (905)665-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.