



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
MY CAPE BRETON HOME [6100270833]
Machine Id
JOHN DEERE PE4045L113987
Component
Diesel Engine
Fluid
PETRO CANADA DURON SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0021298	WA0016787	---
Sample Date		Client Info		25 Mar 2024	07 Oct 2021	---
Machine Age	hrs	Client Info		769	496	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	NORMAL	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>51	9	3	---
Chromium	ppm	ASTM D5185(m)	>11	0	0	---
Nickel	ppm	ASTM D5185(m)	>5	0	0	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)	>3	0	<1	---
Aluminum	ppm	ASTM D5185(m)	>31	1	<1	---
Lead	ppm	ASTM D5185(m)	>26	0	0	---
Copper	ppm	ASTM D5185(m)	>26	<1	<1	---
Tin	ppm	ASTM D5185(m)	>4	0	<1	---
Vanadium	ppm	ASTM D5185(m)		0	0	---
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>22	4	2	---
Potassium	ppm	ASTM D5185(m)	>20	<1	6	---
Fuel		WC Method	>2.1	<1.0	<1.0	---
Water		WC Method	>0.21	NEG	NEG	---
Glycol		WC Method		NEG	0.0	---
Soot %	%	ASTM D7844*	>3	0	0	---
Nitration	Abs/cm	ASTM D7624*	>20	5.2	5.6	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.2	20.7	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	VLITE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.21	NEG	NEG	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>31	1	2	---
Boron	ppm	ASTM D5185(m)	1	12	164	---
Barium	ppm	ASTM D5185(m)	1	0	<1	---
Molybdenum	ppm	ASTM D5185(m)	60	54	<1	---
Manganese	ppm	ASTM D5185(m)	1	0	<1	---
Magnesium	ppm	ASTM D5185(m)	1010	902	11	---
Calcium	ppm	ASTM D5185(m)	1070	1149	2222	---
Phosphorus	ppm	ASTM D5185(m)	1150	974	1029	---
Zinc	ppm	ASTM D5185(m)	1270	1174	1151	---
Sulfur	ppm	ASTM D5185(m)	2060	2525	3189	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.6	16.4	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	13.9	14.1	---

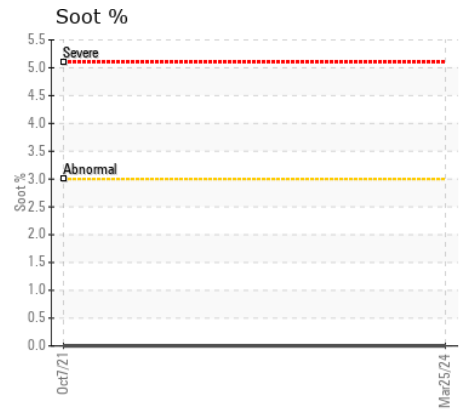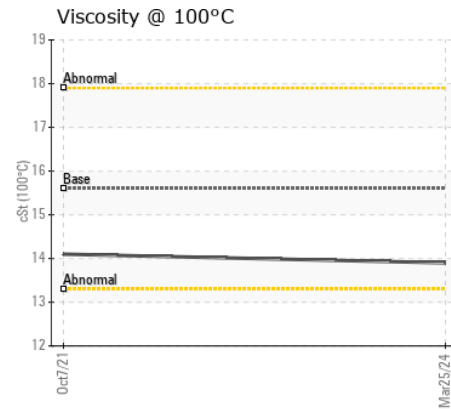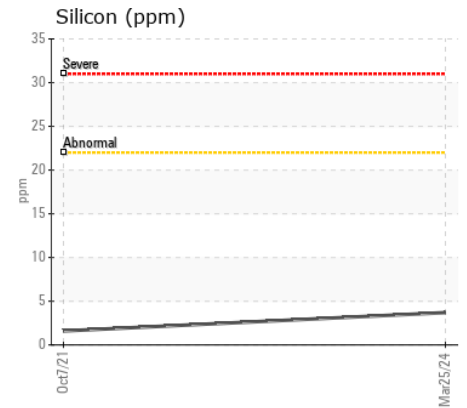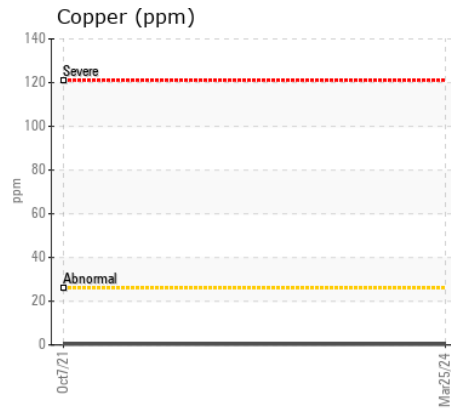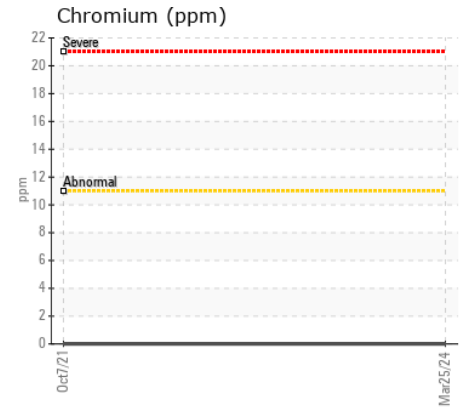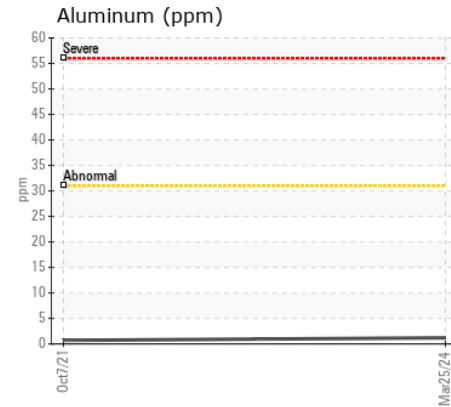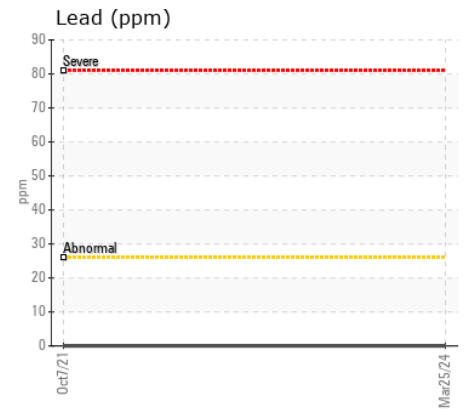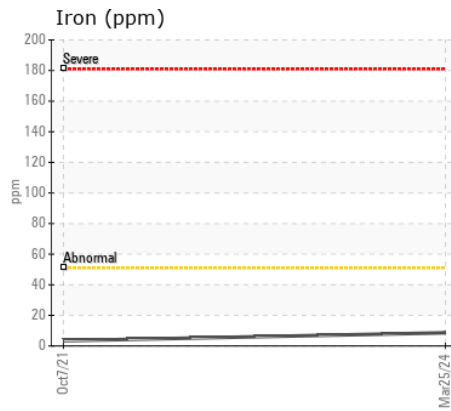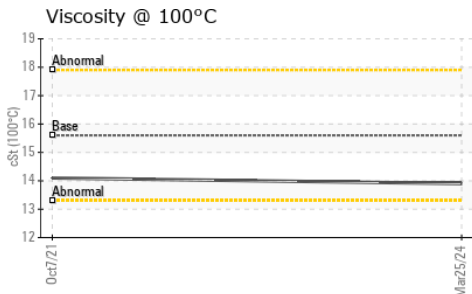

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021298 **Received** : 02 Apr 2024
Lab Number : 02626021 **Tested** : 02 Apr 2024
Unique Number : 5759153 **Diagnosed** : 02 Apr 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325