



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[81587]

Machine Id

161 BAY ST E TORONTO BROOKFIELD PROPERTIES 3YF00425

Component

Rear Diesel Engine

Fluid

ESSO XD-3 EXTRA 15W40 (260 LTR)

RECOMMENDATION

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MOB 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. this testkit includes BN to determine the suitability of the oil for continued use.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0005944	PN0004715	---
Sample Date		Client Info		27 Mar 2024	30 Mar 2023	---
Machine Age	hrs	Client Info		1412	1374	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	ABNORMAL	---

WEAR

Component wear rates appear to be normal (unconfirmed).

Iron	ppm	ASTM D5185(m)	>100	2	3	---
Chromium	ppm	ASTM D5185(m)	>20	0	0	---
Nickel	ppm	ASTM D5185(m)	>2	0	<1	---
Titanium	ppm	ASTM D5185(m)	>2	0	<1	---
Silver	ppm	ASTM D5185(m)	>2	0	0	---
Aluminum	ppm	ASTM D5185(m)	>25	<1	1	---
Lead	ppm	ASTM D5185(m)	>40	0	<1	---
Copper	ppm	ASTM D5185(m)	>330	<1	<1	---
Tin	ppm	ASTM D5185(m)	>15	0	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	7	---
Potassium	ppm	ASTM D5185(m)	>20	0	0	---
Fuel		WC Method	>5	<1.0	1	---
Water		WC Method	>0.2	NEG	NEG	---
Glycol		WC Method		NEG	NEG	---
Soot %	%	ASTM D7844*	>3	0	0	---
Nitration	Abs/cm	ASTM D7624*	>20	5.1	5.9	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.2	25.5	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service (unconfirmed).

Sodium	ppm	ASTM D5185(m)	>192	1	3	---
Boron	ppm	ASTM D5185(m)		14	64	---
Barium	ppm	ASTM D5185(m)		0	0	---
Molybdenum	ppm	ASTM D5185(m)		54	40	---
Manganese	ppm	ASTM D5185(m)		0	<1	---
Magnesium	ppm	ASTM D5185(m)		859	499	---
Calcium	ppm	ASTM D5185(m)	3780	1161	1783	---
Phosphorus	ppm	ASTM D5185(m)	1370	985	1014	---
Zinc	ppm	ASTM D5185(m)	1500	1131	1079	---
Sulfur	ppm	ASTM D5185(m)	3800	2518	2589	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	15.1	20.3	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.7	▲ 11.2	---

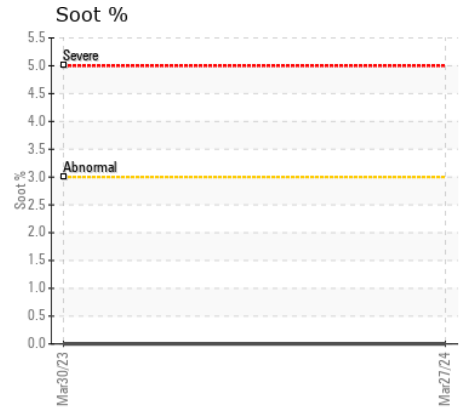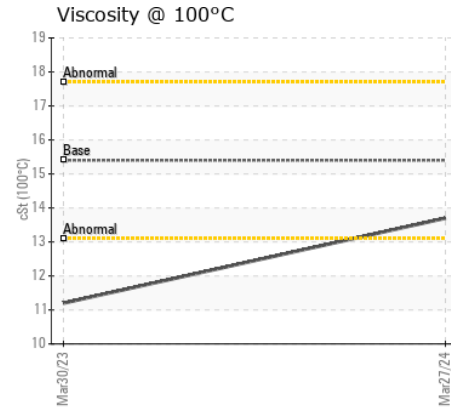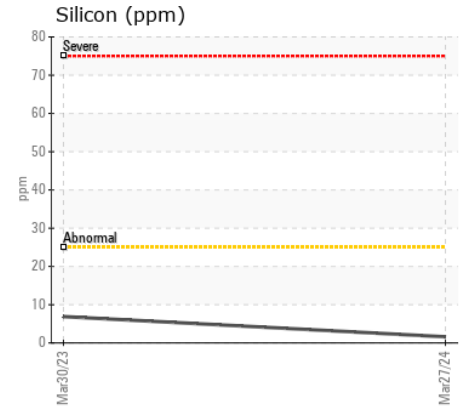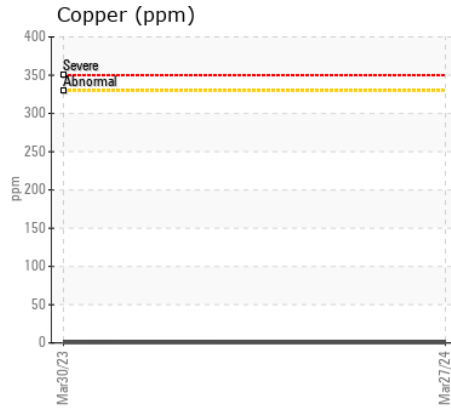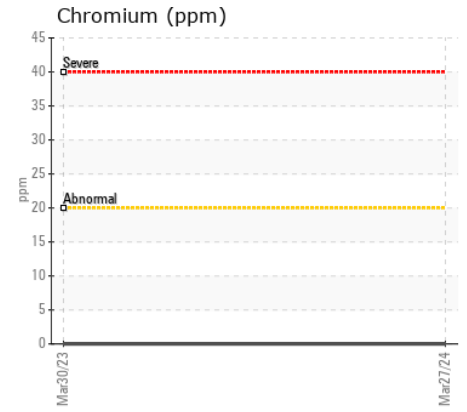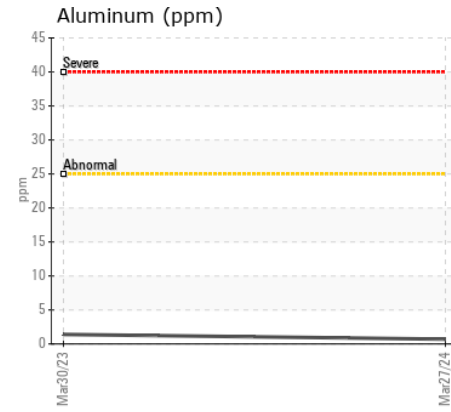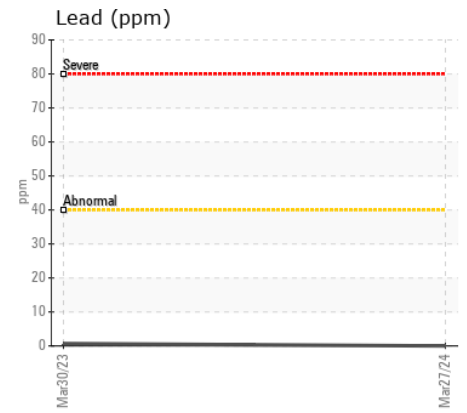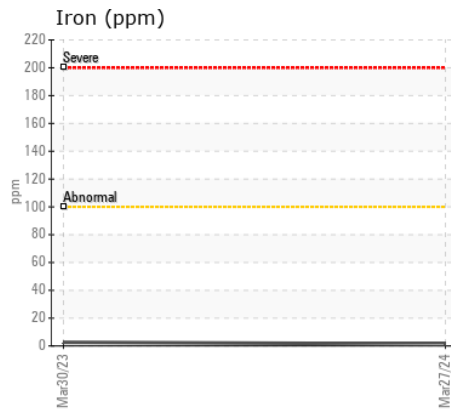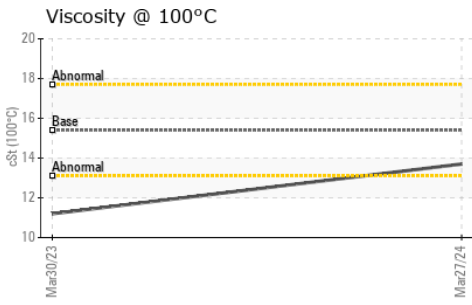

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0005944 **Received** : 03 Apr 2024
Lab Number : 02626330 **Tested** : 03 Apr 2024
Unique Number : 5759462 **Diagnosed** : 03 Apr 2024 - Wes Davis
Test Package : MOB 1

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.