



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

Shelter Bay

Machine Id

JOHN DEERE John Deere feed generator (S/N PE6068N013295)

Component

Diesel Engine

Fluid

MOBIL DELVAC 1 5W40 (30 LTR)

## RECOMMENDATION

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0894275	---	---
Sample Date		Client Info		16 Mar 2024	---	---
Machine Age	hrs	Client Info		12890	---	---
Oil Age	hrs	Client Info		480	---	---
Filter Age	hrs	Client Info		160	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>51	11	---	---
Chromium	ppm	ASTM D5185(m)	>11	0	---	---
Nickel	ppm	ASTM D5185(m)	>5	<1	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>31	<1	---	---
Lead	ppm	ASTM D5185(m)	>26	<1	---	---
Copper	ppm	ASTM D5185(m)	>26	<1	---	---
Tin	ppm	ASTM D5185(m)	>4	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

## CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>22	1	---	---
Potassium	ppm	ASTM D5185(m)	>20	0	---	---
Fuel		WC Method	>2.1	<1.0	---	---
Water		WC Method	>0.21	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0.4	---	---
Nitration	Abs/cm	ASTM D7624*	>20	7.0	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	20.0	---	---
Emulsified Water	scalar	Visual*	>0.21	NEG	---	---

## FLUID CONDITION

Additive levels indicate the addition of a different brand, or type of oil. The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)	>31	<1	---	---
Boron	ppm	ASTM D5185(m)	291	2	---	---
Barium	ppm	ASTM D5185(m)	0.0	0	---	---
Molybdenum	ppm	ASTM D5185(m)	8.0	57	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)	624	914	---	---
Calcium	ppm	ASTM D5185(m)	2158	1193	---	---
Phosphorus	ppm	ASTM D5185(m)	1132	970	---	---
Zinc	ppm	ASTM D5185(m)	1300	1182	---	---
Sulfur	ppm	ASTM D5185(m)	3616	2580	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	14.3	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*	11.0	9.70	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.0	14.1	---	---

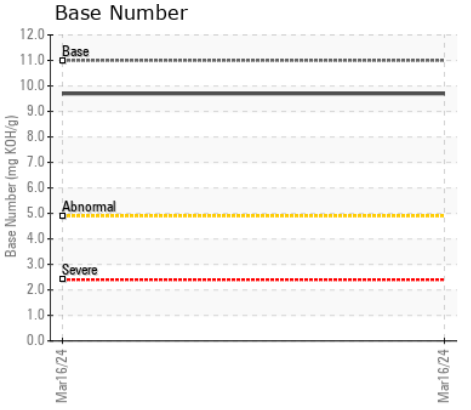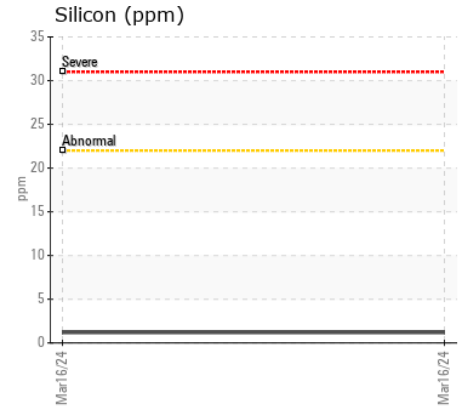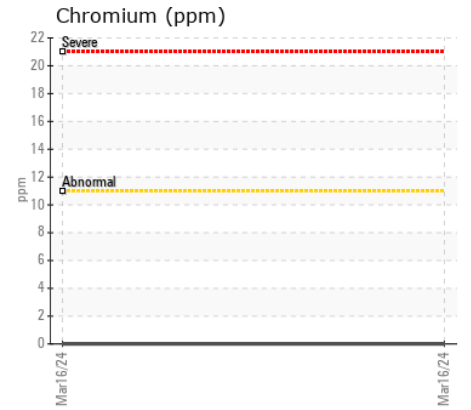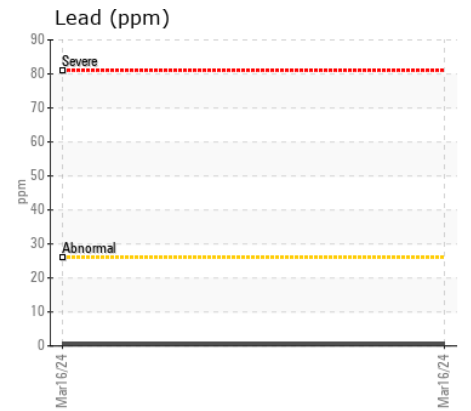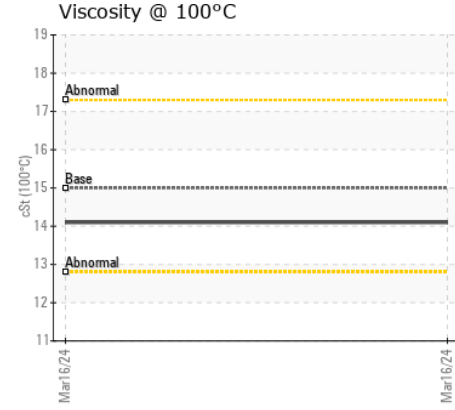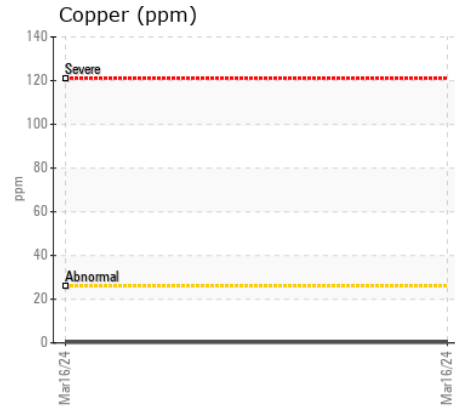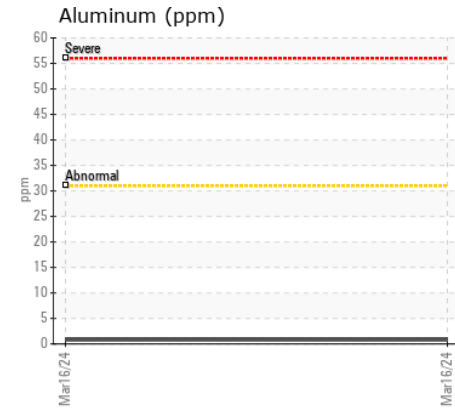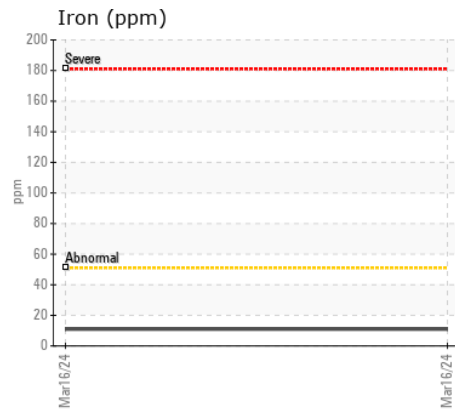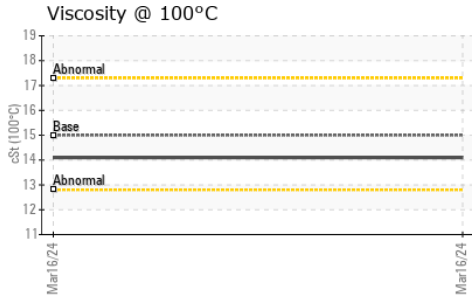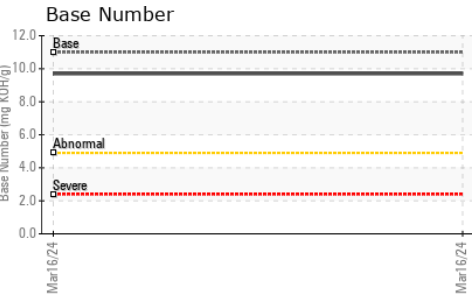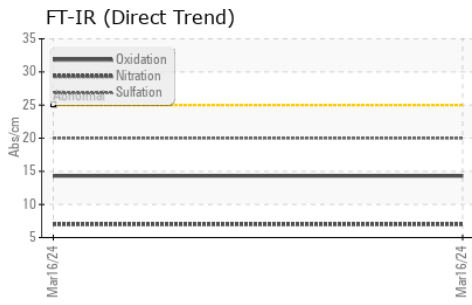

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0894275 **Received** : 08 Apr 2024  
**Lab Number** : 02627251 **Tested** : 09 Apr 2024  
**Unique Number** : 5760383 **Diagnosed** : 09 Apr 2024 - Wes Davis  
**Test Package** : MOB 2

**Mowi Canada West**  
 7200 Coho Road  
 Port Hardy, BC  
 CA V0N 2P0  
 Contact: Brian Dalton  
 brian.dalton@mowi.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

T:  
F: