



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
GARDNER DENVER NO UNIT PC0057652

Component
Compressor

Fluid
{not provided} (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PC0057652	---	---
Sample Date		Client Info		27 Feb 2024	---	---
Machine Age	hrs	Client Info		45558	---	---
Oil Age	hrs	Client Info		4721	---	---
Filter Age	hrs	Client Info		6998	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

PQ		ASTM D8184*		0	---	---
Iron	ppm	ASTM D5185(m)	>50	0	---	---
Chromium	ppm	ASTM D5185(m)	>5	0	---	---
Nickel	ppm	ASTM D5185(m)		0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)		0	---	---
Aluminum	ppm	ASTM D5185(m)	>15	0	---	---
Lead	ppm	ASTM D5185(m)	>65	0	---	---
Copper	ppm	ASTM D5185(m)	>65	<1	---	---
Tin	ppm	ASTM D5185(m)	>10	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION










The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>35	0	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Water	%	ASTM D6304*	>0.1	0.001	---	---
ppm Water	ppm	ASTM D6304*	>1000	1	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	VLITE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.1	NEG	---	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185(m)		0	---	---
Boron	ppm	ASTM D5185(m)		<1	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		0	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		0	---	---
Calcium	ppm	ASTM D5185(m)		0	---	---
Phosphorus	ppm	ASTM D5185(m)		<1	---	---
Zinc	ppm	ASTM D5185(m)		<1	---	---
Sulfur	ppm	ASTM D5185(m)		2590	---	---
Acid Number (AN)	mg KOH/g	ASTM D974*		0.05	---	---
Visc @ 40°C	cSt	ASTM D7279(m)		47.4	---	---
Visc @ 100°C	cSt	ASTM D7279(m)		7.3	---	---
Viscosity Index (VI)	Scale	ASTM D2270*		115	---	---

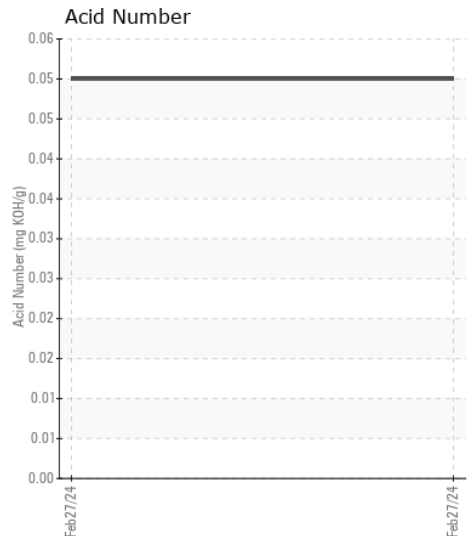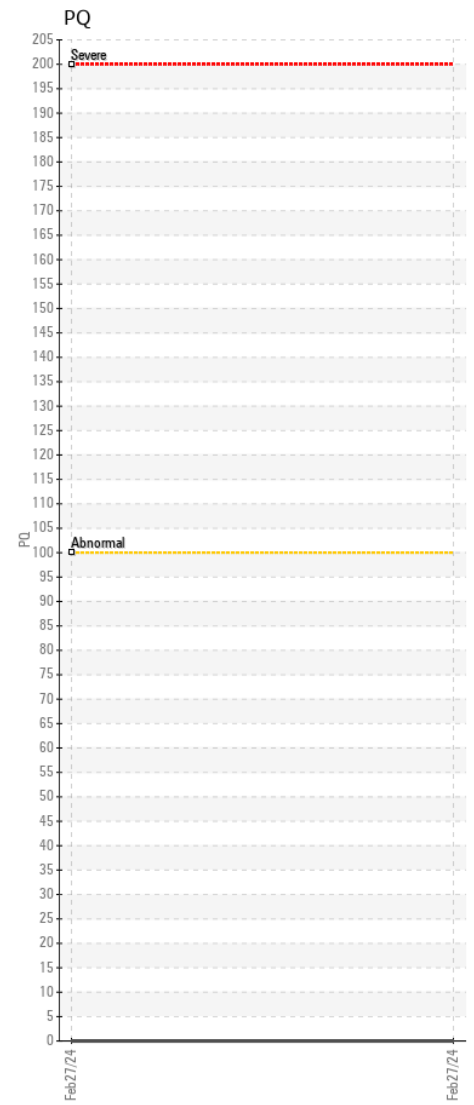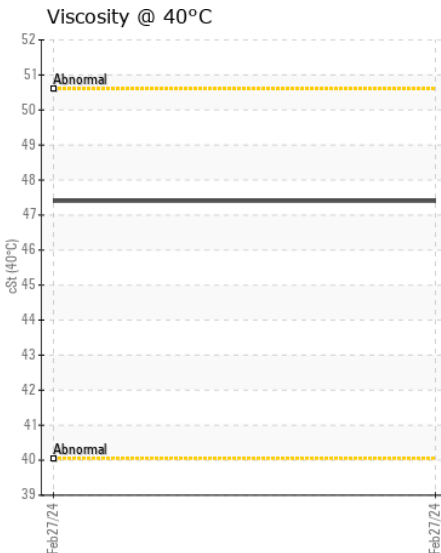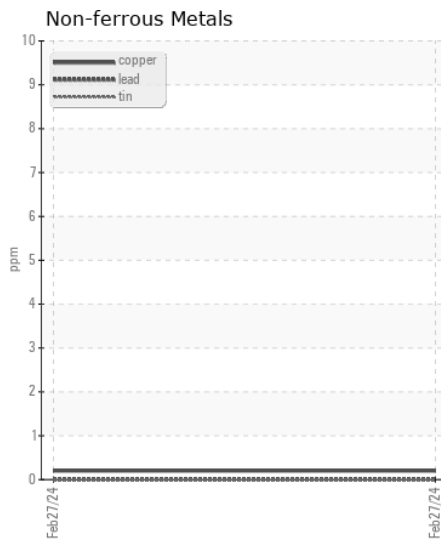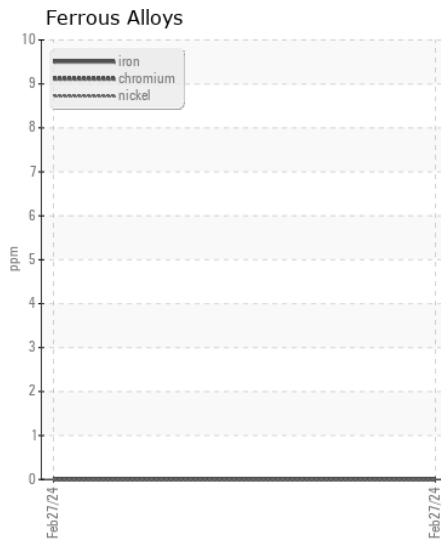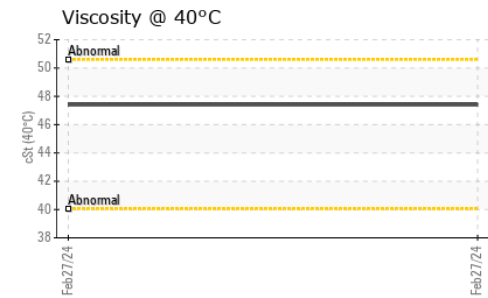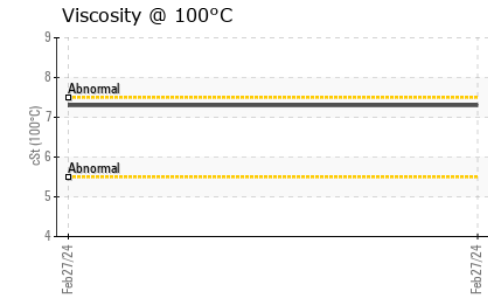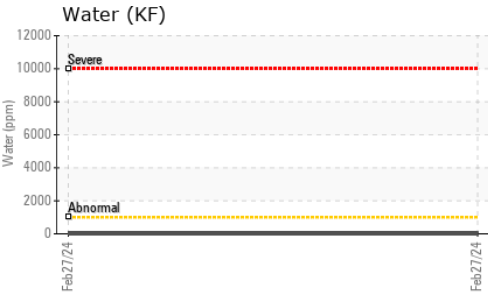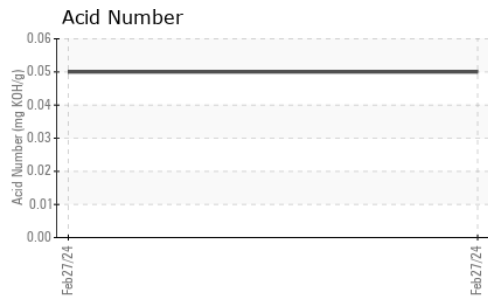

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0057652
Lab Number : 02627368
Unique Number : 5760500
Test Package : IND 2 (Additional Tests: KF, KV100, VI)

Received : 08 Apr 2024
Tested : 10 Apr 2024
Diagnosed : 10 Apr 2024 - Wes Davis

CAMTAC MFG (division of Linamar)

148 ARROW RD
GUELPH, ON
CA N1K 1T4

Contact: Stu Burbidge
stu.burbidge@linamar.com

T: (519)780-2270
F: (519)780-2274

To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Validity of results and interpretation are based on the sample and information as supplied.